

Application Type

Renewal

Facility Type

Non-Municipal

Major / Minor

MinorApplication No. PA0228184APS ID 1133357Authorization ID 1520054
**NPDES PERMIT FACT SHEET  
INDIVIDUAL SEWAGE**
**Applicant and Facility Information**

Applicant Name	<u>J&amp;D Campground</u>	Facility Name	<u>J &amp; D Campground</u>
Applicant Address	<u>973 Southern Drive</u>	Facility Address	<u>973 Southern Drive</u>
	<u>Catawissa, PA 17820-8409</u>		<u>Catawissa, PA 17820-8409</u>
Applicant Contact	<u>Curt Jones</u>	Facility Contact	<u>John Bauer</u>
Applicant Phone	<u>(570) 336-6854</u>	Facility Phone	<u>(570) 784-1653</u>
Client ID	<u>65870</u>	Site ID	<u>254977</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Franklin Township</u>
Connection Status	<u>No Exceptions Allowed</u>	County	<u>Columbia</u>
Date Application Received	<u>March 17, 2025</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>March 20, 2025</u>	If No, Reason	
Purpose of Application	<u>Renewal of a NPDES Permit</u>		


**Summary of Review**

The subject sewage treatment plant serves a seasonal campground in Franklin Township, Columbia.

Sludge use and disposal description and location(s): The facility's sludge is transferred to other WWTPs for further processing.

**Public Participation**

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
✓		 Keith C. Allison / Project Manager	August 20, 2025
✓		 Nicholas W. Hartranft, P.E. / Environmental Engineer Manager	August 22, 2025

**Discharge, Receiving Waters and Water Supply Information**

Outfall No.	001	Design Flow (MGD)	0.02
Latitude	40° 54' 15.74"	Longitude	-76° 30' 23.67"
Quad Name	Danville, PA	Quad Code	1133
Wastewater Description: Sewage Effluent			
Receiving Waters	Roaring Creek (TSF)	Stream Code	27450
NHD Com ID	65642441	RMI	4.6
Drainage Area	47 mi <sup>2</sup>	Yield (cfs/mi <sup>2</sup> )	0.091
Q <sub>7-10</sub> Flow (cfs)	4.3	Q <sub>7-10</sub> Basis	USGS Streamstats
Elevation (ft)	540	Slope (ft/ft)	0.00391
Watershed No.	5-E	Chapter 93 Class.	TSF
Existing Use	N/A	Existing Use Qualifier	N/A
Exceptions to Use	None	Exceptions to Criteria	None
Assessment Status	Impaired		
Cause(s) of Impairment	PATHOGENS		
Source(s) of Impairment	SOURCE UNKNOWN		
TMDL Status	Undeveloped	Name	
Nearest Downstream Public Water Supply Intake	Danville Public Water Authority		
PWS Waters	Susquehanna River	Distance from Outfall (mi)	~9

Comments: The discharge is not expected to be contributing to the above-noted impairment to Roaring Creek by pathogens. The facility generally meets its fecal coliform limitations.

No downstream water supply is expected to be affected by this discharge with the limitations and monitoring proposed.

Treatment Facility Summary				
<b>Treatment Facility Name:</b> J&D Campground WWTP				
<b>WQM Permit No.</b>	<b>Issuance Date</b>			
1900406	11/7/2000			
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Extended Aeration	Chlorine With Dechlorination	0.02
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.02		Not Overloaded	Aerobic Digestion	

Changes Since Last Permit Issuance: None

Other Comments: The treatment facilities as permitted under WQM Permit No. 1900406 consist of bar screen, equalization, aeration basin, clarifier, tablet chlorination, chlorine contact tank, tablet dechlorination, dechlorination tank, and aerated digester.

Compliance History

DMR Data for Outfall 001 (from July 1, 2024 to June 30, 2025)

Parameter	JUN-25	MAY-25	APR-25	MAR-25	FEB-25	JAN-25	DEC-24	NOV-24	OCT-24	SEP-24	AUG-24	JUL-24
Flow (MGD) Average Monthly	0.005	0.003	ND	ND	ND	ND	ND	ND	0.0033	0.003	0.003	0.0037
Flow (MGD) Daily Maximum	0.009	0.008							0.022	0.01	0.01	0.017
pH (S.U.) Instantaneous Minimum	6.48	6.05							6.47	6.25	6.25	6.86
pH (S.U.) Instantaneous Maximum	7.80	8.4							7.50	7.46	7.46	8.13
DO (mg/L) Daily Minimum	0.05	0.16							0.24	0.42	0.42	0.12
TRC (mg/L) Average Monthly	< 0.1	< 0.05							0.04	0.05	0.05	0.04
TRC (mg/L) Instantaneous Maximum	0.79	0.29							0.09	0.13	0.13	0.09
CBOD5 (mg/L) Average Monthly	15.0	< 13.0							< 6.0	< 6.0	< 6.0	< 6.0
CBOD5 (mg/L) Instantaneous Maximum	15.1	20.2							< 6.0	< 6.0	< 6.0	< 6.0
TSS (mg/L) Average Monthly	23.0	22.0							11.0	< 6.0	< 6.0	< 11.0
TSS (mg/L) Instantaneous Maximum	24.5	24.0							16.0	6.4	6.0	16.5
Fecal Coliform (No./100 ml) Geometric Mean	21.0	7.0							< 10.0	< 26.0	< 26.0	< 1.0
Fecal Coliform (No./100 ml) Instantaneous Maximum	137.9	7.5							95.9	260.3	260.3	1.0

Compliance History, Cont'd

Summary of Inspections:	The most recent inspection of the facility by the Department on May 16, 2025 identified no violations at the time of inspection.
Other Comments:	A query in WMS found no open violations in eFACTS for J&D Campground.

Existing Limitations and Monitoring Requirements

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/week	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	Report Daily Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
CBOD5	XXX	XXX	XXX	25	XXX	50	2/month	Grab
TSS	XXX	XXX	XXX	30	XXX	60	2/month	Grab
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab

**Development of Effluent Limitations**

Outfall No. 001  
Latitude 40° 54' 15.20"  
Wastewater Description: Sewage Effluent

Design Flow (MGD) 0.02  
Longitude -76° 30' 23.90"

**Technology-Based Limitations**

The following technology-based limitations apply, subject to water quality analysis and BPJ where applicable:

Pollutant	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD <sub>5</sub>	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

Comments: The above limitations are included in the existing permit.

**Water Quality-Based Limitations**

**CBOD<sub>5</sub>, DO, and NH<sub>3</sub>-N**

The WQM7.0 model allows the Department to evaluate point source discharges of dissolved oxygen (DO), carbonaceous BOD (CBOD<sub>5</sub>), and ammonia nitrogen (NH<sub>3</sub>-N) into free-flowing streams and rivers. To accomplish this the model simulates two basic processes: the mixing and degradation of NH<sub>3</sub>-N in the stream and the mixing and consumption of DO in the stream due to the degradation of CBOD<sub>5</sub> and NH<sub>3</sub>-N. WQM7.0 modeling was performed for the discharge to Roaring Creek and showed that the secondary treatment limits listed above are adequate to protect the receiving waters. See Attachment B. NH<sub>3</sub>-N monitoring was removed at the last permit renewal due to low levels (the highest level was 0.29 mg/L). Therefore, regular monitoring for NH<sub>3</sub>-N will not be required at this time.

**TRC**

The Department uses a modeling spreadsheet to determine necessary WQBELs for TRC toxicity based on instream dilution. The attached modeling results (See attachment C) show that the BAT limit of 0.5 mg/l is adequate to protect the receiving stream.

**Toxics Management**

No further "Reasonable Potential Analysis" was performed to determine additional toxic parameters as candidates for limitations for this 0.02 MGD sewage treatment facility receiving no industrial influent.

**Chesapeake Bay Requirements**

A portion of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the Water Pollution Control Act, 33 U.S.C. §1313(d). Total Nitrogen and Total Phosphorus cap loads have been established for significant dischargers in Pennsylvania to reduce the total nutrient load to the Bay and meet State of Maryland Water Quality Standards. This facility is considered an existing Phase 5, insignificant Chesapeake Bay discharger per the Phase III Watershed Implementation Plan (WIP) and thus has not received Cap Loads. Monitoring under a previous permit found the Total Nitrogen and Total Phosphorus to average 28.0 and 2.7 mg/L, respectively. Because the nutrient load from the discharge has adequately been characterized no further nutrient monitoring will be required at this time.

**e. Coli**

Annual e. coli monitoring will be required at this time due to recent changes to Chapter 93 of the Departments regulations and Department policy.

**Best Professional Judgment (BPJ) Limitations**

No additional BPJ limits are needed beyond the water quality and technology-based limits noted above.

**Anti-Backsliding**

No water quality based or BPJ limits were made less stringent consistent with the anti-backsliding requirements of 40 CFR 122.44(l).

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (386-0400-001), SOPs and/or BPJ.

**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/week	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
DO	XXX	XXX	Report Daily Min	XXX	XXX	XXX	1/day	Grab
TRC	XXX	XXX	XXX	0.5	XXX	1.6	1/day	Grab
CBOD5	XXX	XXX	XXX	25	XXX	50	2/month	Grab
TSS	XXX	XXX	XXX	30	XXX	60	2/month	Grab
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	Report Daily Max	XXX	1/year	Grab


Compliance Sampling Location: Outfall 001

Other Comments: E. Coli monitoring is new as mentioned above.

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment <b>B</b> )
<input type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [REDACTED])
<input checked="" type="checkbox"/>	TRC Model Spreadsheet (see Attachment <b>C</b> )
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [REDACTED])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input checked="" type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input checked="" type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input checked="" type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input checked="" type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input checked="" type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input checked="" type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input checked="" type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input type="checkbox"/>	SOP: [REDACTED]
<input type="checkbox"/>	Other: [REDACTED]

Attachments:

- Discharge Location Map
- WQM7.0 Model
- TRC Model

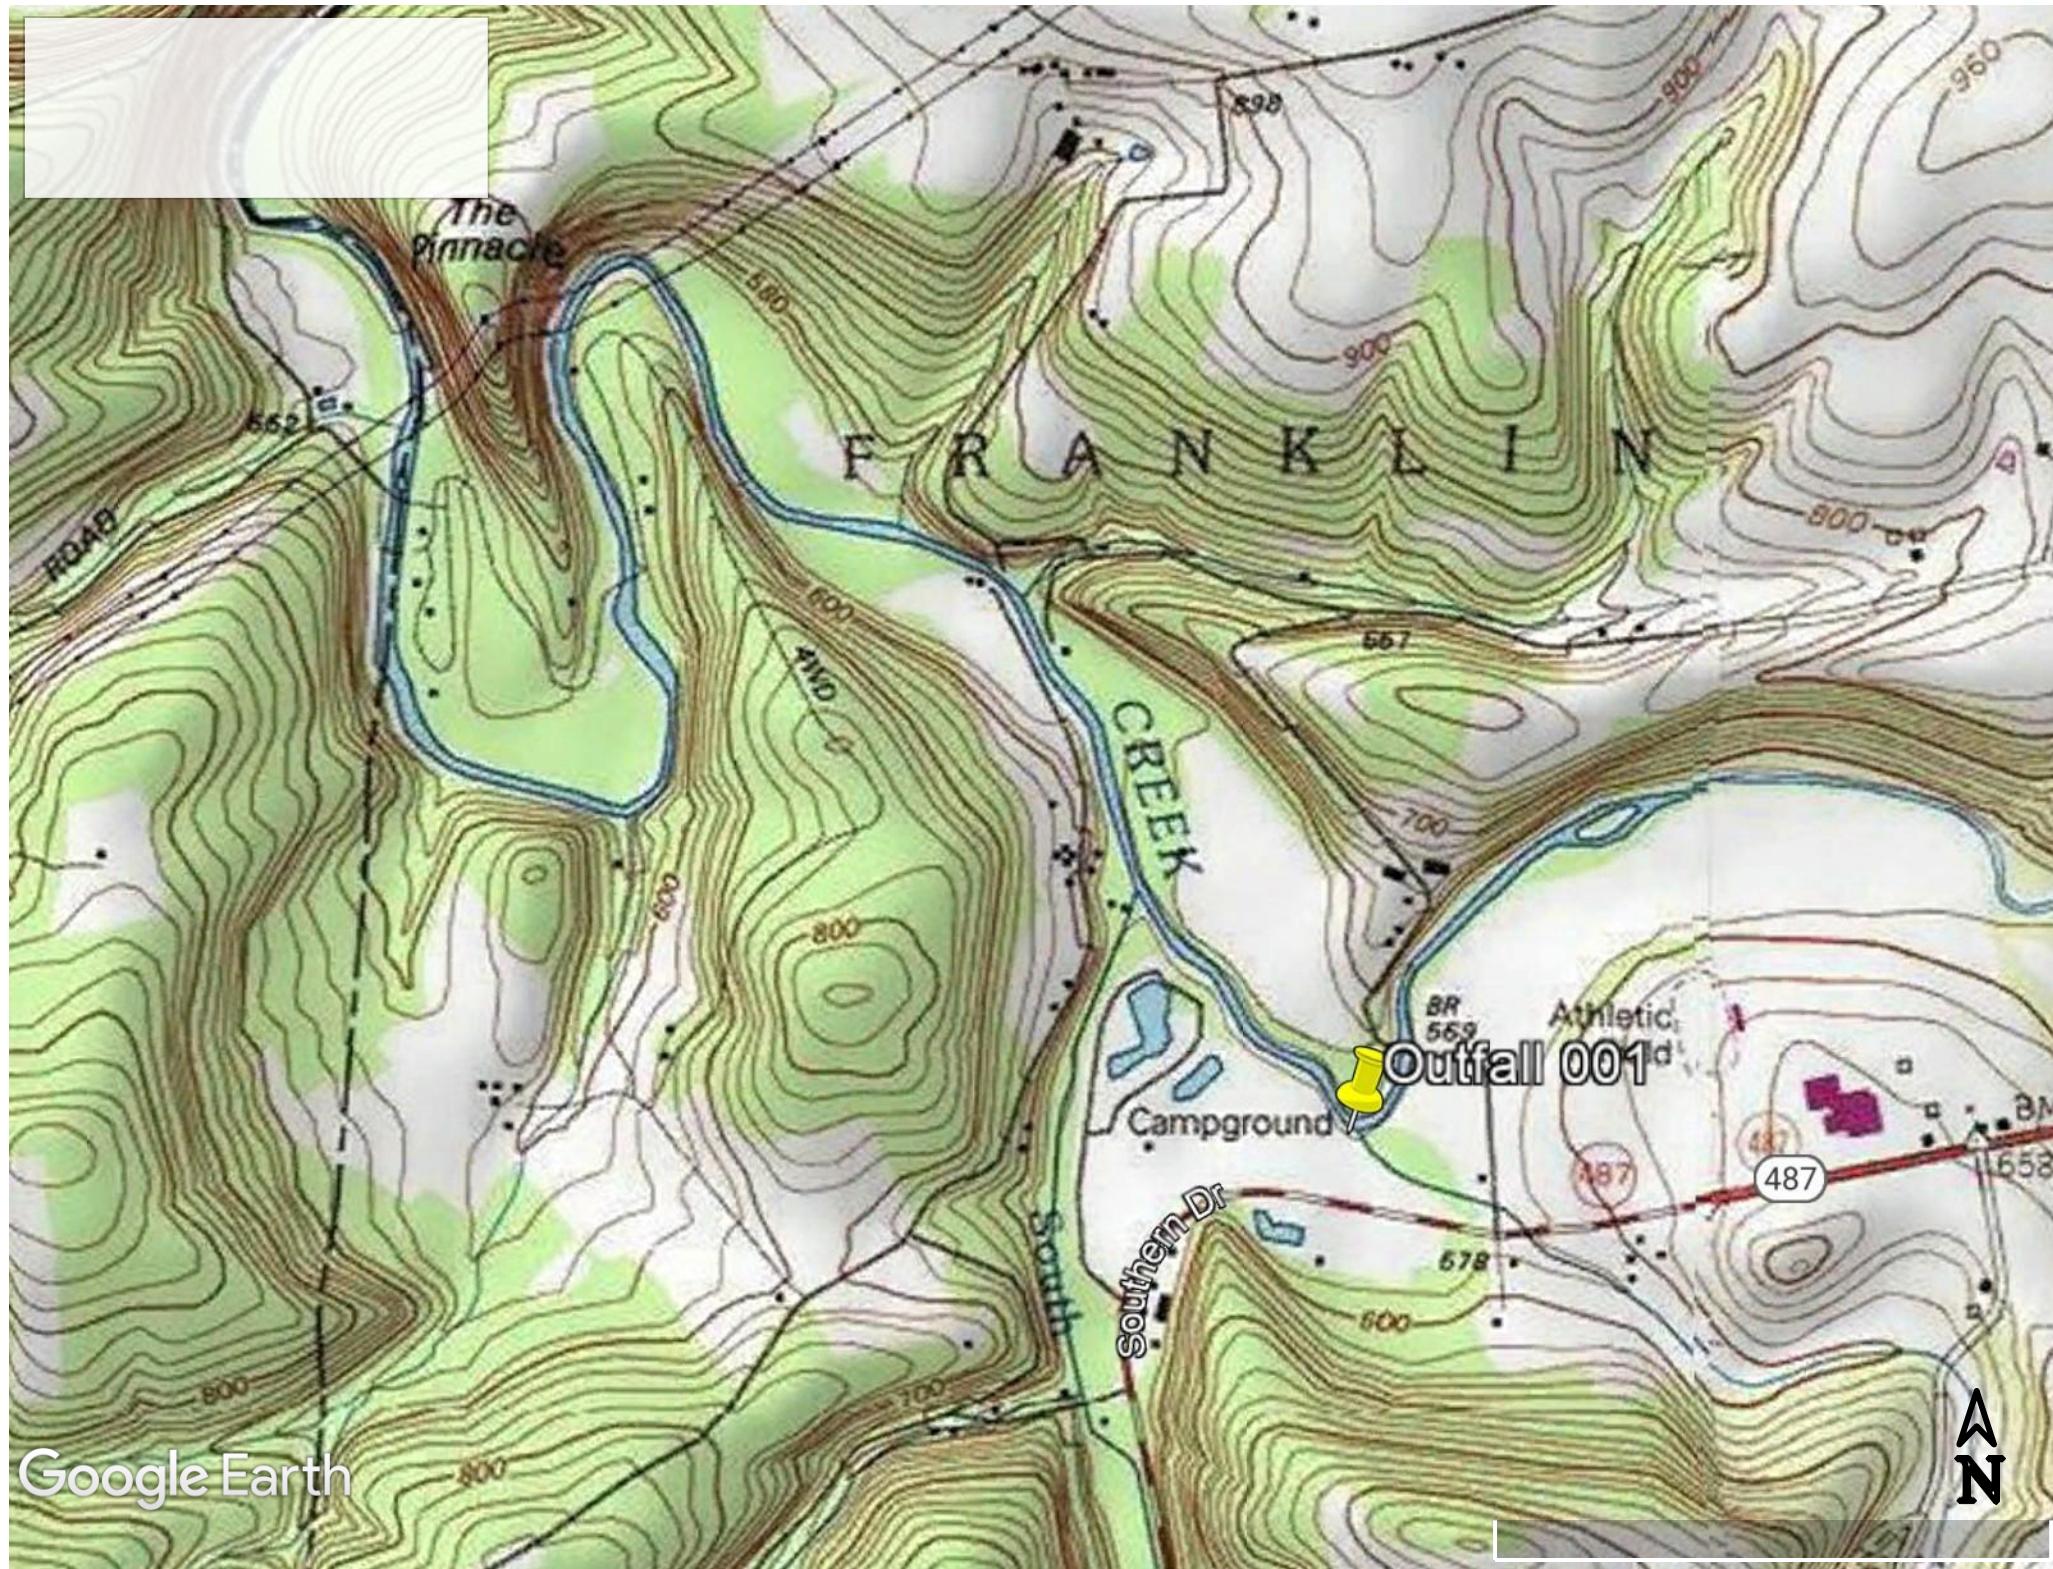

## Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
05E	27450	ROARING CREEK	4.600	540.00	47.00	0.00000	0.00	<input checked="" type="checkbox"/>

### Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD	Rch Width	Rch Depth	Tributary Temp	Stream pH	Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.091	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

### Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
J&D Campground	PA0228184	0.0200	0.0000	0.0000	0.000	25.00	7.00
<b>Parameter Data</b>							
Parameter Name		Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)		
CBOD5		25.00	2.00	0.00	1.50		
Dissolved Oxygen		3.00	8.24	0.00	0.00		
NH3-N		25.00	0.00	0.00	0.70		

## Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
05E	27450	ROARING CREEK	3.630	520.00	55.00	0.00000	0.00	<input checked="" type="checkbox"/>

### Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD	Rch Width	Rch Depth	Tributary Temp	Stream pH	Stream Temp	Stream pH
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	(°C)		(°C)	
Q7-10	0.091	0.00	0.00	0.000	0.000	0.0	0.00	0.00	20.00	7.00	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

### Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
		0.0000	0.0000	0.0000			
<b>Parameter Data</b>							
Parameter Name		Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)		
	CBOD5	25.00	2.00	0.00	1.50		
Dissolved Oxygen		3.00	8.24	0.00	0.00		
NH3-N		25.00	0.00	0.00	0.70		

## WQM 7.0 Hydrodynamic Outputs

<u>SWP Basin</u>			<u>Stream Code</u>			<u>Stream Name</u>						
05E			27450			ROARING CREEK						
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis Flow	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
	(cfs)	(cfs)	(cfs)	(cfs)	(ft/ft)	(ft)	(ft)		(fps)	(days)	(°C)	
<b>Q7-10 Flow</b>												
4.600	4.28	0.00	4.28	.0309	0.00391	.669	32.23	48.2	0.20	0.297	20.04	7.00
<b>Q1-10 Flow</b>												
4.600	2.74	0.00	2.74	.0309	0.00391	NA	NA	NA	0.16	0.380	20.06	7.00
<b>Q30-10 Flow</b>												
4.600	5.82	0.00	5.82	.0309	0.00391	NA	NA	NA	0.24	0.250	20.03	7.00

## **WQM 7.0 Modeling Specifications**

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input checked="" type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.64	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.36	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	6		

## WQM 7.0 D.O.Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
05E	27450	ROARING CREEK		
<u>RMI</u> 4.600	Total Discharge Flow (mgd) 0.020	Analysis Temperature (°C) 20.036	Analysis pH 7.000	
<u>Reach Width (ft)</u> 32.229	<u>Reach Depth (ft)</u> 0.669	<u>Reach WDRatio</u> 48.202	<u>Reach Velocity (fps)</u> 0.200	
<u>Reach CBOD5 (mg/L)</u> 2.17	<u>Reach Kc (1/days)</u> 0.102	<u>Reach NH3-N (mg/L)</u> 0.18	<u>Reach Kn (1/days)</u> 0.702	
<u>Reach DO (mg/L)</u> 8.205	<u>Reach Kr (1/days)</u> 7.424	<u>Kr Equation</u> Tsivoglou	<u>Reach DO Goal (mg/L)</u> 6	
<u>Reach Travel Time (days)</u> 0.297	<b>Subreach Results</b>			
	TravTime (days)	CBOD5 (mg/L)	NH3-N (mg/L)	D.O. (mg/L)
	0.030	2.16	0.18	8.24
	0.059	2.15	0.17	8.24
	0.089	2.15	0.17	8.24
	0.119	2.14	0.17	8.24
	0.148	2.13	0.16	8.24
	0.178	2.13	0.16	8.24
	0.208	2.12	0.16	8.24
	0.237	2.11	0.15	8.24
	0.267	2.11	0.15	8.24
	0.297	2.10	0.15	8.24

## WQM 7.0 Wasteload Allocations

SWP Basin	Stream Code	Stream Name
05E	27450	ROARING CREEK

### **NH3-N Acute Allocations**

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
	4.600 J&D Campground	16.68	50	16.68	50	0	0

### **NH3-N Chronic Allocations**

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
	4.600 J&D Campground	1.88	25	1.88	25	0	0

### **Dissolved Oxygen Allocations**

RMI	Discharge Name	CBOD5		NH3-N		Dissolved Oxygen		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
	4.60 J&D Campground	25	25	25	25	3	3	0	0

## **WQM 7.0 Effluent Limits**

<b><u>SWP Basin</u></b>	<b><u>Stream Code</u></b>	<b><u>Stream Name</u></b>					
<b>05E</b>	<b>27450</b>	<b>ROARING CREEK</b>					
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
4.600	J&D Campground	PA0228184	0.020	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			3

TRC\_CALC

TRC EVALUATION					
Input appropriate values in A3:A9 and D3:D9					
Source	Reference	AFC Calculations		Reference	CFC Calculations
TRC	1.3.2.iii		WLA_afc = 44.353	1.3.2.iii	WLA_cfc = 43.233
PENTOXSD TRG	5.1a		LTAMULT_afc = 0.373	5.1c	LTAMULT_cfc = 0.581
PENTOXSD TRG	5.1b		LTA_afc = 16.527	5.1d	LTA_cfc = 25.134
Source					
Effluent Limit Calculations					
PENTOXSD TRG	5.1f		AML MULT = 1.231		
PENTOXSD TRG	5.1g		AVG MON LIMIT (mg/l) = 0.500		BAT/BPJ
			INST MAX LIMIT (mg/l) = 1.635		
WLA_afc		$(.019/e(-k*AFC_tc)) + [(AFC_Yc*Qs*.019/Qd*e(-k*AFC_tc))...\\ ...+ Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$			
LTAMULT_afc		$\text{EXP}((0.5*\text{LN}(cvh^2+1))-2.326*\text{LN}(cvh^2+1)^0.5)$			
LTA_afc		wla_afc*LTAMULT_afc			
WLA_cfc		$(.011/e(-k*CFC_tc)) + [(CFC_Yc*Qs*.011/Qd*e(-k*CFC_tc))...\\ ...+ Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)$			
LTAMULT_cfc		$\text{EXP}((0.5*\text{LN}(cvd^2/no\_samples+1))-2.326*\text{LN}(cvd^2/no\_samples+1)^0.5)$			
LTA_cfc		wla_cfc*LTAMULT_cfc			
AML MULT		$\text{EXP}(2.326*\text{LN}((cvd^2/no\_samples+1)^0.5)-0.5*\text{LN}(cvd^2/no\_samples+1))$			
AVG MON LIMIT		$\text{MIN}(\text{BAT\_BPJ},\text{MIN}(\text{LTA_afc},\text{LTA_cfc})*\text{AML\_MULT})$			
INST MAX LIMIT		$1.5*((\text{av\_mon\_limit}/\text{AML\_MULT})/\text{LTAMULT_afc})$			