

Application Type Renewal
 Facility Type Industrial
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
 INDIVIDUAL INDUSTRIAL WASTE (IW)
 AND IW STORMWATER**

Application No. PA0247162
 APS ID 484471
 Authorization ID 1263796

Applicant and Facility Information

Applicant Name	<u>PA American Water Co.</u>	Facility Name	<u>PA American West Shore Region WTP</u>
Applicant Address	<u>852 Wesley Drive</u> <u>Mechanicsburg, PA 17055-4475</u>	Facility Address	<u>275 Steigerwalt Hollow Road</u> <u>New Cumberland, PA 17070-2761</u>
Applicant Contact	<u>Jon Prawdzik</u>	Facility Contact	<u>Jon Prawdzik</u>
Applicant Phone	<u>(717) 774-1404</u>	Facility Phone	<u>(717) 774-1404</u>
Client ID	<u>87712</u>	Site ID	<u>615285</u>
SIC Code	<u>4941</u>	Municipality	<u>Fairview Township</u>
SIC Description	<u>Trans. & Utilities - Water Supply</u>	County	<u>York</u>
Date Application Received	<u>January 31, 2019</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>March 7, 2019</u>	If No, Reason	<u></u>
Purpose of Application	<u>This is an application request for NPDES renewal.</u>		

Summary of Review

Approve	Deny	Signatures	Date
X		Nicholas Hong, P.E. / Environmental Engineer Nick Hong (via electronic signature)	December 31, 2020
		Daniel W. Martin, P.E. / Environmental Engineer Manager	
		Maria Bebenek, P.E. / Environmental Program Manager	

Summary of Review

The application submitted by the applicant requests a NPDES renewal permit for the Pennsylvania American Water (West Shore Regional WTP) facility located at 275 Steigerwalt Hollow Road, New Cumberland, PA 17070 in York County, municipality of Fairview Township. The existing permit became effective on August 1, 2014 and expired on July 31, 2019. The application for renewal was received by DEP Southcentral Regional Office (SCRO) on January 31, 2019.

The purpose of this Fact Sheet is to present the basis of information used for establishing the proposed NPDES permit effluent limitations. The Fact Sheet includes a description of the facility, a description of the facility's receiving waters, a description of the facility's receiving waters attainment/non-attainment assessment status, and a description of any changes to the proposed monitoring/sampling frequency. Section 6 provides the justification for the proposed NPDES effluent limits derived from technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), total maximum daily loading (TMDL), antidegradation, anti-backsliding, and/or whole effluent toxicity (WET). A brief summary of the outlined descriptions has been included in the Summary of Review section.

The subject facility is a 0.483 MGD treatment facility. The applicant anticipates proposed upgrades to the treatment facility in the next five years. These upgrades include conversion to liquid sodium hypochlorite (from gaseous chlorine) as primary disinfectant feed, addition of ultraviolet treatment for L2 rule, and additional of a new process flow meter to calculate daily discharge volumes. The NPDES application has been processed as an Industrial Wastewater facility due to the type of wastewater and the design flow rate for the facility. The applicant disclosed the Act 14 requirement to York County Planning Commission and Fairview Township Supervisors and the notice was received by the parties on January 24, 2019 and January 30, 2019. A planning approval letter was not necessary as the facility is neither new or expanding.

Utilizing the DEP's web-based Emap-PA information system, the receiving waters has been determined to be Tributary 63053 to Yellow Breeches Creek. The sequence of receiving streams that Tributary 63053 to Yellow Breeches Creek discharges into are the Yellow Breeches Creek and the Susquehanna River which eventually drains into the Chesapeake Bay. The subject site is not subject to the Chesapeake Bay implementation requirements. The receiving water has protected water usage for cold water fishes (CWF) and migratory fishes (MF). No Class A Wild Trout fisheries are impacted by this discharge. The absence of high quality and/or exceptional value surface waters removes the need for an additional evaluation of anti-degradation requirements.

The Tributary 63053 to Yellow Breeches Creek is a Category 2 stream listed in the 2020 Integrated List of All Waters (formerly 303d Listed Streams). This stream is an attaining stream that supports aquatic life. The receiving waters is not subject to a total maximum daily load (TMDL) plan to improve water quality in the subject facility's watershed.

The existing permit and proposed permit differ as follows:

- **Iron (dissolved) shall be monitored on at least 1x/quarter basis.**

The proposed permit will expire five (5) years from the effective date.

Based on the review in this report, it is recommended that the permit be drafted. DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Any additional information or public review of documents associated with the discharge or facility may be available at PA DEP Southcentral Regional Office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file review, contact the SCRO File Review Coordinator at 717.705.4700.

1.0 Applicant

1.1 General Information

This fact sheet summarizes PA Department of Environmental Protection's review for the NPDES renewal for the following subject facility.

Facility Name: Pa American Water (West Shore Regional WTP)

NPDES Permit # PA0247162

Physical Address: 275 Steigerwalt Hollow Road
New Cumberland, PA 17070

Mailing Address: 852 Wesley Drive
Mechanicsburg, PA 17055

Contact: Michael Barger
Production Supervisor
Michael.barger@amwater.com

Jon Prawdzik
Senior Manager, Central PA Operations
Jon.Prawdzik@amwater.com

Consultant: There was not a consultant utilized for this NPDES renewal.

1.2 Permit History

Description of Facility

The facility purifies water withdrawn from the Yellow Breeches Creek for potable public consumption. Water is then pumped through a distribution system to residential, commercial, and industrial customers located in Silver Spring, Hampden, East Pennsboro, Upper and Lower Allen, Fairview, Newberry Township, Camp Hill, Wormleysburg, West Fairview, Lemoyne, New Cumberland, and Shiremanstown Boroughs.

Permit submittal included the following information.

- NPDES Application
- Influent Sample Data
- Effluent Sample Data

2.0 Treatment Facility Summary

2.1.1 Site location

The physical address for the facility is 275 Steigerwalt Hollow Road, New Cumberland, PA 17070. A topographical and an aerial photograph of the facility are depicted as Figure 1 and Figure 2.

Figure 1: Topographical map of the subject facility


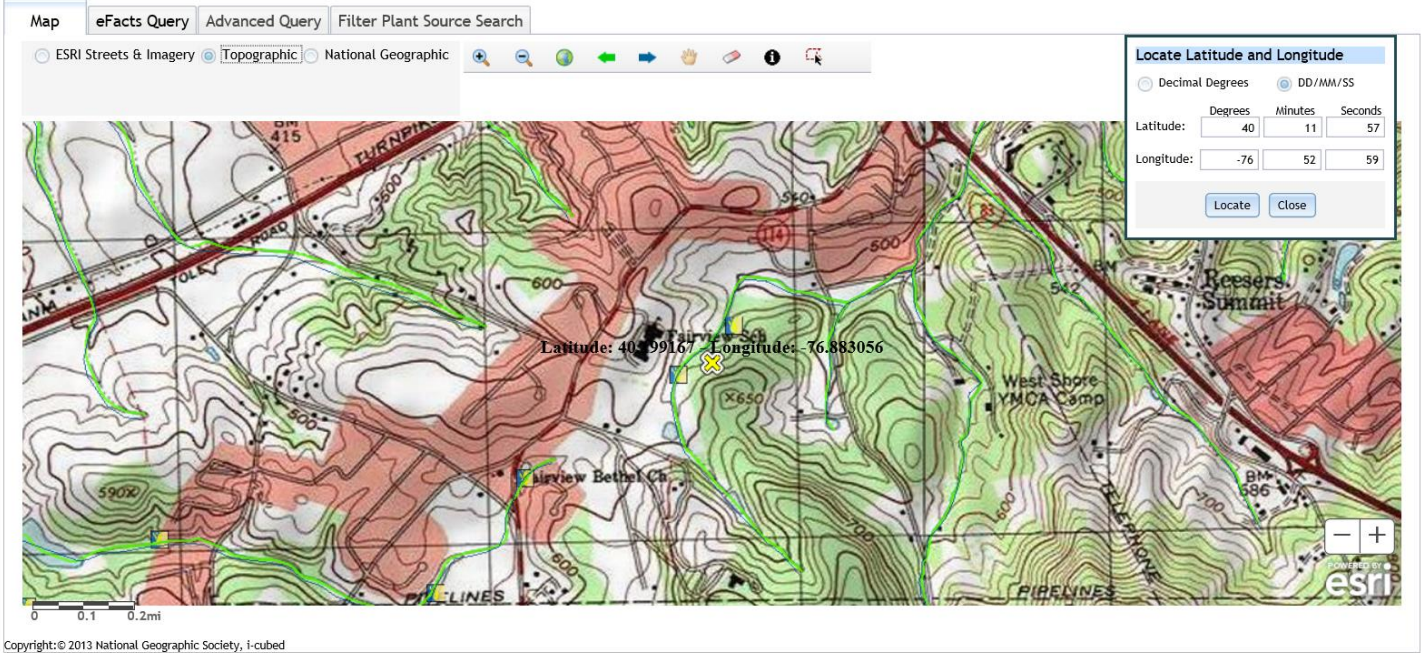


Figure 2: Aerial Photograph of the subject facility

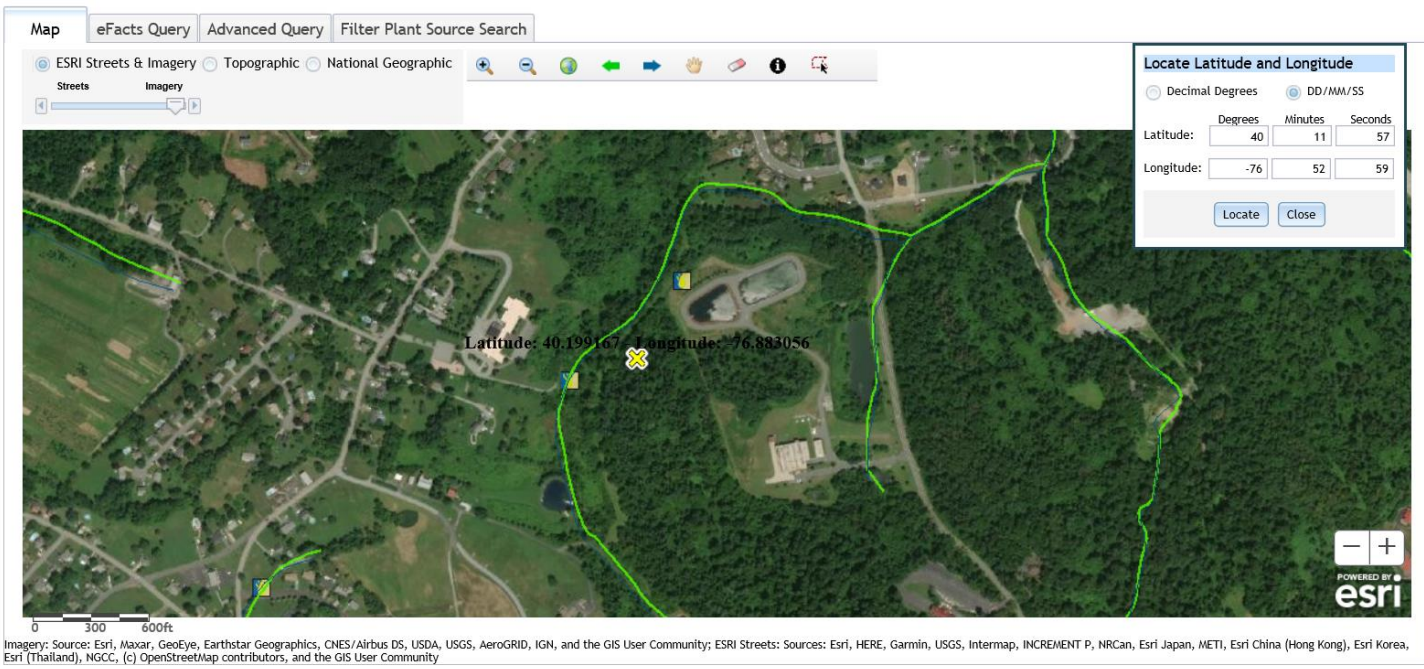

2.1.2 Sources of Wastewater/Stormwater

Outfall 001 receives all process wastewater from filter backwash and rinse cycles, sludge blowdowns from sedimentation clarifiers, process analyzers, and sample pump wastewater. Outfall 001 is actively used and open all year.

2.2 Description of Wastewater Treatment Process

The subject facility is a 0.483 MGD design flow facility. The subject facility treats wastewater using two lagoons. Sedimentation Lagoon 1 and 2 are operated independent of each other with valved inlet piping that allow for lagoon selection. The lagoons receive process wastewater from filter backwash and rinse cycles, sludge blowdowns from sedimentation clarifiers, process analyzer and sample wastewater.

The facility is being evaluated for flow, pH, TRC, TSS, aluminum, iron and manganese. The existing permits limits for the facility is summarized in Section 2.4.

The treatment process is summarized in the table.

Treatment Facility Summary				
Treatment Facility Name: PA American West Shore Region Water System				
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Industrial	Physical (Industrial Waste)	Sedimentation	No Disinfection	0.483
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal

2.3 Facility Outfall Information

The facility has the following outfall information for wastewater.

Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.483</u>
Latitude	<u>40° 12' 1.00"</u>	Longitude	<u>-76° 52' 56.00"</u>
Wastewater Description:	<u>Water Treatment Effluent</u>		

2.3.1 Operational Considerations- Chemical Additives

Chemical additives are chemical products introduced into a waste stream that is used for cleaning, disinfecting, or maintenance and which may be detected in effluent discharged to waters of the Commonwealth. Chemicals excluded are those used for neutralization of waste streams, the production of goods, and treatment of wastewater.

The subject facility utilizes the following chemicals as part of their treatment process.

- GreenClean Pro for Algaecide
- Cationic /Nonionic Polymer for Coagulant/Flocculant
- Ferric Chloride for Coagulant/Flocculant
- Powder Activated Carbon for Taste and Odor Control
- Sodium Permanganate for Oxidation or Organics and Taste/Odor Control
- Chlorine- Primary Disinfectant
- Sodium Hydroxide- pH adjustment

2.4 Existing NPDES Permits Limits

The existing NPDES permit limits are summarized in the table.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 12' 01", Longitude 76° 52' 56", River Mile Index 1.98, Stream Code 63053

Receiving Waters: Unnamed Tributary to Yellow Breeches Creek

Type of Effluent: Water treatment plant backwash

1. The permittee is authorized to discharge during the period from August 1, 2014 through July 31, 2019.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Daily Maximum	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report	XXX	XXX	XXX	XXX	1/week	Measured
pH (S.U.)	XXX	XXX	6.0	XXX	XXX	9.0	2/month	Grab
Total Residual Chlorine	XXX	XXX	XXX	0.19	XXX	0.62	1/day	Grab
Total Suspended Solids	XXX	XXX	XXX	30	60	75	2/month	8-Hr Composite
Total Aluminum	XXX	XXX	XXX	0.50	1.0	1.25	2/month	8-Hr Composite
Total Iron	XXX	XXX	XXX	1.5	3.0	3.75	2/month	8-Hr Composite
Total Manganese	XXX	XXX	XXX	1.0	2.0	2.5	2/month	8-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at discharge from facility.

3.0 Facility NPDES Compliance History

3.1 Summary of Inspections

A summary of the most recent inspections during the existing permit review cycle is as follows.

The DEP inspector noted the following during the inspection.

04/06/2015: DEP received a phone call from Justin Brame of PA American Water reporting a discharge from their distribution system to the surface waters. The cause was a contractor hitting a 6" pipe while excavating. The discharge lasted approximately one hour.

01/27/2016: DEP performed an inspection to follow up on a report of unauthorized discharge of backwash and rinse water into a wetlands area. The discharge of backwash and rinse water occurred from the Waste Transfer Basin (WTB) which flowed down an embankment into the wetlands pond area on the western side of the property.

Other incidents at the facility are: (1) The facility stated that a plow had recently hit a level transmitter for the WTB which normally alarms during high levels. The facility stated that there is a secondary alarm. (2) The facility stated that the pipe transferring backwash and rinse water from the WTB to the onsite lagoon(s) at the northern end of the property had been blocked by snow and ice. This caused a backup. Design measures have been put in place to prevent a recurrence.

04/17/2019: There was nothing significant to report.

3.2 Summary of DMR Data

A review of approximately 1-year of DMR data shows that the monthly average flow data for the facility below the design capacity of the treatment system. The maximum average flow data for the DMR reviewed was 0.417 MGD in August 2019. The design capacity of the treatment system is 0.483 MGD.

NPDES Permit Fact Sheet
PA American West Shore Region WTP

NPDES Permit No. PA0247162

DMR Data for Outfall 001 (from August 1, 2019 to July 31, 2020)

Parameter	JUL-20	JUN-20	MAY-20	APR-20	MAR-20	FEB-20	JAN-20	DEC-19	NOV-19	OCT-19	SEP-19	AUG-19
Flow (MGD) Average Monthly	0.372	0.386	0.397	0.372	0.394	0.369	0.378	0.374	0.370	0.366	0.403	0.417
Flow (MGD) Daily Maximum	0.514	0.567	0.665	0.378	0.518	0.373	0.516	0.479	0.513	0.514	0.634	0.768
pH (S.U.) Minimum	7.5	7.43	7.24	7.44	7.35	6.63	6.91	6.77	6.58	6.93	7.3	7.4
pH (S.U.) Instantaneous Maximum	8.0	7.86	7.87	7.83	7.85	8.06	7.86	7.83	7.68	7.94	7.96	8.0
TRC (mg/L) Average Monthly	0.04	0.04	0.04	0.04	0.03	0.03	0.03	0.04	0.04	0.03	0.04	0.05
TRC (mg/L) Instantaneous Maximum	0.08	0.07	0.08	0.08	0.09	0.09	0.09	0.08	0.14	0.06	0.19	0.08
TSS (mg/L) Average Monthly	< 4	< 4	< 4.0	< 4	< 4.0	< 5.0	< 4	< 4	< 4	< 4.0	< 4.0	< 5
TSS (mg/L) Daily Maximum	< 4	< 4	< 4.0	< 4	< 4.0	6.0	< 4	< 4	< 4	< 4.0	< 4.0	5.2
Total Aluminum (mg/L) Average Monthly	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.100
Total Aluminum (mg/L) Daily Maximum	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.10	< 0.100
Total Iron (mg/L) Average Monthly	0.4	0.4	0.50	0.6	0.30	0.2	0.20	0.5	0.20	0.30	0.1	0.30
Total Iron (mg/L) Daily Maximum	0.559	0.518	0.589	0.69	0.391	0.249	0.187	0.599	0.244	0.329	0.159	0.289
Total Manganese (mg/L) Average Monthly	0.1	0.10	0.10	0.1	0.10	0.1	0.02	0.1	0.10	0.05	0.04	0.04
Total Manganese (mg/L) Daily Maximum	0.123	0.096	0.078	0.091	0.076	0.116	0.028	0.21	0.099	0.047	0.047	0.045

3.3 Non-Compliance

3.3.1 Non-Compliance- NPDES Effluent

A summary of the non-compliance to the permit limits for the existing permit cycle is as follows.

From the DMR data beginning in August 1, 2014 and ending October 7, 2020, there were no observed effluent non-compliances.

3.3.2 Non-Compliance- Enforcement Actions

A summary of the non-compliance enforcement actions for the current permit cycle is as follows:

Beginning in August 1, 2014 and ending October 7, 2020, there were no observed enforcement actions.

**Summary of Enforcement Actions
Beginning August 1, 2014 and ending October 7, 2020**

ENF ID	ENF TYPE	ENF TYPE DESC	DATE	EXECUTED DATE	VIOLATIONS	ENF FINALSTATUS	DATE
340486	NOV	Notice of Violation	03/07/2016	02/16/2016	CSL301	Comply/Closed	03/11/2016

3.4 Summary of Biosolids Disposal

For 2019, the total amount of biosolids disposed was 1,105,000 gallons. Hoy Farms received 884,000 gallons. Davis Farm received 169,000 gallons. Plouse Farm received 52,000 gallons.

The farm addresses are summarized below.

Hoy Farm, 581 Cranes Gap Road, Carlisle, PA

Davis Farm, 1000 Pisgah State Road, Shermans Dale, PA

Plouse Farm, 7059 Union Deposit Road, Hummelstown, PA

Solids are stored in the lagoons, removed at the appropriate time, and beneficially disposed annually via land application at local farms.

3.5 Open Violations

As of December 2020, no open violations existed for the Pennsylvania American Water (West Shore Regional WTP) (PA0247162). However, the client, PA American Water, has open violations for other facilities.

4.0 Receiving Waters and Water Supply Information Detail Summary

4.1 Receiving Waters

The receiving waters has been determined to be Tributary 63053 to Yellow Breeches Creek. The sequence of receiving streams that Tributary 63053 to Yellow Breeches Creek discharges into are the Yellow Breeches Creek and the Susquehanna River which eventually drains into the Chesapeake Bay.

4.2 Public Water Supply (PWS) Intake

The closest PWS to the subject facility is Pennsylvania American Water (PWS ID #7210029) located approximately 2.1 miles downstream of the subject facility on the Yellow Breeches Creek. Based upon the distance and the flow rate of the facility, the PWS should not be impacted.

4.3 Class A Wild Trout Streams

Class A Wild Trout Streams are waters that support a population of naturally produced trout of sufficient size and abundance to support long-term and rewarding sport fishery. DEP classifies these waters as high-quality coldwater fisheries.

The information obtained from EMAP suggests that no Class A Wild Trout Fishery will be impacted by this discharge.

4.4 2020 Integrated List of All Waters (303d Listed Streams)

Section 303(d) of the Clean Water Act requires States to list all impaired surface waters not supporting uses even after appropriate and required water pollution control technologies have been applied. The 303(d) list includes the reason for impairment which may be one or more point sources (i.e. industrial or sewage discharges) or non-point sources (i.e. abandoned mine lands or agricultural runoff and the pollutant causing the impairment such as metals, pH, mercury or siltation).

States or the U.S. Environmental Protection Agency (EPA) must determine the conditions that would return the water to a condition that meets water quality standards. As a follow-up to listing, the state or EPA must develop a Total Maximum Daily Load (TMDL) for each waterbody on the list. A TMDL identifies allowable pollutant loads to a waterbody from both point and non-point sources that will prevent a violation of water quality standards. A TMDL also includes a margin of safety to ensure protection of the water.

The water quality status of Pennsylvania's waters uses a five-part categorization (lists) of waters per their attainment use status. The categories represent varying levels of attainment, ranging from Category 1, where all designated water uses are met to Category 5 where impairment by pollutants requires a TMDL for water quality protection.

The receiving waters is listed in the 2020 Pennsylvania Integrated Water Quality Monitoring and Assessment Report as a Category 2 waterbody. The surface waters is an attaining stream that supports aquatic life. The designated use has been classified as protected waters for cold water fishes (CWF) and migratory fishes (MF).

4.5 Low Flow Stream Conditions

Water quality modeling estimates are based upon conservative data inputs. The data are typically estimated using either a stream gauge or through USGS web based StreamStats program. The NPDES effluent limits are based upon the combined flows from both the stream and the facility discharge.

A conservative approach to estimate the impact of the facility discharge using values which minimize the total combined volume of the stream and the facility discharge. The volumetric flow rate for the stream is based upon the seven-day, 10-year low flow (Q710) which is the lowest estimated flow rate of the stream during a 7 consecutive day period that occurs once in 10 -year time period. The facility discharge is based upon a known design capacity of the subject facility.

The closest WQN station to the subject facility is the Yellow Breeches station (WQN212). This WQN station is located approximately 2.4 miles downstream of the subject facility.

The closest gauge station to the subject facility is the Susquehanna River station at Marietta, PA (USGS station number 1576000). This gauge station is located approximately 26 miles downstream of the subject facility.

For WQM modeling, pH and stream water temperature data from the water quality network station was used. pH was estimated to be 8.2 and the stream water temperature was estimated to be 20.51 C.

The hardness of the stream was estimated by collecting a sample upstream of the facility. The sampling result was 130 mg/l CaCO₃.

The low flow yield and the Q710 for the subject facility was estimated as shown below.

Gauge Station Data		
USGS Station Number	1576000	
Station Name	Susquehanna River at Marietta, PA	
Q710	2,420	ft ³ /sec
Drainage Area (DA)	25,990	mi ²
Calculations		
The low flow yield of the gauge station is:		
Low Flow Yield (LFY) = Q710 / DA		
LFY = (2,420 ft ³ /sec / 25,990 mi ²)		
LFY =	0.0931	ft ³ /sec/mi ²
The low flow at the subject site is based upon the DA of		
	0.13	mi ²
Q710 = (LFY@gauge station)(DA@Subject Site)		
Q710 = (0.0931 ft ³ /sec/mi ²)(0.13 mi ²)		
Q710 =	0.012	ft ³ /sec

4.6 Summary of Discharge, Receiving Waters and Water Supply Information

Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.483</u>
Latitude	<u>40° 12' 0.84"</u>	Longitude	<u>-76° 52' 57.78"</u>
Quad Name	<u></u>	Quad Code	<u></u>
Wastewater Description: <u>Water Treatment Effluent</u>			
Receiving Waters	<u>Unnamed Tributary to Yellow Breeches Creek (CWF)</u>	Stream Code	<u>63053</u>
NHD Com ID	<u>56405279</u>	RMI	<u>2</u>
Drainage Area	<u>0.13</u>	Yield (cfs/mi ²)	<u>0.0931</u>
Q ₇₋₁₀ Flow (cfs)	<u>0.012</u>	Q ₇₋₁₀ Basis	<u>StreamStats/Streamgauge</u>
Elevation (ft)	<u>562</u>	Slope (ft/ft)	<u></u>
Watershed No.	<u>7-E</u>	Chapter 93 Class.	<u>CWF, MF</u>
Existing Use	<u>Same as Chapter 93 class.</u>	Existing Use Qualifier	<u></u>
Exceptions to Use	<u></u>	Exceptions to Criteria	<u></u>
Assessment Status	<u>Attaining uses for aquatic life</u>		
Cause(s) of Impairment	<u>Not appl.</u>		
Source(s) of Impairment	<u>Not appl.</u>		
TMDL Status	<u>Not appl.</u>	Name	<u></u>
Background/Ambient Data		Data Source	
pH (SU)	<u>8.2</u>	<u>WQN212; median July to Sept</u>	
Temperature (°C)	<u>20.51</u>	<u>WQN212; median July to Sept</u>	
Hardness (mg/L)	<u>130</u>	<u>NPDES application data</u>	
Other:	<u></u>	<u></u>	
Nearest Downstream Public Water Supply Intake	<u>PA American Water Co West</u>		
PWS Waters	<u>Yellow Breeches Creek</u>	Flow at Intake (cfs)	<u></u>
PWS RMI	<u>0.43</u>	Distance from Outfall (mi)	<u></u>

5.0: Overview of Presiding Water Quality Standards

5.1 General

There are at least six (6) different policies which determines the effluent performance limits for the NPDES permit. The policies are technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), antidegradation, total maximum daily loading (TMDL), anti-backsliding, and whole effluent toxicity (WET) The effluent performance limitations enforced are the selected permit limits that is most protective to the designated use of the receiving waters. An overview of each of the policies that are applicable to the subject facility has been presented in Section 6.

5.2.1 Technology-Based Limitations

TBEL treatment requirements under section 301(b) of the Act represent the minimum level of control that must be imposed in a permit issued under section 402 of the Act (40 CFR 125.3).

Permit limits for water treatment plant wastes are subject to handling and disposal of water treatment plant (WTP) using Best Practicable Control Technology (BPCT) currently available. Wastewater from treatment of WTP sludges and filter backwash shall have the following permit limits.

Parameter	Monthly Average	Daily Max
	mg/l	mg/l
Suspended Solids	30	60
Iron (total)	2	4
Aluminum (total)	4	8
Manganese (total)	1	2
pH	6 - 9	-----
TRC	0.5	1

Notes:

Source: TECHNOLOGY-BASED CONTROL
 REQUIREMENTS FOR WATER TREATMENT PLANT
 WASTES

5.3 Water Quality-Based Limitations

WQBEL are based on the need to attain or maintain the water quality criteria and to assure protection of designated and existing uses (PA Code 25, Chapter 92a.2). The subject facility that is typically enforced is the more stringent limit of either the TBEL or the WQBEL.

Determination of WQBEL is calculated by spreadsheet analysis or by a computer modeling program developed by DEP. DEP permit engineers utilize the following computing programs for WQBEL permit limitations: (1) MS Excel worksheet for Total Residual Chlorine (TRC); (2) WQM 7.0 for Windows Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen Version 1.0 (WQM Model) and (3) PENTOXSD for Windows 2.0 (PENTOXSD) for Toxics pollutants.

5.3.1 Water Quality Modeling 7.0

The facility is not subject to WQM.

A TRC evaluation is available in Attachment C.

5.3.2 PENTOXSD Modeling

The PENTOXSD model is a computer model that is used to determine effluent limitations for toxics (and other substances) for single discharge wasteload allocations. This computer model uses a mass-balance water quality analysis that includes consideration for mixing, first-order decay, and other factors used to determine recommended water quality-based effluent limits. PENTOXSD does not assume that all discharges completely mix with the stream. The point of compliance with water quality criteria are established using criteria compliance times (CCTs). The available CCTs are either acute fish criterion (AFC), chronic fish criterion (CFC), or human health criteria (THH & CRL).

Acute Fish Criterion (AFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 15 minutes travel time downstream of the current discharge) or the complete mix time whichever comes first. AFC is evaluated at Q710 conditions.

Chronic Fish Criterion (CFC) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CFC is evaluated at Q710 conditions.

Threshold Human Health (THH) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the estimated travel time downstream to the nearest potable water supply intake whichever comes first. THH is evaluated at Q710 conditions.

Cancer Risk Level (CRL) measures the criteria compliance time as either the maximum criteria compliance time (i.e. 12 hours travel time downstream of the current discharge) or the complete mix time whichever comes first. CRL is evaluated at Qh (harmonic mean or normal flow) conditions.

The PENTOXSD Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

The input values utilized for the modeling are summarized in the table which can be found in Attachment B.

5.3.2.1 Determining if NPDES Permit Will Require Monitoring/Limits in the Proposed Permit for Toxic Pollutants

To determine if PENTOXSD modeling is necessary, DEP has developed a Toxics Management Spreadsheet to identify toxics of concern. Toxic pollutants whose maximum concentrations as reported in the permit application or on DMRs are greater than the most stringent applicable water quality criterion are pollutants of concern. A Reasonable Potential Analysis was utilized to determine (a) if the toxic parameters modeled would require monitoring or (b) if permit limitations would be required for the parameters. The toxics reviewed for reasonable potential were the pollutants in Groups 1 and 2.

For the laboratory sampling data submitted with the NPDES renewal application, (a) the toxic parameters for aluminum, cadmium, silver, and thallium were analyzed by the laboratory above DEP QL limits; and (b) results for dissolved iron and total iron were elevated.

DEP requested that these parameters be resampled.

The re-sampling results are summarized below.

Summary of Re-Sampling Results								
Date of Sampling / Parameter	11/8/2020		11/15/2020		12/13/2020		Max Concentration	
		mg/l		mg/l		mg/l		mg/l
Aluminum		0.005		0.002	<	0.001		0.005
Cadmium	<	0.00008	<	0.00008	<	0.00008	<	0.00008
Iron		0.403		0.169		0.38		0.403
Iron (dissolved)		0.016				0.048		0.048
Silver	<	0.00005	<	0.00005	<	0.00005	<	0.00005
Thallium	<	0.0004	<	0.0004	<	0.0004	<	0.0004

The Toxics Management Spreadsheet indicated the concentrations measured in the effluent sample were not within the normal range for safe water quality protection.

Based upon the SOP- Establishing Water Quality-Based Effluent Limitations (WQBELs) and Permit Conditions for Toxic Pollutants (Revised January 10, 2019), monitoring and/or limits will be established as follows.

- (a) When reasonable potential is demonstrated, establish limits where the maximum reported concentration equals or exceeds 50% of the WQBEL.
- (b) For non-conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 25% - 50% of the WQBEL.
- (c) For conservative pollutants, establish monitoring requirements where the maximum reported concentration is between 10% - 50% of the WQBEL.

Applicable monitoring or permit limits for toxics are summarized in Section 6.

The Toxics Management Spreadsheet output has been included in Attachment B.

5.3.3 Whole Effluent Toxicity (WET)

The facility is not subject to WET.

5.4 Total Maximum Daily Loading (TMDL)

5.4.1 TMDL

The goal of the Clean Water Act (CWA), which governs water pollution, is to ensure that all of the Nation's waters are clean and healthy enough to support aquatic life and recreation. To achieve this goal, the CWA created programs designed to regulate and reduce the amount of pollution entering United States waters. Section 303(d) of the CWA requires states to assess their waterbodies to identify those not meeting water quality standards. If a waterbody is not meeting standards, it is listed as impaired and reported to the U.S. Environmental Protection Agency. The state then develops a plan to clean up the impaired waterbody. This plan includes the development of a Total Maximum Daily Load

(TMDL) for the pollutant(s) that were found to be the cause of the water quality violations. A Total Maximum Daily Load (TMDL) calculates the maximum amount of a specific pollutant that a waterbody can receive and still meet water quality standards.

Pennsylvania has committed to restoring all impaired waters by developing TMDLs and TMDL alternatives for all impaired waterbodies. The TMDL serves as the starting point or planning tool for restoring water quality.

5.4.1.1 Local TMDL

The subject facility does not discharge into a local TMDL.

5.4.1.2 Chesapeake Bay TMDL Requirement

The Chesapeake Bay Watershed is a large ecosystem that encompasses approximately 64,000 square miles in Maryland, Delaware, Virginia, West Virginia, Pennsylvania, New York and the District of Columbia. An ecosystem is composed of interrelated parts that interact with each other to form a whole. All of the plants and animals in an ecosystem depend on each other in some way. Every living thing needs a healthy ecosystem to survive. Human activities affect the Chesapeake Bay ecosystem by adding pollution, using resources and changing the character of the land.

Most of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the federal Water Pollution Control Act ("Clean Water Act"), 33 U.S.C. § 1313(d). While the Chesapeake Bay is outside the boundaries of Pennsylvania, more than half of the State lies within the watershed. Two major rivers in Pennsylvania are part of the Chesapeake Bay Watershed. They are (a) the Susquehanna River and (b) the Potomac River. These two rivers total 40 percent of the entire Chesapeake Bay watershed.

The overall management approach needed for reducing nitrogen, phosphorus and sediment are provided in the Bay TMDL document and the Phase I, II, and III WIPs which is described in the Bay TMDL document and Executive Order 13508.

The Bay TMDL is a comprehensive pollution reduction effort in the Chesapeake Bay watershed identifying the necessary pollution reductions of nitrogen, phosphorus and sediment across the seven Bay watershed jurisdictions of Delaware, Maryland, New York, Pennsylvania, Virginia, West Virginia and the District of Columbia to meet applicable water quality standards in the Bay and its tidal waters.

The Watershed Implementation Plans (WIPs) provides objectives for how the jurisdictions in partnership with federal and local governments will achieve the Bay TMDL's nutrient and sediment allocations.

Phase 3 WIP provides an update on Chesapeake Bay TMDL implementation activities for point sources and DEP's current implementation strategy for wastewater. The latest revision of the supplement was December 17, 2019.

The Chesapeake Bay TMDL (Appendix Q) categorizes point sources into four sectors:

- Sector A- significant sewage dischargers;
- Sector B- significant industrial waste (IW) dischargers;
- Sector C- non-significant dischargers (both sewage and IW facilities); and
- Sector D- combined sewer overflows (CSOs).

All sectors contain a listing of individual facilities with NPDES permits that were believed to be discharging at the time the TMDL was published (2010). All sectors with the exception of the non-significant dischargers have individual wasteload allocations (WLAs) for TN and TP assigned to specific facilities. Non-significant dischargers have a bulk or aggregate allocation for TN and TP based on the facilities in that sector that were believed to be discharging at that time and their estimated nutrient loads.

Based upon the supplement the subject facility has been categorized as a Sector C discharger. The supplement defines Sector C as a non-significant discharger that includes sewage facilities (Phase 4 facilities: ≥ 0.2 MGD and < 0.4 MGD and Phase 5 facilities: > 0.002 MGD and < 0.2 MGD), small flow/single residence sewage treatment facilities (≤ 0.002 MGD), and non-significant IW facilities, all of which may be covered by statewide General Permits or may have individual NPDES permits.

At this time, there are approximately 850 Phase 4 and 5 sewage facilities, approximately 715 small flow sewage treatment facilities covered by a statewide General Permit, and approximately 300 non-significant IW facilities.

For non-significant IW facilities, monitoring and reporting of TN and TP will be required throughout the permit term in renewed or amended permits anytime the facility has the potential to introduce a net TN or TP increase to the load contained within the intake water used in processing.

Non-significant IW facilities that propose expansion or production increases and as a result will discharge at least 75 lbs/day TN or 25 lbs/day TP (on an annual average basis), will be classified as Significant IW dischargers and receive Cap Loads in their permits based on existing performance (existing TN/TP concentrations at current average annual flow).

In general, for new non-significant IW discharges (including existing facilities discharging without a permit), DEP will issue permits containing Cap Loads of "0" and these facilities will be expected to purchase credits and/or apply offsets to achieve compliance.

Since the facility is not suspected of generating nitrogen or phosphorus, this facility is not subject to Sector C monitoring requirements.

5.5 Anti-Degradation Requirement

Chapter 93.4a of the PA regulations requires that surface water of the Commonwealth of Pennsylvania may not be degraded below levels that protect the existing uses. The regulations specifically state that *Existing instream water uses and the level of water quality necessary to protect the existing uses shall be maintained and protected*. Antidegradation requirements are implemented through DEP's guidance manual entitled Water Quality Antidegradation Implementation Guidance (Document #391-0300-02).

The policy requires DEP to protect the existing uses of all surface waters and the existing quality of High Quality (HQ) and Exceptional Value (EV) Waters. Existing uses are protected when DEP makes a final decision on any permit or approval for an activity that may affect a protected use. Existing uses are protected based upon DEP's evaluation of the best available information (which satisfies DEP protocols and Quality Assurance/Quality Control (QA/QC) procedures) that indicates the protected use of the waterbody.

For a new, additional, or increased point source discharge to an HQ or EV water, the person proposing the discharge is required to utilize a nondischarge alternative that is cost-effective and environmentally sound when compared with the cost of the proposed discharge. If a nondischarge alternative is not cost-effective and environmentally sound, the person must use the best available combination of treatment, pollution prevention, and wastewater reuse technologies and assure that any discharge is nondegrading. In the case of HQ waters, DEP may find that after satisfaction of intergovernmental coordination and public participation requirements lower water quality is necessary to accommodate important economic or social development in the area in which the waters are located. In addition, DEP will assure that cost-effective and reasonable best management practices for nonpoint source control in HQ and EV waters are achieved.

The subject facility's discharge will be to a non-special protection waters and the permit conditions are imposed to protect existing instream water quality and uses. Neither HQ waters or EV waters is impacted by this discharge.

5.6 Anti-Backsliding

Anti-backsliding is a federal regulation which prohibits a permit from being renewed, reissued, or modified containing effluent limitations which are less stringent than the comparable effluent limitations in the previous permit (40 CFR 122.1.1 and 40 CFR 122.1.2). A review of the existing permit limitations with the proposed permit limitations confirm that the facility is consistent with anti-backsliding requirements. The facility has proposed effluent limitations that are as stringent as the existing permit.

6.0 NPDES Parameter Details

The basis for the proposed sampling and their monitoring frequency that will appear in the permit for each individual parameter are itemized in this Section. The final limits are the more stringent of technology based effluent treatment (TBEL) requirements, water quality based (WQBEL) limits, TMDL, antidegradation, anti-degradation, or WET.

The reader will find in this section:

- a) a justification of recommended permit monitoring requirements and limitations for each parameter in the proposed NPDES permit;
- b) a summary of changes from the existing NPDES permit to the proposed permit; and
- c) a summary of the proposed NPDES effluent limits.

6.1 Recommended Monitoring Requirements and Effluent Limitations

A summary of the recommended monitoring requirements and effluent limitations are itemized in the tables. The tables are categorized by (a) Conventional Pollutants and Disinfection and (b) Toxics.

6.1.1 Conventional Pollutants and Disinfection

Summary of Proposed NPDES Parameter Details for Conventional Pollutants and Disinfection			
PA American Water Company, PA0247162			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
pH (S.U.)	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 2x/month as a grab sample (Table 6-4).
		Effluent Limit:	Effluent limits may range from pH = 6.0 to 9.0
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-4 and the effluent limits assigned by DEP Guidance Document-Water Treatment Plant Wastes..
TSS	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-4).
		Effluent Limit:	The average monthly limit should not exceed 30 mg/l.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by DEP Guidance Document-Water Treatment Plant Wastes
TRC	WQBEL	Monitoring:	The monitoring frequency shall be on a daily basis as a grab sample (Table 6-4).
		Effluent Limit:	The average monthly limit should not exceed 0.19 mg/l and/or 0.62 mg/l as an instantaneous maximum.
		<p>Rationale: Chlorine in both combined (chloramine) and free form is extremely toxic to freshwater fish and other forms of aquatic life (Implementation Guidance Total Residual Chlorine 1). The TRC effluent limitations to be imposed on a discharger shall be the more stringent of either the WQBEL or TBEL requirements and shall be expressed in the NPDES permit as an average monthly and instantaneous maximum effluent concentration (Implementation Guidance Total Residual Chlorine 4).</p> <p>Based on the Fact Sheet prepared on March 7, 2014 TRC limits were developed as follows: The permittee submitted the results of a chlorine demand study on August 17, 2010. The study was conducted for one year (August 2009 through July 2010) in order to determine the discharge TRC demand in the effluent leaving the facility's settling lagoons. 37 samples were taken for the study which resulted in a discharge chlorine demand of 0.39 mg/L. The discharge demand value of 0.39 mg/L will also be used in the modeling for this renewal phase.</p> <p>Based on the attached TRC Excel Spreadsheet calculator, which uses the equations and calculations from the Department's May 1, 2003 Implementation Guidance for Total Residual Chlorine (ID No. 391-2000-015), the facility's discharge must meet a monthly average limit of 0.19 mg/L and an instantaneous maximum limit of 0.62 mg/L. This is in agreement with the limits in the existing permit.</p>	
Notes:			
1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.483 MGD.			
3 Table 6-4 (Self Monitoring Requirements for Industrial Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Phase 2 Watershed Implementation Plan Wastewater Supplement, Revised September 6, 2017			

6.1.2 Summary of Toxics Monitoring

Summary of Proposed NPDES Parameter Details for Toxics			
PA American Water Company, PA0247162			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
Aluminum	Antibacksliding	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	The performance effluent limit shall not exceed 0.5 mg/l as a monthly average.
		Rationale:	Consistent with DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash, this parameter shall be monitored. Aluminum shall continue to have an effluent not exceeding 0.5 mg/l as a monthly average. Antibacksliding requires that this parameter shall continue in the proposed permit at a concentration not less than the current permit.
Iron	Antibacksliding	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	The performance effluent limit shall not exceed 1.5 mg/l as a monthly average.
		Rationale:	Consistent with DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash, this parameter shall be monitored. Aluminum shall continue to have an effluent not exceeding 1.5 mg/l as a monthly average. Antibacksliding requires that this parameter shall continue in the proposed permit at a concentration not less than the current permit.
Manganese	DEP Guidance Document-Water Treatment Plant Wastes	Monitoring:	The monitoring frequency shall be 2x/month as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	The performance effluent limit shall not exceed 1.0 mg/l as a monthly average.
		Rationale:	Effluent limits are defined by DEP Guidance Document- Technology-Based Control Requirements for Water Treatment Plant Wastes- Waste Water from Treatment of WTP Sludges and Filter Backwash
Iron (Dissolved)	WQBEL	Monitoring:	The monitoring frequency shall be 1x/quarter as an 8-hr composite sample (Table 6-3).
		Effluent Limit:	No effluent requirements.
		Rationale:	While the Toxics Management Spreadsheet recommends performance limits, additional sampling to confirm the levels of this pollutant in the effluent is necessary. The iron (dissolved) parameter shall be monitored on a 1x/quarter basis. Pending favorable sampling results from the proposed permit, the frequency of this parameter for monitoring may be reduced or eliminated in future renewals.
Notes:			
1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.483 MGD.			
3 Table 6-4 (Self Monitoring Requirements for Industrial Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits) (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Phase 2 Watershed Implementation Plan Wastewater Supplement, Revised September 6, 2017			

6.2 Summary of Changes From Existing Permit to Proposed Permit

A summary of how the proposed NPDES permit differs from the existing NPDES permit is summarized as follows.

Changes in Permit Monitoring or Effluent Quality		
Parameter	Existing Permit	Draft Permit
Iron (Dissolved)	No effluent limit	While the Toxics Management Spreadsheet recommends performance limits, additional sampling to confirm the levels of this pollutant in the effluent is necessary. The iron (dissolved) parameter shall be monitored on a 1x/quarter basis. Pending favorable sampling results from the proposed permit, the frequency of this parameter for monitoring may be reduced or eliminated in future renewals.

6.3.1 Summary of Proposed NPDES Effluent Limits

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the “NPDES Permit Writer’s Manual” (362-0400-001), SOPs and/or BPJ.

The proposed NPDES effluent limitations are summarized in the table below.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 12' 1.00", Longitude 78° 52' 56.00", River Mile Index 2, Stream Code 63053

Receiving Waters: Unnamed Tributary to Yellow Breeches Creek (CWF)

Type of Effluent: Water Treatment Effluent

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Daily Maximum	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	1/week	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	2/month	Grab
Total Residual Chlorine (TRC)	XXX	XXX	XXX	0.19	XXX	0.62	1/day	Grab
Total Suspended Solids	XXX	XXX	XXX	30	60	75	2/month	Composite
Aluminum, Total	XXX	XXX	XXX	0.50	1.0	1.25	2/month	8-Hr Composite
Iron, Dissolved	XXX	XXX	XXX	Report Avg Qtrly	XXX	XXX	1/quarter	8-Hr Composite
Iron, Total	XXX	XXX	XXX	1.5	3.0	3.75	2/month	8-Hr Composite
Manganese, Total	XXX	XXX	XXX	1.0	2.0	2.5	2/month	8-Hr Composite

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

6.3.2 Summary of Proposed Permit Part C Conditions

The subject facility has the following Part C conditions.

- Chlorine Minimization
- Water Treatment Plant Basin Cleaning

Tools and References Used to Develop Permit	
<input type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input checked="" type="checkbox"/>	PENTOXSD for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Toxics Screening Analysis Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 362-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 362-2000-003, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 362-2000-008, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 362-2183-003, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 362-2183-004, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 385-2000-011, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 391-2000-002, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 391-2000-003, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 391-2000-006, 9/97.
<input type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 391-2000-007, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 391-2000-008, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 391-2000-010, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 391-2000-011, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 391-2000-013, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 391-2000-014, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 391-2000-015, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 391-2000-017, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 391-2000-018, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 391-2000-019, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 391-2000-021, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 391-2000-022, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 391-2000-023, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 391-2000-024, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 391-3200-013, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: New and Reissuance Industrial Waste and Industrial Stormwater, Revised October 11, 2013
<input type="checkbox"/>	Other: [redacted]

Attachment A

Stream Stats/Gauge Data

14 Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania

Table 1. List of U.S. Geological Survey streamgage locations in and near Pennsylvania with updated streamflow statistics.—Continued

[Latitude and Longitude in decimal degrees; mi², square miles]

Streamgage number	Streamgage name	Latitude	Longitude	Drainage area (mi ²)	Regulated ¹
01561000	Brush Creek at Gapsville, Pa.	39.956	-78.254	36.8	N
01562000	Raystown Branch Juniata River at Saxton, Pa.	40.216	-78.265	756	N
01562500	Great Trough Creek near Marklesburg, Pa.	40.350	-78.130	84.6	N
01563200	Raystown Branch Juniata River below Rays Dam nr Huntingdon, Pa.	40.429	-77.991	960	Y
01563500	Juniata River at Mapleton Depot, Pa.	40.392	-77.935	2,030	Y
01564500	Aughwick Creek near Three Springs, Pa.	40.213	-77.925	205	N
01565000	Kishacoquillas Creek at Reedsville, Pa.	40.655	-77.583	164	N
01565700	Little Lost Creek at Oakland Mills, Pa.	40.605	-77.311	6.52	N
01566000	Tuscarora Creek near Port Royal, Pa.	40.515	-77.419	214	N
01566500	Cocolamus Creek near Millerstown, Pa.	40.566	-77.118	57.2	N
01567000	Juniata River at Newport, Pa.	40.478	-77.129	3,354	Y
01567500	Bixler Run near Loysville, Pa.	40.371	-77.402	15.0	N
01568000	Sherman Creek at Shermans Dale, Pa.	40.323	-77.169	207	N
01568500	Clark Creek near Carsonville, Pa.	40.460	-76.751	22.5	LF
01569000	Stony Creek nr Dauphin, Pa.	40.380	-76.907	33.2	N
01569800	Letort Spring Run near Carlisle, Pa.	40.235	-77.139	21.6	N
01570000	Conodoguinet Creek near Hogestown, Pa.	40.252	-77.021	470	LF
01570500	Susquehanna River at Harrisburg, Pa.	40.255	-76.886	24,100	Y
01571000	Paxton Creek near Penbrook, Pa.	40.308	-76.850	11.2	N
01571500	Yellow Breeches Creek near Camp Hill, Pa.	40.225	-76.898	213	N
01572000	Lower Little Swatara Creek at Pine Grove, Pa.	40.538	-76.377	34.3	N
01572025	Swatara Creek near Pine Grove, Pa.	40.533	-76.402	116	N
01572190	Swatara Creek near Inwood, Pa.	40.479	-76.531	167	N
01573000	Swatara Creek at Harper Tavern, Pa.	40.403	-76.577	337	N
01573086	Beck Creek near Cleona, Pa.	40.323	-76.483	7.87	N
01573160	Quittapahilla Creek near Bellegrove, Pa.	40.343	-76.562	74.2	N
01573500	Manada Creek at Manada Gap, Pa.	40.397	-76.709	13.5	N
01573560	Swatara Creek near Hershey, Pa.	40.298	-76.668	483	N
01574000	West Conewago Creek near Manchester, Pa.	40.082	-76.720	510	N
01574500	Codorus Creek at Spring Grove, Pa.	39.879	-76.853	75.5	Y
01575000	South Branch Codorus Creek near York, Pa.	39.921	-76.749	117	Y
01575500	Codorus Creek near York, Pa.	39.946	-76.755	222	Y
01576000	Susquehanna River at Marietta, Pa.	40.055	-76.531	25,990	Y
01576085	Little Conestoga Creek near Churchtown, Pa.	40.145	-75.989	5.82	N
01576500	Conestoga River at Lancaster, Pa.	40.050	-76.277	324	N
01576754	Conestoga River at Conestoga, Pa.	39.946	-76.368	470	N
01578310	Susquehanna River at Conowingo, Md.	39.658	-76.174	27,100	Y
01578400	Bowery Run near Quarryville, Pa.	39.895	-76.114	5.98	N
01580000	Deer Creek at Rocks, Md.	39.630	-76.403	94.4	N
01581500	Bynum Run at Bel Air, Md.	39.541	-76.330	8.52	N
01581700	Winters Run near Benson, Md.	39.520	-76.373	34.8	N
01582000	Little Falls at Blue Mount, Md.	39.604	-76.620	52.9	N
01582500	Gumpowder Falls at Glencoe, Md.	39.550	-76.636	160	Y
01583000	Slade Run near Glyndon, Md.	39.495	-76.795	2.09	N
01583100	Piney Run at Dover, Md.	39.521	-76.767	12.3	N

Table 2. Selected low-flow statistics for streamgage locations in and near Pennsylvania.—Continued

[ft³/s; cubic feet per second; —, statistic not computed; <, less than]

Streamgage number	Period of record used in analysis ¹	Number of years used in analysis	1-day, 10-year (ft ³ /s)	7-day, 10-year (ft ³ /s)	7-day, 2-year (ft ³ /s)	30-day, 10-year (ft ³ /s)	30-day, 2-year (ft ³ /s)	90-day, 10-year (ft ³ /s)
01565000	1941–2008	37	17.6	18.6	28.6	20.3	32.4	24.4
01565700	1965–1981	17	.4	.4	.9	.5	1.1	.8
01566000	1913–2008	52	4.3	7.9	18.8	12.4	25.6	19.2
01566500	1932–1958	27	1.7	2.4	4.0	3.2	5.7	4.9
01567000	² 1974–2008	35	504	534	725	589	857	727
01567000	³ 1901–1972	72	311	367	571	439	704	547
01567500	1955–2008	54	2.0	2.2	3.3	2.6	3.8	3.1
01568000	1931–2008	78	12.7	15.5	25.5	19.2	32.0	26.0
01568500	² 1943–1997	55	1.8	2.3	4.3	2.7	5.0	3.1
01569000	1939–1974	14	2.6	4.0	7.4	5.1	9.4	7.8
01569800	1978–2008	31	15.9	17.0	24.4	18.4	26.1	20.3
01570000	³ 1913–1969	35	—	63.1	110	76.1	124	95.3
01570000	² 1971–2008	38	63.1	69.3	109	78.3	125	97.8
01570500	³ 1901–1972	72	2,310	2,440	4,000	2,830	4,950	3,850
01570500	² 1974–2008	35	3,020	3,200	5,180	3,690	6,490	4,960
01571000	1941–1995	16	.1	.2	.6	.3	1.2	.8
01571500	1911–2008	62	81.6	86.8	115	94.0	124	105
01572000	1921–1984	14	2.1	2.3	4.8	3.0	6.5	4.5
01572025	1990–2008	17	15.2	16.4	26.7	18.5	34.6	27.7
01572190	1990–2008	17	19.1	20.5	36.2	23.9	45.8	35.3
01573000	1920–2008	89	18.0	22.0	52.0	30.8	69.2	50.9
01573086	1965–1981	17	.5	.6	2.6	.8	3.3	1.1
01573160	1977–1994	18	26.9	29.6	46.4	33.6	51.9	39.5
01573500	1939–1958	20	1.3	1.4	2.5	1.8	3.2	2.6
01573560	1977–2008	30	50.3	62.0	104	76.9	131	108
01574000	1930–2008	79	8.0	11.1	32.0	17.7	47.0	33.9
01574500	² 1968–2008	41	14.2	24.0	35.9	29.4	42.0	33.3
01574500	³ 1930–1966	34	2.3	7.1	11.5	9.3	14.8	12.7
01575000	² 1973–1995	23	.7	1.4	6.7	3.2	12.0	9.3
01575000	³ 1929–1971	43	.1	.6	10.3	2.3	15.0	6.1
01575500	² 1948–1996	49	12.1	18.7	41.3	23.9	50.0	33.8
01576000	³ 1933–1972	40	2,100	2,420	4,160	2,960	5,130	4,100
01576000	² 1974–2008	35	2,990	3,270	5,680	3,980	7,180	5,540
01576085	1984–1995	12	.4	.5	.8	.7	1.2	1.2
01576500	1931–2008	78	27.2	38.6	79.4	49.1	97.3	66.1
01576754	1986–2008	23	74.2	84.9	151	106	189	147
⁴ 01578310	1969–2008	40	549	2,820	5,650	4,190	7,380	6,140
01578400	1964–1981	18	1.4	1.5	2.7	1.9	3.2	2.5
⁴ 01580000	1928–2008	81	19.7	22.8	48.1	28.1	51.8	35.4
⁴ 01581500	1946–2008	28	.2	.3	1.2	.8	1.7	1.5
⁴ 01581700	1969–2008	40	4.7	5.5	17.5	8.1	18.3	12.0
⁴ 01582000	1946–2008	63	11.3	12.5	25.0	15.5	28.0	20.3
⁴ 01582500	1979–2008	27	41.2	43.9	78.8	53.8	90.6	74.1
⁴ 01583000	1949–1981	33	.3	.3	.7	.3	1.0	.6
⁴ 01583100	1984–2008	15	2.1	2.4	5.5	3.2	6.0	4.2

Attachment B

Modeling Input Values

Toxics Management Spreadsheet Output

Master Input Sheet				
PA American Water Company				
PA0247162				
October 2020				
General Data 1 (Modeling Point #1)	Type	Default	Input Value	Units
Stream Code	R		63053	
River Mile Index	R		2	miles
Elevation	R		562	feet
Latitude			40.199167	
Longitude			-76.883056	
Drainage Area	R		0.13	sq miles
Reach Slope	O		Default	ft/ft
Low Flow Yield	R	0.1	0.0931	cfs/sq mile
Potable Water Supply Withdrawal	O	0	Default	mgd
General Data 2 (Modeling Point #2)	Type	Default	Input Value	Units
Stream Code	R		63053	
River Mile Index	R		0.78	miles
Elevation	R		381	feet
Latitude			40.210481	
Longitude			-76.868263	
Drainage Area	R		1.53	sq miles
Reach Slope	O		Default	ft/ft
Low Flow Yield	R	0.1	0.0931	cfs/sq mile
Potable Water Supply Withdrawal	O	0	Default	mgd
Hydrodynamic and Related Data	Type	Default	Input Value	Units
Tributary Flow	O		Default	cfs
Stream Flow	O		Default	cfs
Tributary Temperature	R	20	20.51	C
Tributary pH	R	7	8.2	pH units
Stream Temperature	O		Default	C
Stream pH	O		Default	pH Units
Tributary Hardness	R (Pentox)	100	130	mg/l

<i>Discharge Data</i>	<i>Type</i>	<i>Default</i>	<i>Input Value</i>	<i>Units</i>
Discharge Name	R		Pa American Water Company	15 character
Permit Number	R		PA0247162	PA0000000
Existing Discharge Flow	R		0.483	mgd
Permitted Discharge Flow	R		0.483	mgd
Design Discharge Flow	R		0.483	mgd
Reserve Factor	O	0	Default	decimal percent
Discharge Temperature	R	25	Usually default	C
Discharge pH	R	7	7.51	pH units
Discharge Hardness	R (Pentox)	100	120	mg/l

Number of Samples for PENTOXSD	R	-----	4	Dimensionless
--------------------------------	---	-------	---	---------------



Discharge Information

Instructions Discharge Stream

Facility: PA American Water NPDES Permit No.: PA0247162 Outfall No.: 001

Evaluation Type: Major Sewage / Industrial Waste Wastewater Description: Water treatment plant backwash

Discharge Characteristics								
Design Flow (MGD)*	Hardness (mg/l)*	pH (SU)*	Partial Mix Factors (PMFs)				Complete Mix Times (min)	
			AFC	CFC	THH	CRL	Q ₇₋₁₀	Q _h
0.483	120	7.51						

Discharge Pollutant	Units	Max Discharge Conc	0 if left blank		0.6 if left blank		0 if left blank			1 if left blank	
			Trib Conc	Stream Conc	Daily CV	Hourly CV	Stream CV	Fate Coeff	FOS	Criteria Mod	Chem Transl
Group 1	Total Dissolved Solids (PWS)	mg/L	138								
	Chloride (PWS)	mg/L	38.7								
	Bromide	mg/L	< 1								
	Sulfate (PWS)	mg/L	90.2								
	Fluoride (PWS)	mg/L	< 0.2								
Group 2	Total Aluminum	µg/L	< 5								
	Total Antimony	µg/L	< 0.4								
	Total Arsenic	µg/L	< 1								
	Total Barium	µg/L	30								
	Total Beryllium	µg/L	< 0.4								
	Total Boron	µg/L	< 50								
	Total Cadmium	µg/L	< 0.08								
	Total Chromium (III)	µg/L	< 1								
	Hexavalent Chromium	µg/L	< 0.1								
	Total Cobalt	µg/L	< 1								
	Total Copper	µg/L	< 2								
	Free Cyanide	µg/L									
	Total Cyanide	µg/L	< 5								
	Dissolved Iron	µg/L	403								
	Total Iron	µg/L	48								
	Total Lead	µg/L	< 1								
	Total Manganese	µg/L	54								
	Total Mercury	µg/L	< 0.2								
	Total Nickel	µg/L	< 1								
	Total Phenols (Phenolics) (PWS)	µg/L	< 50								
Total Selenium	µg/L	< 2									
Total Silver	µg/L	< 0.05									
Total Thallium	µg/L	< 0.4									
Total Zinc	µg/L	< 10									
Total Molybdenum	µg/L	< 1									
Acrolein	µg/L	<									
Acrylamide	µg/L	<									
Acrylonitrile	µg/L	<									
Benzene	µg/L	<									
Bromoform	µg/L	<									



Stream / Surface Water Information

PA American Water, NPDES Permit No. PA0247162, Outfall 001

Instructions Discharge **Stream**

Receiving Surface Water Name: Tributary 63053 to Yellow Breeches Cr No. Reaches to Model: 1

- Statewide Criteria
- Great Lakes Criteria
- ORSANCO Criteria

Location	Stream Code*	RMI*	Elevation (ft)*	DA (mi ²)*	Slope (ft/ft)	PWS Withdrawal (MGD)	Apply Fish Criteria*
Point of Discharge	063053	2	562	0.13			Yes
End of Reach 1	063053	0.78	381	1.53			Yes

Q₇₋₁₀

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness*	pH*	Hardness	pH
Point of Discharge	2	0.0931										130	8.2		
End of Reach 1	0.78	0.0931										130	8.2		

Q_h

Location	RMI	LFY (cfs/mi ²)*	Flow (cfs)		W/D Ratio	Width (ft)	Depth (ft)	Velocity (fps)	Travel Time (days)	Tributary		Stream		Analysis	
			Stream	Tributary						Hardness	pH	Hardness	pH	Hardness	pH
Point of Discharge	2														
End of Reach 1	0.78														



Model Results

PA American Water, NPDES Permit No. PA0247162, Outfall 001

Instructions

Results

RETURN TO INPUTS

SAVE AS PDF

PRINT

All

Inputs

Results

Limits

Hydrodynamics

Q₇₋₁₀

RMI	Stream Flow (cfs)	PWS Withdrawal (cfs)	Net Stream Flow (cfs)	Discharge Analysis Flow (cfs)	Slope (ft/ft)	Depth (ft)	Width (ft)	W/D Ratio	Velocity (fps)	Travel Time (days)	Complete Mix Time (min)
2	0.01		0.01	0.747	0.028	0.553	4.217	7.624	0.328	0.229	0.00009
0.78	0.14		0.142								

Q_h

RMI	Stream Flow (cfs)	PWS Withdrawal (cfs)	Net Stream Flow (cfs)	Discharge Analysis Flow (cfs)	Slope (ft/ft)	Depth (ft)	Width (ft)	W/D Ratio	Velocity (fps)	Travel Time (days)	Complete Mix Time (min)
2	0.16		0.16	0.747	0.028	0.597	4.217	7.061	0.359	0.208	0.009
0.78	1.353		1.35								

Wasteload Allocations

Recommended WQBELs & Monitoring Requirements

No. Samples/Month:

Pollutants	Mass Limits		Concentration Limits				Governing WQBEL	WQBEL Basis	Comments
	AML (lbs/day)	MDL (lbs/day)	AML	MDL	IMAX	Units			
Dissolved Iron	1.23	1.92	305	478	762	µg/L	305	THH	Discharge Conc ≥ 50% WQBEL (RP)

Other Pollutants without Limits or Monitoring

Attachment C

TRC Evaluation

PA American Water Company

PA0247162

December 2020

1A	B	C	D	E	F	G
2	TRC EVALUATION					
3	Input appropriate values in B4:B8 and E4:E7					
4	0.0121	= Q stream (cfs)		0.5	= CV Daily	
5	0.483	= Q discharge (MGD)		0.5	= CV Hourly	
6	30	= no. samples		1	= AFC_Partial Mix Factor	
7	0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor	
8	0.39	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)	
9	0.5	= BATBPJ Value		720	= CFC_Criteria Compliance Time (min)	
	0	= % Factor of Safety (FOS)		0	= Decay Coefficient (K)	
10	Source	Reference	AFC Calculations	Reference	CFC Calculations	
11	TRC	1.3.2.iii	WLA_afc = 0.414	1.3.2.iii	WLA_cfc = 0.406	
12	PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373	5.1c	LTAMULT_cfc = 0.581	
13	PENTOXSD TRG	5.1b	LTA_afc = 0.154	5.1d	LTA_cfc = 0.236	
14						
15	Source	Effluent Limit Calculations				
16	PENTOXSD TRG	5.1f	AML_MULT = 1.231			
17	PENTOXSD TRG	5.1g	AVG_MON_LIMIT (mg/l) = 0.190	AFC		
18			INST_MAX_LIMIT (mg/l) = 0.621			
	WLA_afc	$(.019k(-k^*AFC_tc)) + [(AFC_Yc^*Qs^*.019/Qd^*e(-k^*AFC_tc)) \dots + Xd + (AFC_Yc^*Qs^*Xs/Qd)]^*(1-FOS/100)$				
	LTAMULT_afc	$EXP((0.5^*LN(cvh^*2+1))-2.326^*LN(cvh^*2+1)^*0.5)$				
	LTA_afc	$wla_afc^*LTAMULT_afc$				
	WLA_cfc	$(.011k(-k^*CFC_tc) + [(CFC_Yc^*Qs^*.011/Qd^*e(-k^*CFC_tc)) \dots + Xd + (CFC_Yc^*Qs^*Xs/Qd)]^*(1-FOS/100)$				
	LTAMULT_cfc	$EXP((0.5^*LN(cvd^*2/no_samples+1))-2.326^*LN(cvd^*2/no_samples+1)^*0.5)$				
	LTA_cfc	$wla_cfc^*LTAMULT_cfc$				
	AML_MULT	$EXP(2.326^*LN((cvd^*2/no_samples+1)^*0.5)-0.5^*LN(cvd^*2/no_samples+1))$				
	AVG_MON_LIMIT	$MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)^*AML_MULT)$				
	INST_MAX_LIMIT	$1.5^*((av_mon_limit/AML_MULT)^*LTAMULT_afc)$				