



Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0264105**
APS ID **1151079**
Authorization ID **1550211**

Applicant, Facility and Project Information

Applicant Name	<u>Crystal Gladden</u>	Facility Name	<u>Crystal A Gladden SRSTP</u>
Applicant Address	<u>9229 Station Road</u>	Facility Address	<u>9229 Station Road</u>
Applicant Contact	<u>Erie, PA 16510-5623</u>	Facility Contact	
Applicant Phone		Facility Phone	
Client ID	<u>327372</u>	Site ID	<u>809550</u>
SIC Code	<u>8800</u>	Municipality	<u>Greenfield Township</u>
SIC Description	<u>Private Households</u>	County	<u>Erie</u>
Date Application Received	<u>November 24, 2025</u>	WQM Required	<u>Previously issued - 2515412</u>
Date Application Accepted	<u>December 4, 2025</u>	WQM App. No.	
Project Description	<u>Renewal for a Single Residence Sewage Treatment Plant</u>		

Summary of Review

The permittee is applying for reissuance of Individual Permit **PA0264105** that will expire on June 30, 2026. This is a discharge into stream channel - Trib 62367 To Sixmile Creek. The average daily flow is projected to be 400 GPD.

Act 14 notifications were submitted and received.

The existing facility consists of: Norweco Singulair Green Model 960 - 500 Aerobic unit Tank with a Biofilm reactor and UV disinfection.

AMRs were not received.

There are no open violations in WMS for the subject Client ID (**327372**) as of December 4, 2025

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
x		Adebayo Olude Adebayo Olude / Civil Engineer Trainee	December 4, 2025
X		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	December 17, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	42° 6' 50.77"	Longitude	-79° 53' 53.41"
Quad Name	Hammett	Quad Code	42079A8
Wastewater Description:	Sewage Effluent		
Receiving Waters	Unnamed Tributary to Sixmile Creek (CWF, MF)	Stream Code	62367
NHD Com ID	123923452	RMI	0.7700
Drainage Area	0.32	Yield (cfs/mi ²)	0.0438
Q ₇₋₁₀ Flow (cfs)	0.014	Q ₇₋₁₀ Basis	USGS StreamStats
Elevation (ft)		Slope (ft/ft)	----
Watershed No.	15-A	Chapter 93 Class.	CWF, MF
Existing Use		Existing Use Qualifier	
Exceptions to Use	-----	Exceptions to Criteria	-----
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment			
Source(s) of Impairment			
TMDL Status		Name	
Background/Ambient Data		Data Source	
pH (SU)	7	Default - CWF	
Temperature (°F)	20	Default	
Hardness (mg/L)	100	Default	
Other:	-----	-----	
Nearest Downstream Public Water Supply Intake		Erie Water Works	
PWS Waters	Lake Erie (Chestnut and West)	Flow at Intake (cfs)	----
PWS RMI	---	Distance from Outfall (mi)	10

Changes Since Last Permit Issuance: Elevation was revised using Google Earth. Drainage Area and Q₇₋₁₀ Flow were revised using USGS StreamStats.

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of Biofilm reactor in the Norweco singulair Green Model 960-500 aerobic unit.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	XXX	1/year
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab


Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliforms are technology- based on Chapter 92a.47.

Attachment 1
eMAP– Receiving Streams Information

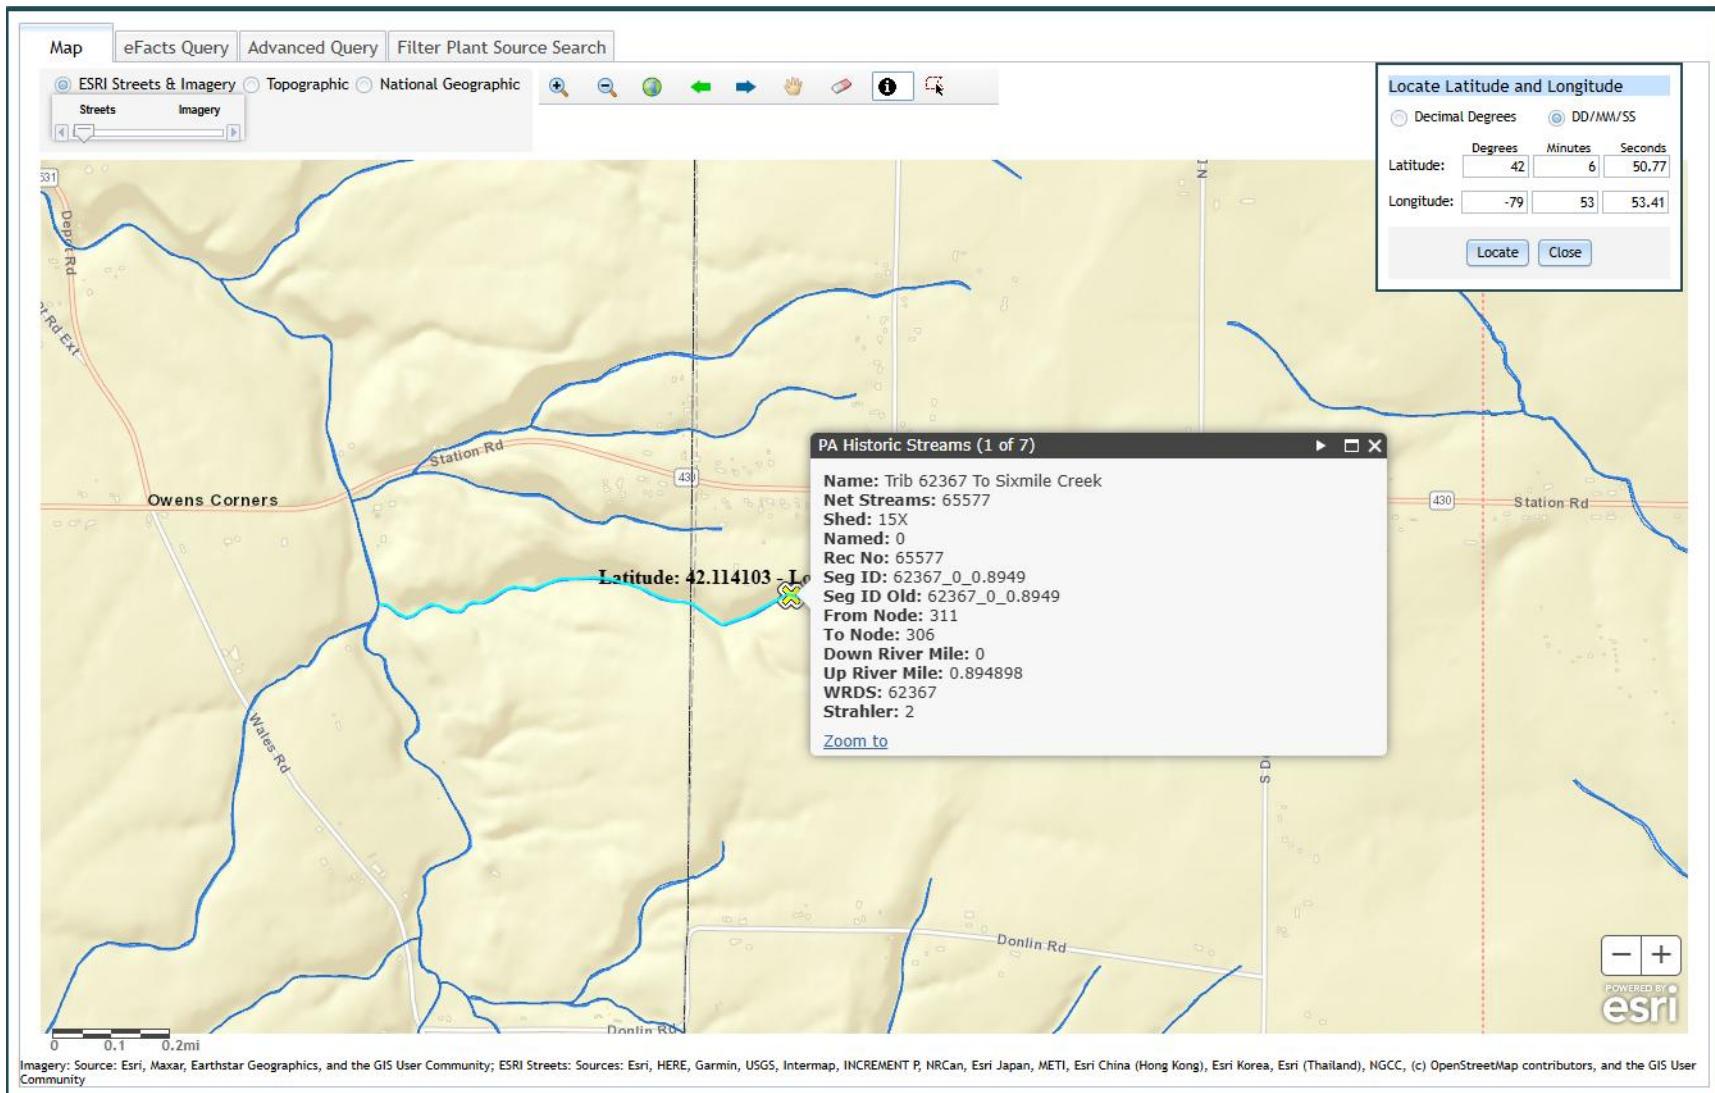

Attachment 2
Google Earth - Imagery

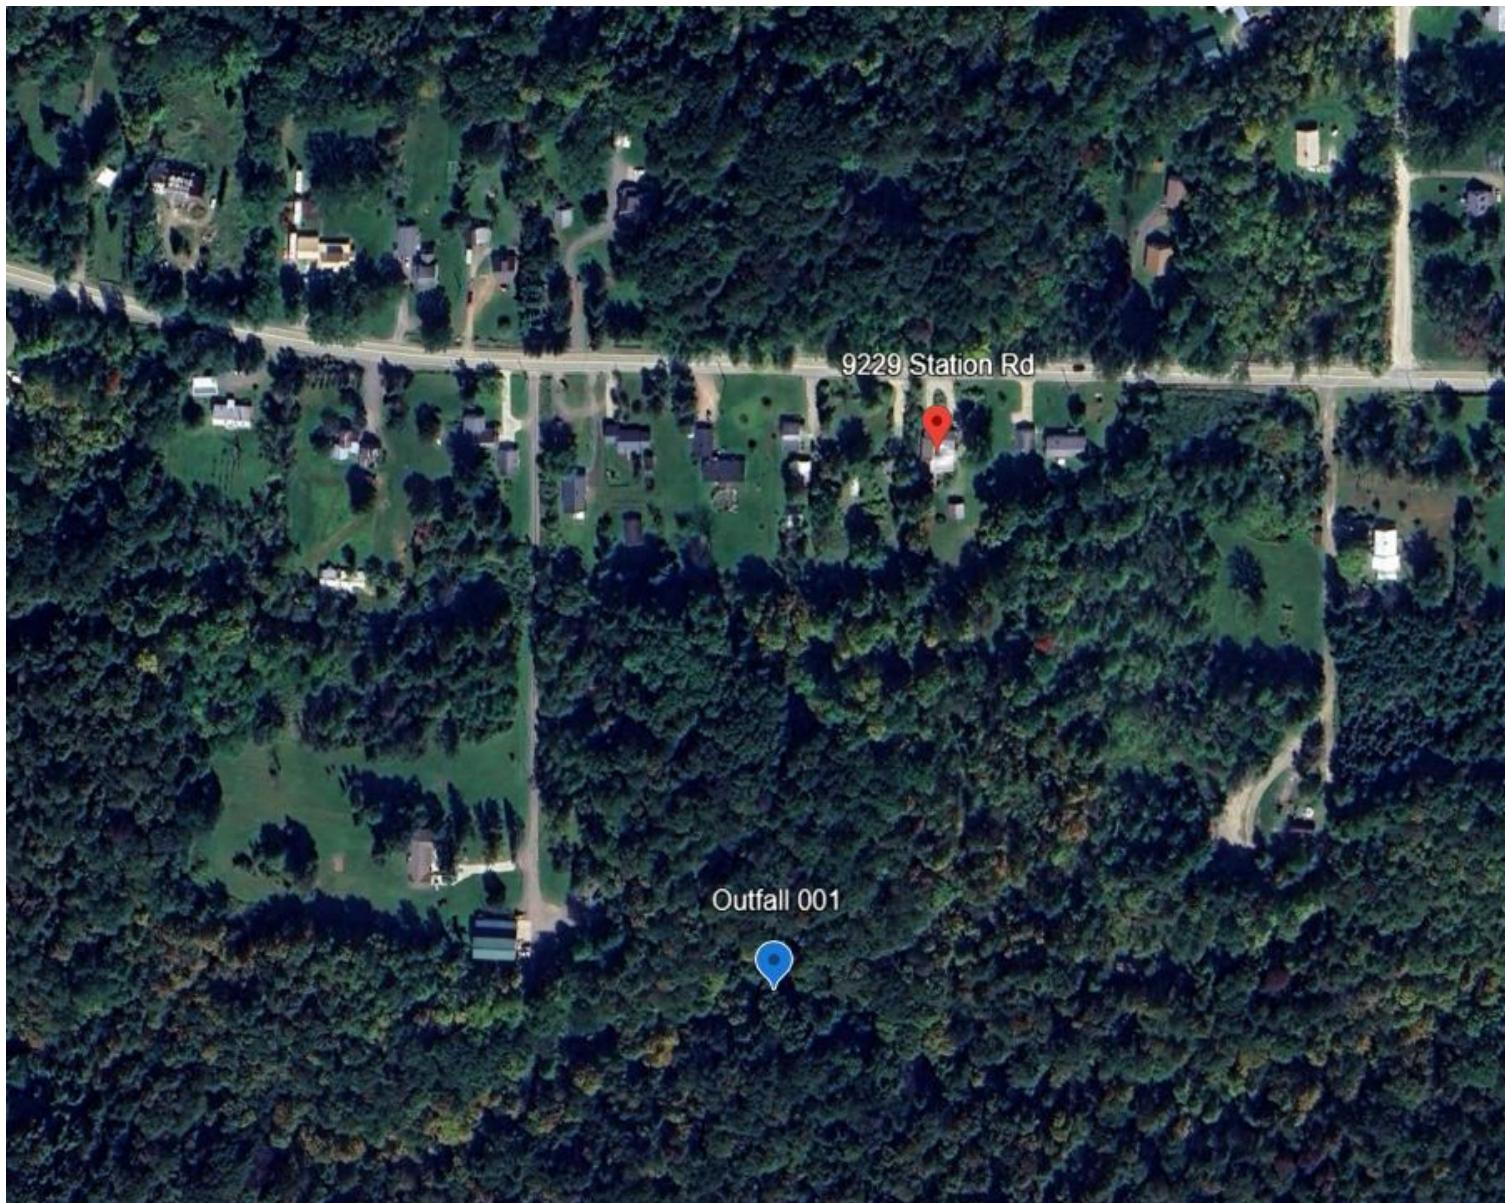

Attachment 3
StreamStats Report

StreamStats Report

Region ID:

Workspace ID:

Clicked Point (Latitude, Longitude):


Time:

PA

PA20251204181026380000

42.11408, -79.89820

2025-12-04 13:10:50 -0500

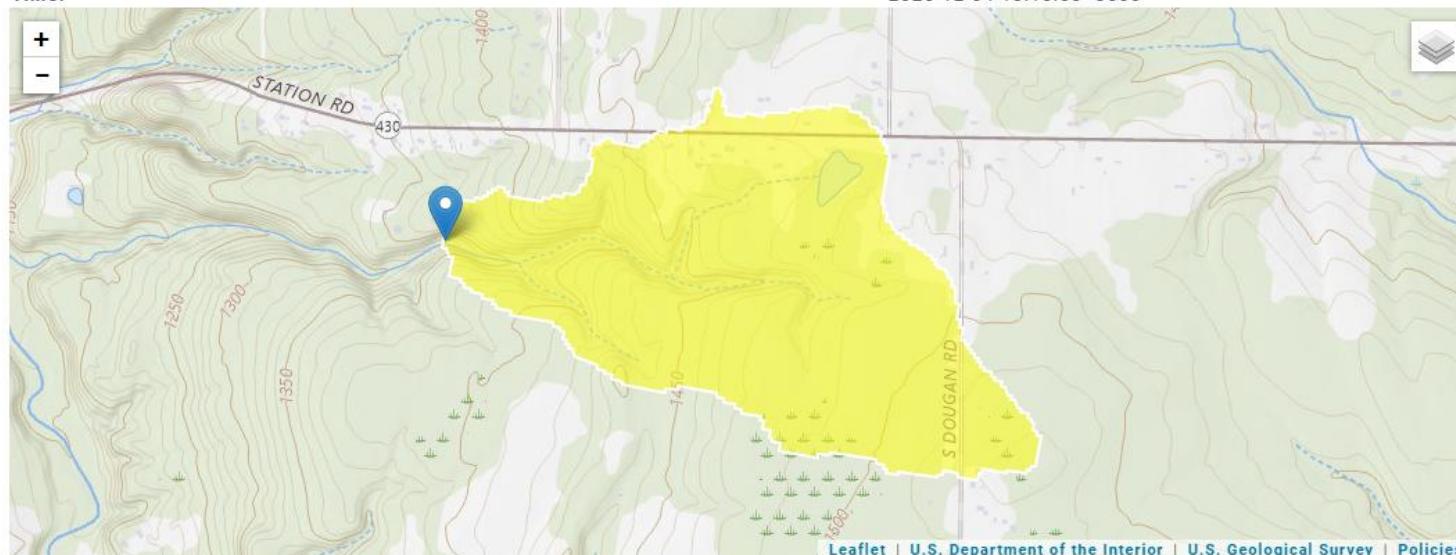

[+ Collapse All](#)

➤ Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	0.32	square miles
ELEV	Mean Basin Elevation	1461	feet
PRECIP	Mean Annual Precipitation	46	inches