

Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. PA0264172
APS ID 1019859
Authorization ID 1320509

Applicant, Facility and Project Information

Applicant Name	<u>Chadwick Paronish</u>	Facility Name	<u>Chad Paronish SRSTP</u>
Applicant Address	<u>146 Water Plant Road</u> <u>Nicktown, PA 15762-8210</u>	Facility Address	<u>146 Water Plant Road</u> <u>Nicktown, PA 15762-8210</u>
Applicant Contact	<u>Chadwick Paronish</u>	Facility Contact	<u>Chadwick Paronish</u>
Applicant Phone	<u>(814) 322-7809</u>	Facility Phone	<u>(814) 322-7809</u>
Client ID	<u>331712</u>	Site ID	<u>810413</u>
SIC Code	<u>8800</u>	Municipality	<u>Barr Township</u>
SIC Description	<u>Private Households</u>	County	<u>Cambria</u>
Date Application Received	<u>July 6, 2020</u>	WQM Required	<u>No</u>
Date Application Accepted	<u>June 1, 2021</u>	WQM App. No.	<u>-</u>
Project Description	<u>NPDES permit renewal.</u>		

Summary of Review

The project involves the NPDES renewal of a new 400 gpd single residence sewage treatment system for a 3-bedroom home.

Act 14 – Proof of notification was submitted and received.

The applicant should be able to meet the limits of this permit, which will protect the uses of the receiving stream.

I. OTHER REQUIRMENTS

- | | |
|---|---------------------------------|
| A. AMRs | F. Stormwater into Sewers |
| B. DMRs | G. Right of Way |
| C. Depth of Septage and Scum Management | H. Solids Handling |
| D. Septic Tank Pumping | I. Public Sewerage Availability |
| E. Chlorine Optimization | |

SPECIAL CONDITIONS: None

Permitted treatment consist of (WQM Permit No. 1115411 T-1) a 1250-gallon dual compartment septic tank, an Ecoflo peat moss Filter, and a Salcor 3G UV disinfection unit, where the treated effluent discharges to Teakettle Run (CWF).

There are no open violations in WMS for the subject client ID (331712) as of 6/15/2021.

Sludge use and disposal description and location(s): Septage must be pumped and hauled off-site by a septage hauler for land application under a general permit authorized by DEP or disposal at an STP.

You may make an appointment to review the DEP files on this case by calling the File Review Coordinator at 814-332-6340.

The EPA Waiver is in effect.

Approve	Deny	Signatures	Date
X		Jon F. Bucha Jonathan F. Bucha / Civil Engineer General	June 15, 2021
X		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	June 21, 2021

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.0004</u>
Latitude	<u>40° 35' 45"</u>	Longitude	<u>-78° 50' 43"</u>
Quad Name	<u>Colver</u>	Quad Code	<u>40078-E7</u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Teakettle Run (CWF)</u>	Stream Code	<u>44584</u>
NHD Com ID	<u>123717193</u>	RMI	<u>0.1200</u>
Drainage Area	<u>3.84 mi² (Streamstats)</u>	Yield (cfs/mi ²)	<u>0.059</u>
Q ₇₋₁₀ Flow (cfs)	<u>0.227</u>	Q ₇₋₁₀ Basis	<u>Streamstats</u>
Elevation (ft)	<u>1718 (Google Earth)</u>	Slope (ft/ft)	<u>-</u>
Watershed No.	<u>18-D</u>	Chapter 93 Class.	<u>CWF</u>
Existing Use	<u>-</u>	Existing Use Qualifier	<u>-</u>
Exceptions to Use	<u>-</u>	Exceptions to Criteria	<u>-</u>
Assessment Status	<u>Attaining Use(s)</u>		
Cause(s) of Impairment	<u>-</u>		
Source(s) of Impairment	<u>-</u>		
TMDL Status	<u>Final</u>	Name	<u>Kiskiminetas-Conemaugh River Watersheds TMDL</u>
Background/Ambient Data		Data Source	
pH (SU)	<u>-</u>		<u>-</u>
Temperature (°F)	<u>-</u>		<u>-</u>
Hardness (mg/L)	<u>-</u>		<u>-</u>
Other:	<u>-</u>		<u>-</u>
Nearest Downstream Public Water Supply Intake			
PWS Waters	<u></u>	Flow at Intake (cfs)	<u></u>
PWS RMI	<u></u>	Distance from Outfall (mi)	<u></u>

Changes Since Last Permit Issuance: Replaced summertime and wintertime fecal coliform limits from the previous NPDES permit to be yearround fecal coliform limit of 200 geometric mean annual average, in order to remain consistent with the SOP titled New and Reissuance Small Flow Treatment Facility Individual NPDES Permit Applications (SOP no. BCW-PMT-003, dated May 17, 2019).

Other Comments: This treatment facility is capable of meeting effluent limits.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Compliance History	
Summary of DMRs:	Provided sampling did not exceed effluent limits.
Summary of Inspections:	Inspection occurred on 11/17, 2020 where no violations were noted.

Other Comments: **AMRs have been submitted. Proof of septage pumping was received for September 10, 2018.**

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/year	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab


Compliance Sampling Location: Outfall 001 after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7 and the monitoring frequency for pH has been established as "upon request" due to CWF stream designation.

Attachment A – Chapter 93 Class

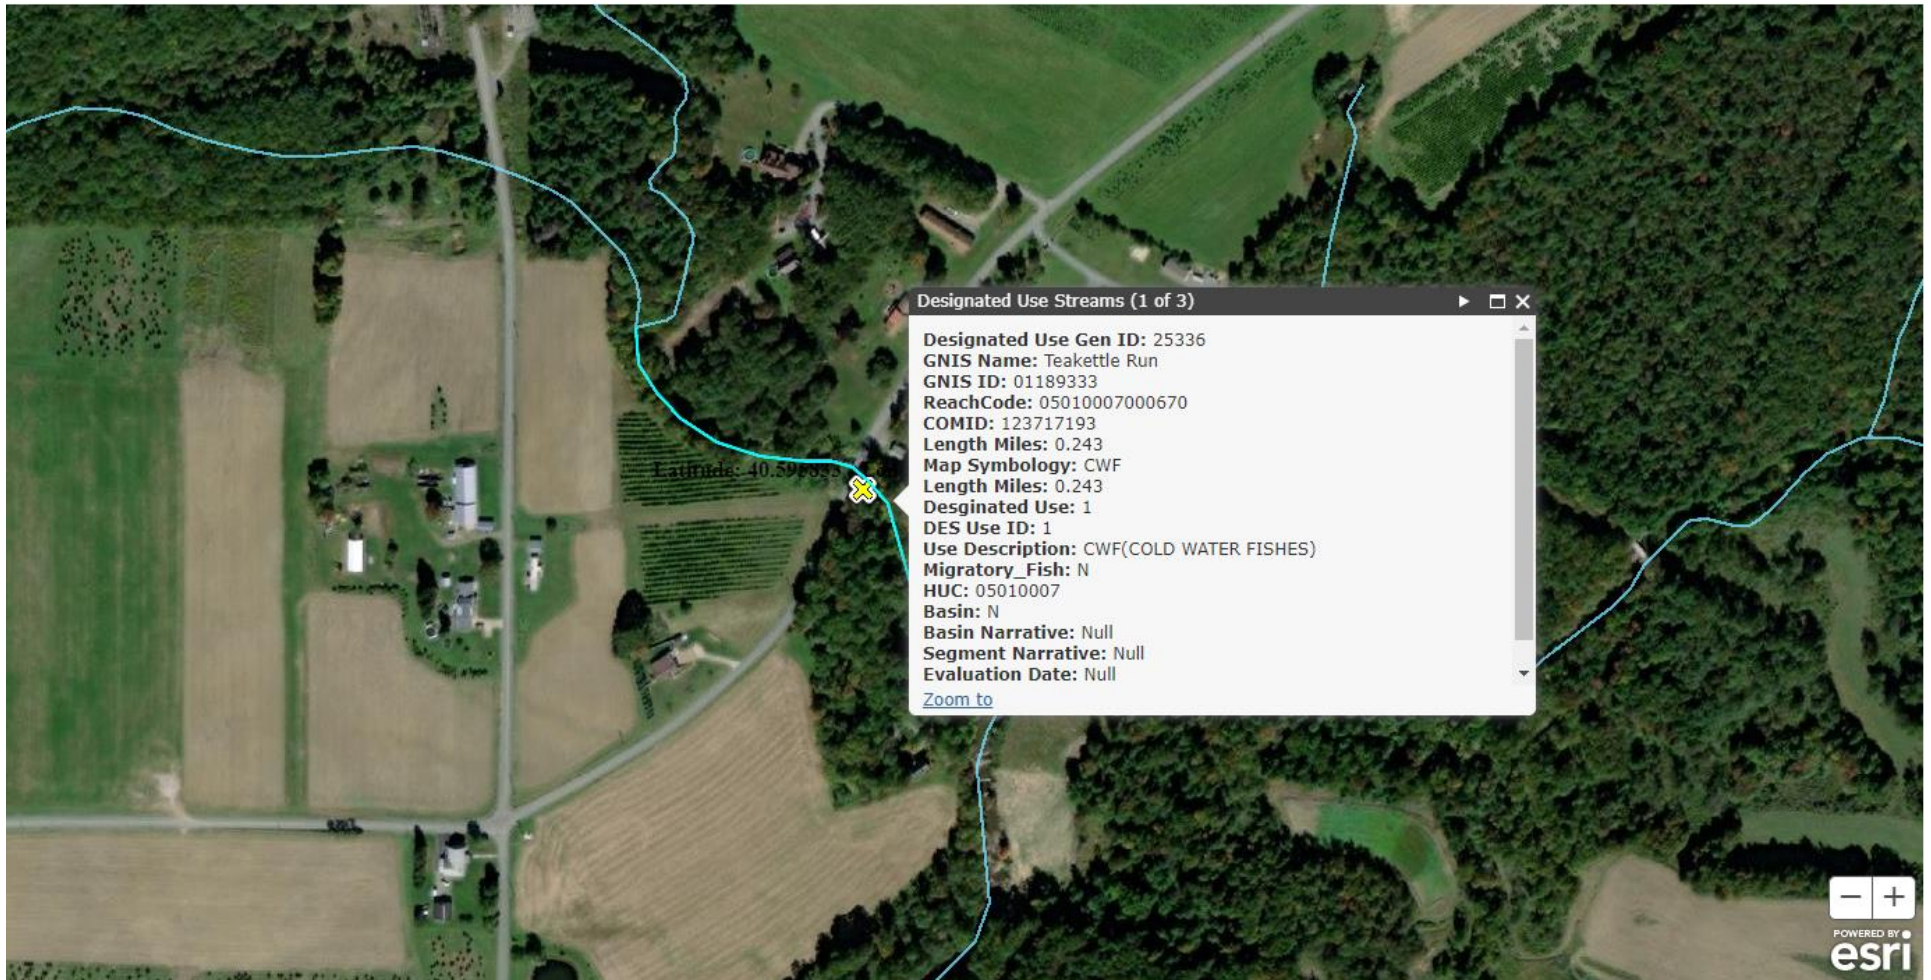

Attachment B – Streamstats Outfall 001 Drainage Area

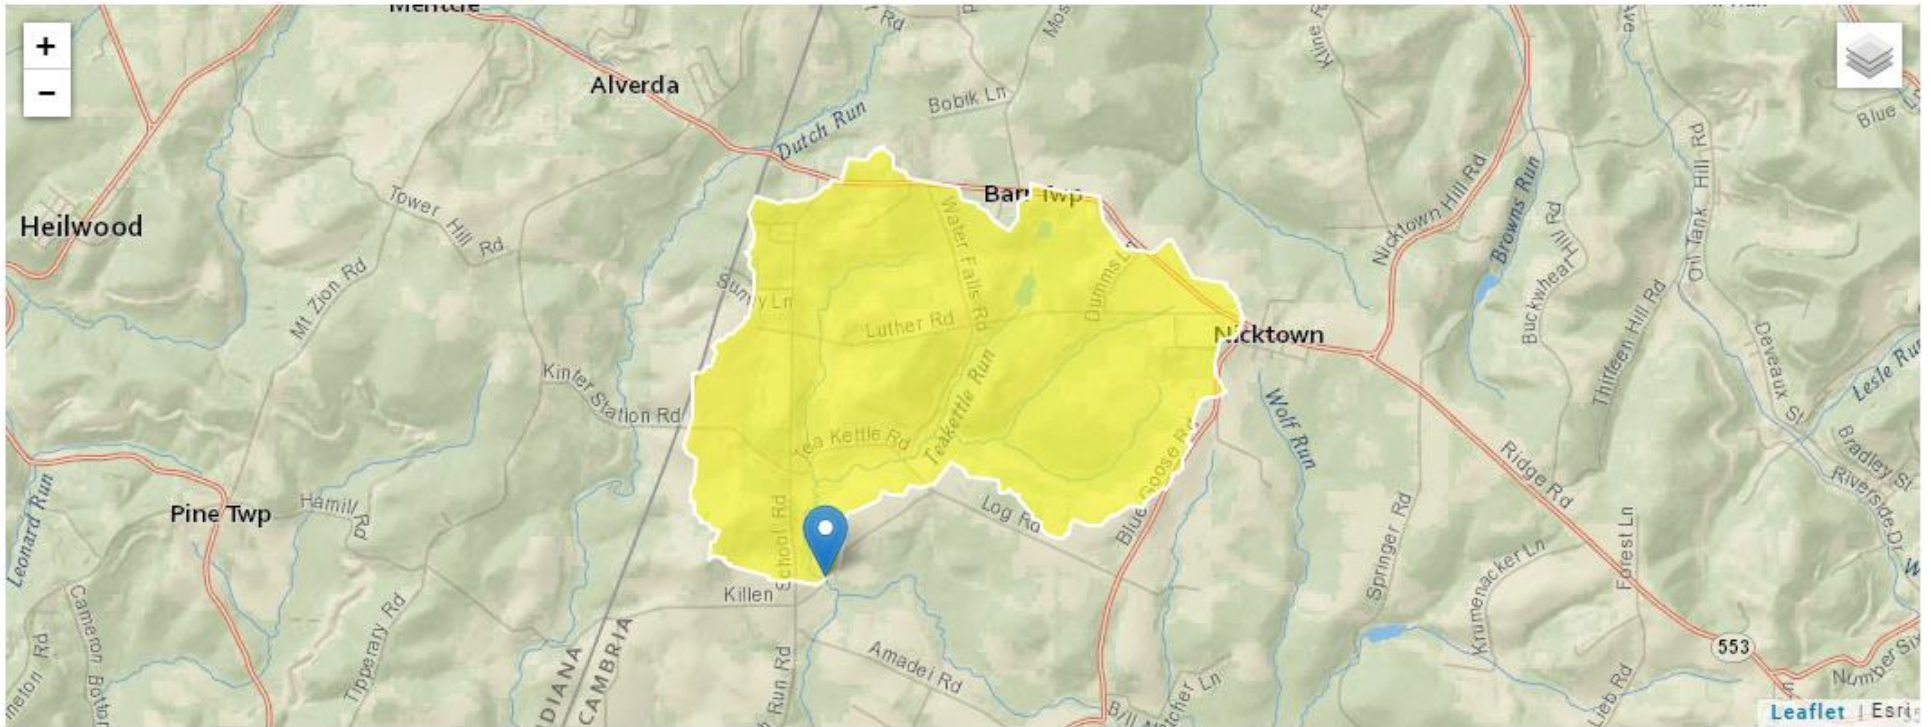

Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	3.84	square miles
ELEV	Mean Basin Elevation	1855	feet
PRECIP	Mean Annual Precipitation	45	inches