

Application Type Renewal  
Wastewater Type Sewage  
Facility Type SRSTP

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SFTF/SRSTP**

Application No. PA0265209  
APS ID 1061868  
Authorization ID 1393449

**Applicant, Facility and Project Information**

Applicant Name	<u>William E Roberts Jr</u>	Facility Name	<u>William E Roberts SRSTP</u>
Applicant Address	<u>6300 Franklin Road</u> <u>Fairview, PA 16415</u>	Facility Address	<u>6300 Franklin Road</u> <u>Fairview, PA 16415</u>
Applicant Contact	<u>William Roberts</u>	Facility Contact	<u></u>
Applicant Phone	<u>(814) 474-4709</u>	Facility Phone	<u></u>
Client ID	<u>337230</u>	Site ID	<u>822790</u>
SIC Code	<u>8800</u>	Municipality	<u>Fairview Township</u>
SIC Description	<u>Private Households</u>	County	<u>Erie</u>
Date Application Received	<u>April 25, 2022</u>	WQM Required	<u>Yes</u>
Date Application Accepted	<u>May 5, 2022</u>	WQM App. No.	<u>2517407</u>
Project Description	<u>Single Residence Sewage Treatment Plant Renewal.</u>		

**Summary of Review**

This is an existing discharge.

Act 14 – Proof of Notification was submitted and received.

Existing treatment consists of (WQM Permit No. 2517407): A Norweco Singulair Model 960 aerobic unit, a Norweco Bio Film Reactor, a Norweco AT 1500 (UV) light disinfection unit, and a 500 gallon effluent pump tank.

The EPA Waiver is in effect.

The treatment tanks were pumped in October 2021.

There are no open violations in WMS for the subject Client ID (337230) as of 6/15/2022.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	June 15, 2022
X		Adam J. Pesek for Justin C. Dickey, P.E. / Environmental Engineer Manager	June 16, 2022

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>0.0005</u>
Latitude	<u>42° 0' 42.7"</u>	Longitude	<u>-80° 15' 32.31"</u>
Quad Name	<u>Fairview</u>	Quad Code	<u>42080A3</u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Unnamed Tributary to Lake Erie</u>	Stream Code	<u>62485</u>
NHD Com ID	<u>134205215</u>	RMI	<u>0.1600</u>
Drainage Area	<u>0.27</u>	Yield (cfs/mi <sup>2</sup> )	<u>0.1</u>
Q <sub>7-10</sub> Flow (cfs)	<u>0.027</u>	Q <sub>7-10</sub> Basis	<u>Default</u>
Elevation (ft)	<u>906</u>	Slope (ft/ft)	<u>---</u>
Watershed No.	<u>15-A</u>	Chapter 93 Class.	<u>HQ-CWF, MF</u>
Existing Use	<u></u>	Existing Use Qualifier	<u></u>
Exceptions to Use	<u></u>	Exceptions to Criteria	<u></u>
Assessment Status	<u>Impaired</u>		
Cause(s) of Impairment	<u>SILTATION</u>		
Source(s) of Impairment	<u>AGRICULTURE</u>		
TMDL Status	<u></u>	Name	<u></u>
Background/Ambient Data		Data Source	
pH (SU)	<u>7.0</u>	Default	<u></u>
Temperature (°F)	<u>20</u>	Default	<u></u>
Hardness (mg/L)	<u>100</u>	Default	<u></u>
Other:	<u></u>		<u></u>
Nearest Downstream Public Water Supply Intake	<u>Erie Water Works</u>		
PWS Waters	<u>Lake Erie (Chestnut and West)</u>	Flow at Intake (cfs)	<u>N/A</u>
PWS RMI	<u>N/A</u>	Distance from Outfall (mi)	<u>6.47</u>

Changes Since Last Permit Issuance: None

Other Comments: No modeling was performed for this NPDES Permit as the Norweco Singlair Model 960 aerobic unit is capable of meeting CBOD5 and TSS averages of 10 mg/l, which are less than the inputs of the WQ model.

Planning was approved on July 7, 2017.

**It is recommended that this NPDES Permit be renewed.**

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are BPJ/technology-based on the Department's "Small Flow Treatment Facilities Manual. The limits for pH are technology-based on Chapter 93.7.

Attachment 1  
eMap – Location Map

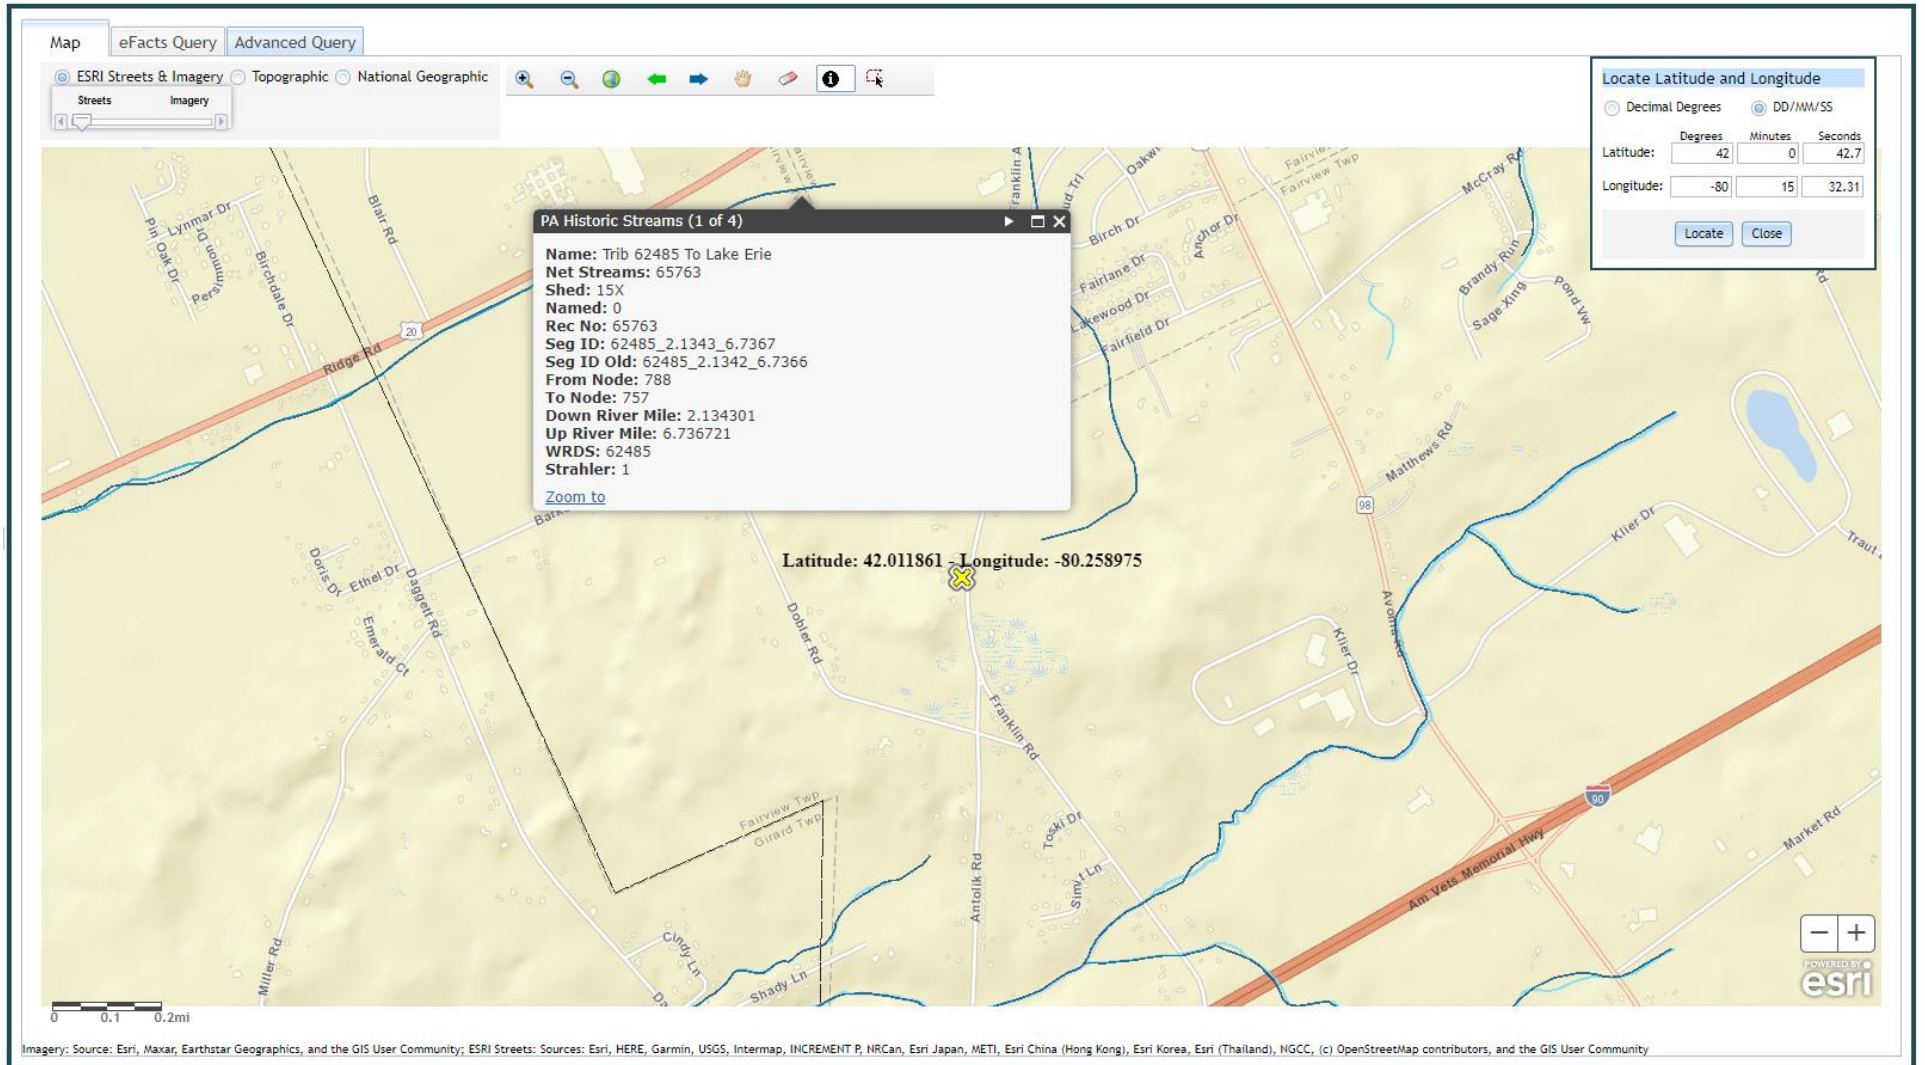

Attachment 2  
Google Earth Imagery

