



Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. PA0272001
APS ID 1119197
Authorization ID 1494720

Applicant, Facility and Project Information

Applicant Name	<u>Jerry Park</u>	Facility Name	<u>Jerry Park SRSTP</u>
Applicant Address	<u>10518 Scandia Road</u>	Facility Address	<u>10518 Scandia Road</u>
	<u>Russell, PA 16345</u>		<u>Russell, PA 16345</u>
Applicant Contact	<u>Jerry Park</u>	Facility Contact	
Applicant Phone	<u>(814) 757-9520</u>	Facility Phone	
Client ID	<u>347258</u>	Site ID	<u>833060</u>
SIC Code	<u>8800</u>	Municipality	<u>Elk Township</u>
SIC Description	<u>Private Households</u>	County	<u>Warren</u>
Date Application Received	<u>August 6, 2024</u>	WQM Required	
Date Application Accepted		WQM App. No.	
Project Description	<u>NPDES Renewal for a Single Residence Sewage Treatment Plant (SRSTP).</u>		

Summary of Review

This is an NPDES permit renewal of an existing onlot sewage system servicing a home.

The existing system (WQM #6219404) consists of a 1500-gallon dual-compartment septic tank with effluent filter, a Premier Tech EC7-500-C-P Coco filter with effluent pump, and UV disinfection unit housed in a 1000-gallon dual compartment tank.

There are currently no open violations for this client as of 3/27/2025.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	March 27, 2025
X		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	April 8, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0005
Latitude	41° 58' 18.58"	Longitude	-78° 58' 58.90"
Quad Name	Cornplanter Run	Quad Code	41078H8
Wastewater Description:	Sewage Effluent		
Receiving Waters	Unnamed Tributary to Fishburn Run (CWF)	Stream Code	56916
NHD Com ID	112367409	RMI	0.6900
Drainage Area	0.1	Yield (cfs/mi ²)	0.1
Q ₇₋₁₀ Flow (cfs)	0.01	Q ₇₋₁₀ Basis	Default
Elevation (ft)	2035	Slope (ft/ft)	---
Watershed No.	16-B	Chapter 93 Class.	CWF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment			
Source(s) of Impairment			
TMDL Status		Name	
Background/Ambient Data		Data Source	
pH (SU)	7.0	Default	
Temperature (°F)	20	Default	
Hardness (mg/L)	100	Default	
Other:			
Nearest Downstream Public Water Supply Intake		New York State Line	
PWS Waters	Allegheny Reservoir	Flow at Intake (cfs)	N/A
PWS RMI	N/A	Distance from Outfall (mi)	2.2

Changes Since Last Permit Issuance: None.

Other Comments: N/A

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (MGD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	XXX	1/year
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
CBOD ₅	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅ and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1
eMap – Location Map

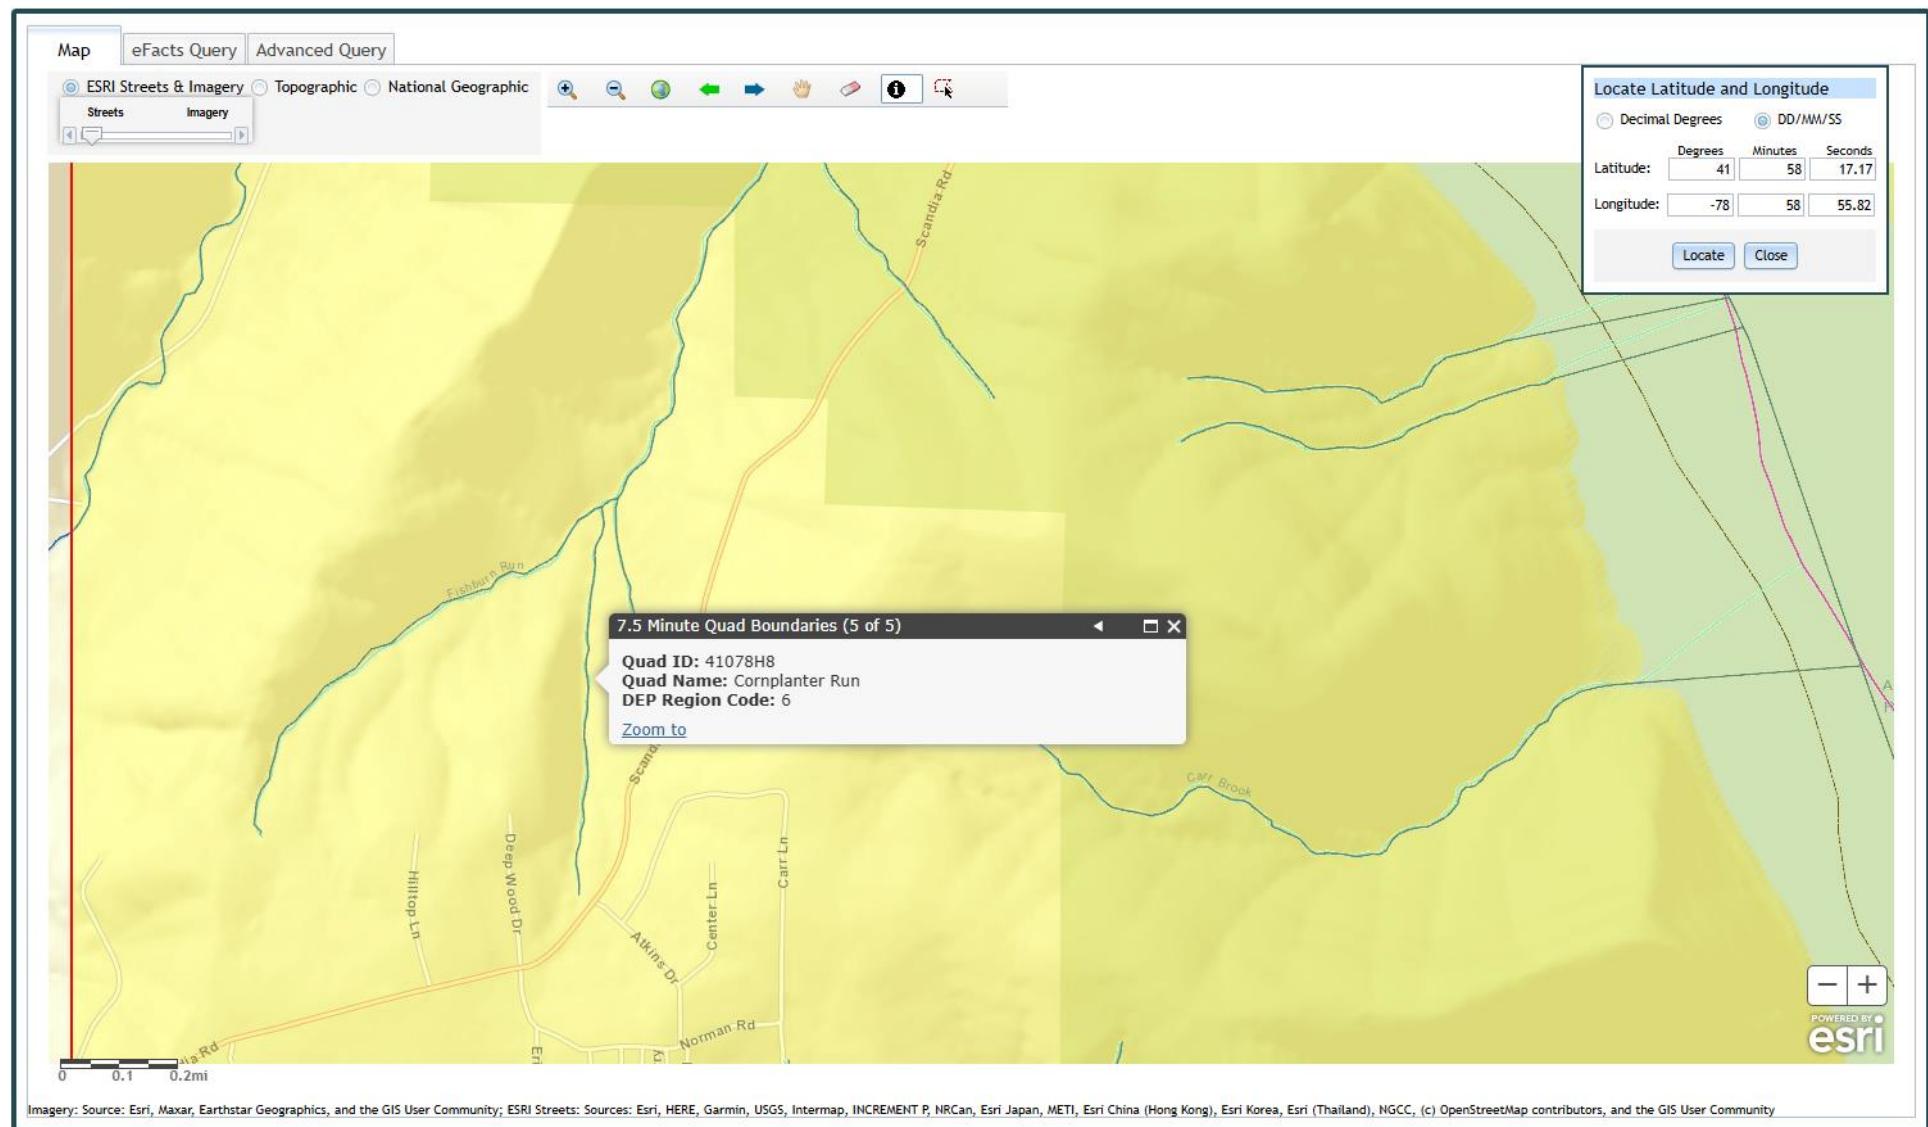

Attachment 2
Google Earth Imagery

