

Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0272434**
APS ID **1136382**
Authorization ID **1525612**

Applicant, Facility and Project Information

Applicant Name	<u>Eric Erdely & Kayla Wynkoop</u>	Facility Name	<u>Eric Erdely & Kayla Wynkoop SRSTP</u>
Applicant Address	10286 Sharp Road	Facility Address	10286 Sharp Road
	Waterford, PA 16441-3954		Waterford, PA 16441
Applicant Contact	<u>Eric Erdely</u>	Facility Contact	
Applicant Phone	<u>(814) 434-4127</u>	Facility Phone	
Client ID	<u>363815</u>	Site ID	<u>836734</u>
SIC Code	<u>8800</u>	Municipality	<u>Waterford Township</u>
SIC Description	<u>Private Households</u>	County	<u>Erie</u>
Date Application Received	<u>April 17, 2025</u>	WQM Required	<u>Previously issued - 2519416</u>
Date Application Accepted	<u>June 12, 2025</u>	WQM App. No.	
Project Description	<u>Renewal for a Single residence sewage treatment plant.</u>		

Summary of Review

The permittee is applying for reissuance of Individual Permit **PA0272434** that would expire on November 30, 2024. This is a discharge into stream channel – Trib 62644 To Elk Creek. The average daily flow is projected to be 400 GPD.

Act 14 notifications were submitted and received.

No AMR have been submitted.

There are no open violations in WMS for the subject Client ID (**363815**) as of June 12, 2025.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
x		Adebayo Olude Adebayo Olude / Civil Engineer Trainee	June 12, 2025
x		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	June 13, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	41° 59' 37.71"	Longitude	-80° 2' 24.16"
Quad Name	Cambridge Springs	Quad Code	41080H1
Wastewater Description:	Sewage Effluent		
Receiving Waters	Unnamed Tributary of Elk Creek (CWF, MF)	Stream Code	62644
NHD Com ID	123920432	RMI	0.4700
Drainage Area	0.0652	Yield (cfs/mi ²)	0.0354
Q ₇₋₁₀ Flow (cfs)	0.00231	Q ₇₋₁₀ Basis	USGS Stream Stats
Elevation (ft)	1440	Slope (ft/ft)	
Watershed No.	15-A	Chapter 93 Class.	CWF, MF
Existing Use		Existing Use Qualifier	
Exceptions to Use		Exceptions to Criteria	
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment			
Source(s) of Impairment			
TMDL Status		Name	
Background/Ambient Data		Data Source	
pH (SU)	7	Default	
Temperature (°F)	20	Default - CWF	
Hardness (mg/L)	100	Default	
Other:	-----	-----	
Nearest Downstream Public Water Supply Intake		Erie Water Works	
PWS Waters	Lake Erie	Flow at Intake (cfs)	-----
PWS RMI	-----	Distance from Outfall (mi)	-----

Changes Since Last Permit Issuance: N/A

Other Comments: This SRSTP is designed where applicable in accordance with the SFTF Manual.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (MGD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001 – after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for CBOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47.

Attachment 1
eMAP – Receiving Streams Information

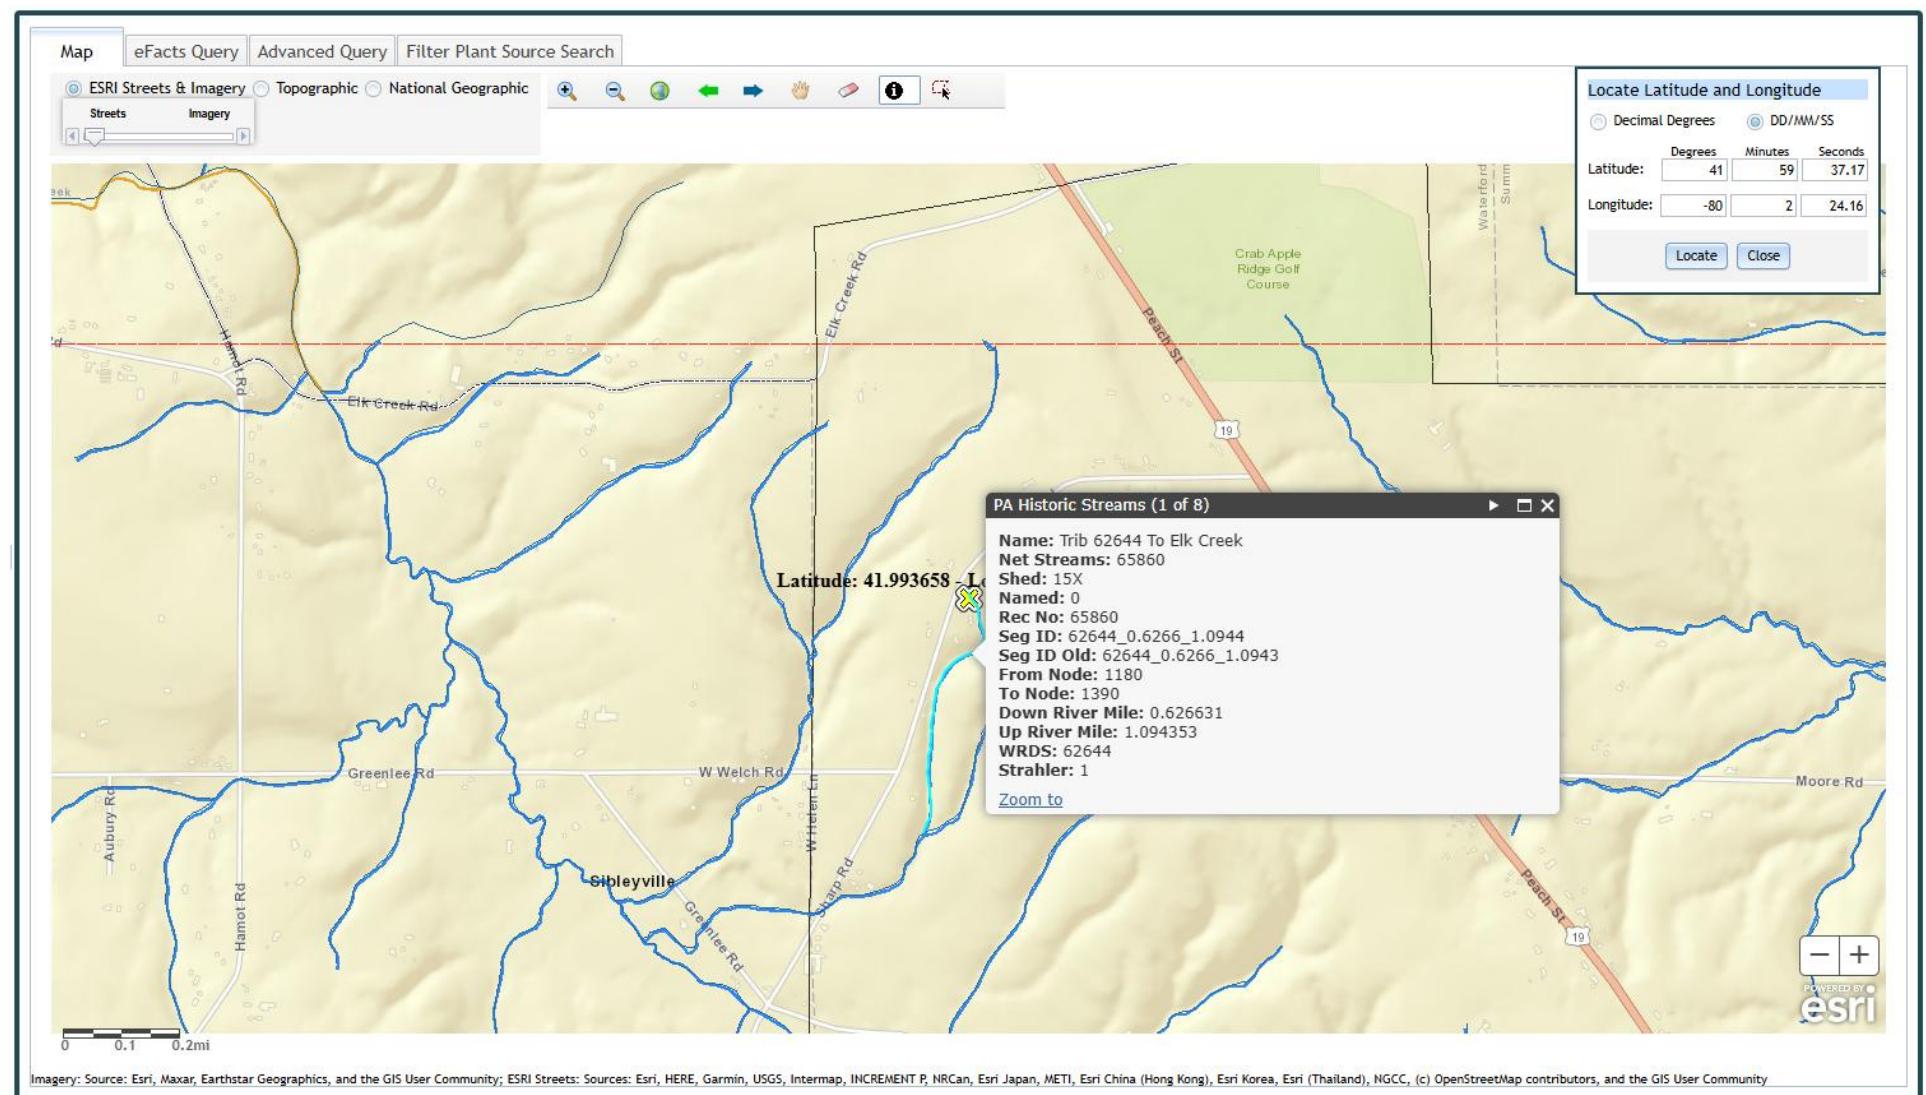

Attachment 2
Google Earth – Site Imagery

