

Application Type Renewal  
Wastewater Type Sewage  
Facility Type SRSTP

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0272558**  
APS ID **1133532**  
Authorization ID **1520367**

**Applicant, Facility and Project Information**

Applicant Name	<b>Michael Forster</b>	Facility Name	<b>Michael Forster SRSTP</b>
Applicant Address	11264 Whitewood Drive Newbury, OH 44065	Facility Address	4883 Route 6 Sheffield, PA 16347
Applicant Contact	Michael Forster	Facility Contact	Michael Forster
Applicant Phone	(216) 906-6731	Facility Phone	(216) 906-6731
Client ID	352753	Site ID	837729
SIC Code	8800	Municipality	Sheffield Township
SIC Description	Private Households	County	Warren
Date Application Received	March 18, 2025	WQM Required	Previously issued - 6219413
Date Application Accepted		WQM App. No.	
Project Description	Renewal of a Single Resident Sewage Treatment Plant (SRSTP)		

**Summary of Review**

The permittee is applying for reissuance of Individual Permit No. PA0272558 that expired on January 31, 2025. The existing discharge serves a 3-bedroom home and discharges into Twomile Run (HQ-CWF).

The existing facility consists of (WQM Permit No. 6219413): A 1,000-gallon dual compartment concrete septic tank with an effluent filter followed by a Premier Tech EC7-500-C-P Coco filter with integral UV disinfection and effluent pumping.

Act 14 notifications were submitted and received.

There are no open violations in WMS for the subject Client ID (352753) as of April 2<sup>nd</sup>, 2025.

**Public Participation**

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Carlee Wilson Carlee Wilson / Environmental Engineering Trainee	April 2, 2025
X		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	April 7, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	41° 42' 12.09"	Longitude	-79° 1' 8.88"
Quad Name	-	Quad Code	-
Wastewater Description:	Sewage Effluent		
Receiving Waters	Twomile Run (HQ-CWF)	Stream Code	105789
NHD Com ID	100468251	RMI	0.1200
Drainage Area	25.8	Yield (cfs/mi <sup>2</sup> )	-
Q <sub>7-10</sub> Flow (cfs)	1.74	Q <sub>7-10</sub> Basis	USGS - StreamStats
Elevation (ft)	-	Slope (ft/ft)	-
Watershed No.	16-F	Chapter 93 Class.	HQ-CWF
Existing Use	-	Existing Use Qualifier	-
Exceptions to Use	-	Exceptions to Criteria	-
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment	-		
Source(s) of Impairment	-		
TMDL Status	Name -		
Background/Ambient Data		Data Source	
pH (SU)	-	-	
Temperature (°F)	-	-	
Hardness (mg/L)	-	-	
Other:	-	-	
Nearest Downstream Public Water Supply Intake		-	
PWS Waters	-	Flow at Intake (cfs)	-
PWS RMI	-	Distance from Outfall (mi)	-

Changes Since Last Permit Issuance: N/A

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7-500-C-P Coco filter and the High Quality (HQ) stream designation.

In accordance with the SOP, water quality modeling was not performed since this is a SRSTP.

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
BOD <sub>5</sub>	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001 – after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7 and, as a regional policy, the monitoring frequency has been established as "1/month" due to High Quality (HQ) stream designation.

Attachment 1  
eMapPA – Receiving Stream Location and Data

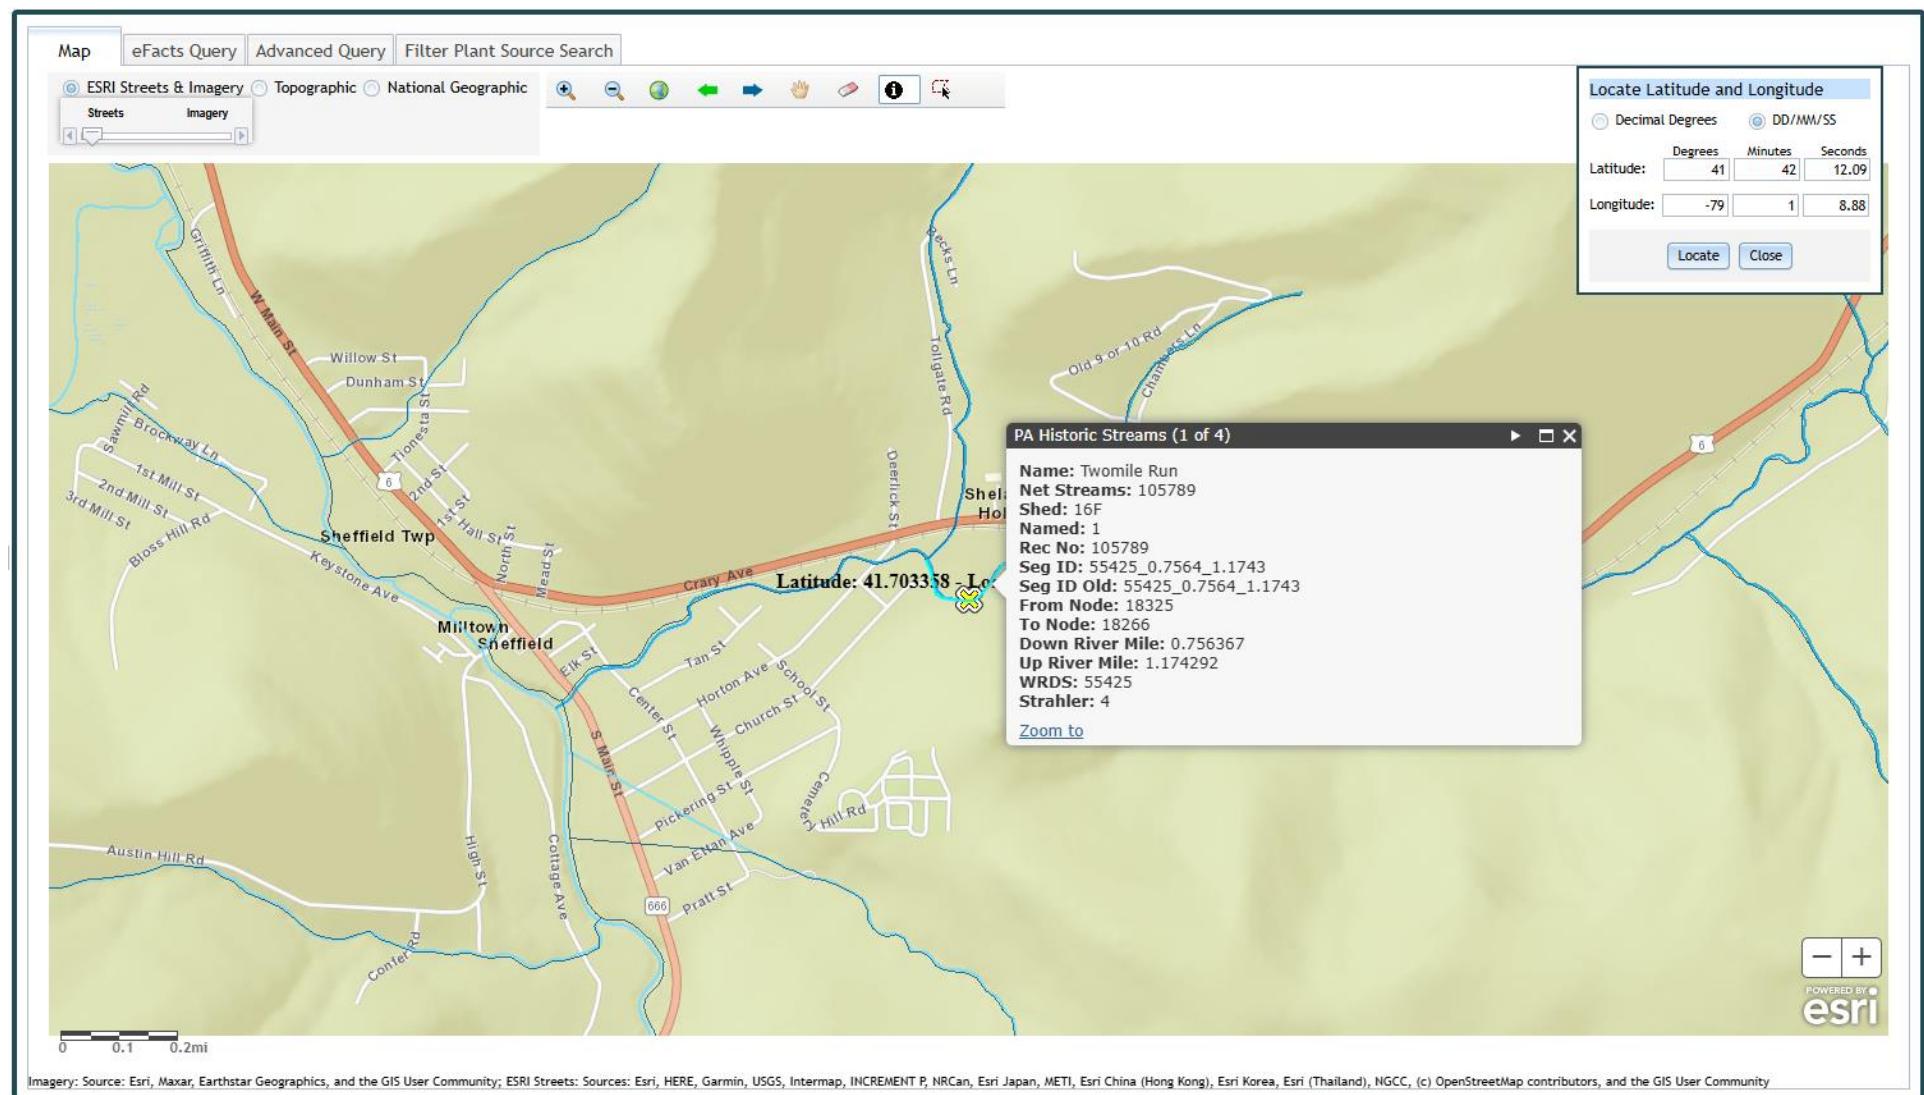

Attachment 2  
Google Earth – Aerial Site View

