

Application Type New
 Facility Type Storm Water
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
 INDIVIDUAL INDUSTRIAL WASTE (IW)
 AND IW STORMWATER**

Application No. PA0276651
 APS ID 1080012
 Authorization ID 1425350

Applicant and Facility Information

Applicant Name	<u>Nestle USA - Breinigsville District Center</u>	Facility Name	<u>Nestle USA - Breinigsville District Center</u>
Applicant Address	<u>555 Nestle Way Breinigsville, PA 18031-1518</u>	Facility Address	<u>555 Nestle Way Breinigsville, PA 18031-1518</u>
Applicant Contact	<u>Jennifer Kaltenbach</u>	Facility Contact	<u>Marc Miles</u>
Applicant Phone	<u>(484) 513-8627</u>	Facility Phone	<u>(610) 391-7910</u>
Client ID	<u>374966</u>	Site ID	<u>862465</u>
SIC Code	<u>4225</u>	Municipality	<u>Upper Macungie Township</u>
SIC Description	<u>Trans. & Utilities - General Warehousing and Storage</u>	County	<u>Lehigh</u>
Date Application Received	<u>January 30, 2023</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>February 02, 2023</u>	If No, Reason	
Purpose of Application	<u>New individual stormwater permit.</u>		

Summary of Review

The applicant is requesting a New NPDES individual stormwater permit to discharge stormwater to Iron Creek. The receiving stream is HQ-CWF/MF in state water plan basin 2-C as per the department current existing list, the receiving Stream does not have an existing use classification that is more protective than its designated use.

Industrial activities on site include receiving, warehousing and shipping finished food and beverage products. The facility is primary categorized by SIC code 4225, Land transportation, petroleum stations and terminals which fall under appendix L monitoring and reporting requirements of the PAG03 general permit. Appendix L pollutants of concern include TSS, (Oil & Grease), total Nitrogen and total phosphorus. The Benchmark value for Oil & Grease of 30mg/L is included in this permit as an IMAX BPJ limitation to be sampled semi- annually.

The stormwater from this facility is monitored by six outfalls which are spread thru the facility. Outfall 006 is considered the representative outfall and includes most activities happening in the majority of the other outfalls

The outfalls numbering is changed to match our standard numbering with eFACTS and WMS systems as follow:

(O-1 became 001); (O-2 = 002); (O-3 =003) ; (O-4A = 004) ; (O-5 = 005); (O-6 =006); (O-4B = 007); (O-4C= 008).

Since this is an existing discharge and the site maintain a no-exposure conditions all listed non- discharge alternatives were eliminated from further consideration. Degradation of existing water quality is not expected to occur because activities on the site are limited to warehouse and trucking.

The facility SOP include all BMPs which a permittee is required to implement to keep stormwater from getting into contact with potential pollutant.


Approve	Deny	Signatures	Date
X		Hakim Yesli (signed) Hakim Yesli / Environmental Engineering Specialist	August 14, 2023
X		Amy M. Bellanca (signed) Amy M. Bellanca, P.E. / Program Manager	9-7-23

Summary of Review

WMS “query by client report” was run on August 14, 2023 and no violations exist for this client.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP’s discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

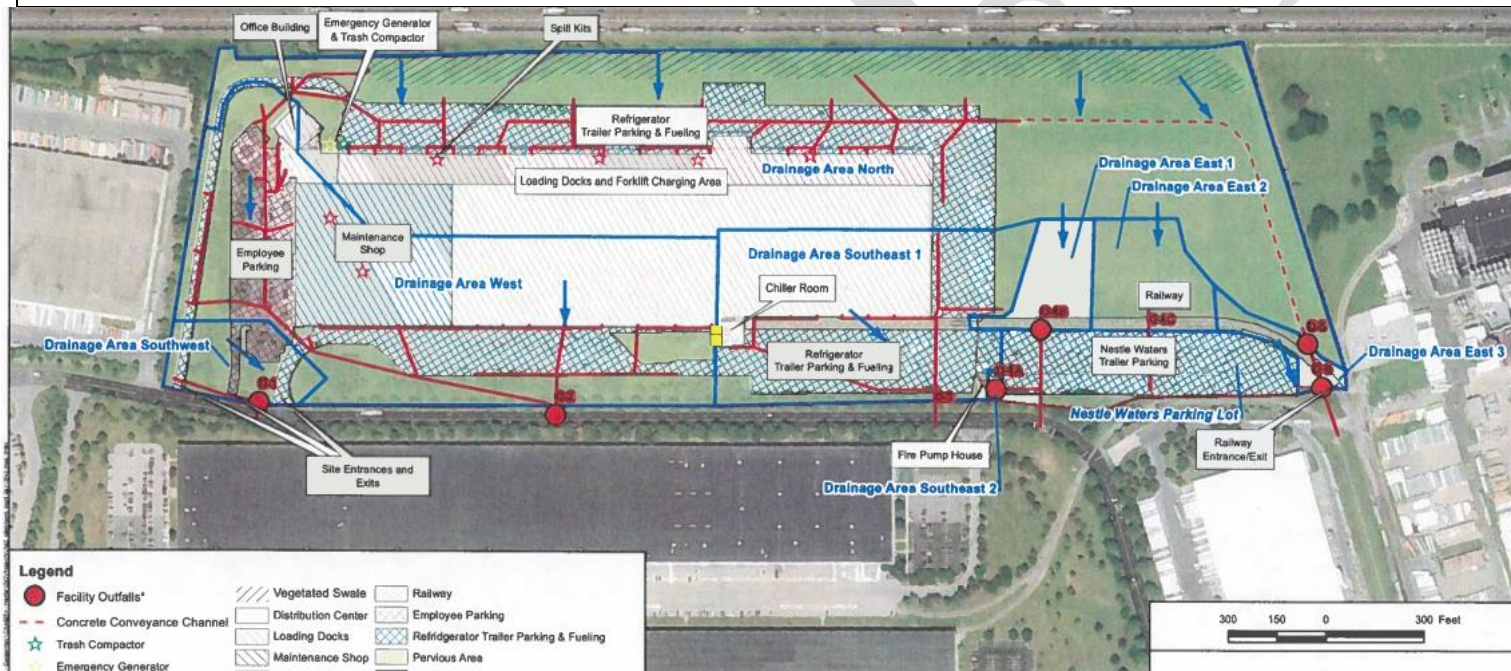

DRAFT