

Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0287946**
APS ID **1142268**
Authorization ID **1535419**

Applicant, Facility and Project Information

Applicant Name	<u>Joseph Baker</u>	Facility Name	<u>Joseph Baker SRSTP</u>
Applicant Address	<u>636 Reed Road</u>	Facility Address	<u>636 Reed Road</u>
Applicant Contact	<u>Corry, PA 16407-3012</u>	Facility Contact	<u>Corry, PA 16407</u>
Applicant Phone	<u>(814) 882-9314</u>	Facility Phone	<u>(814) 882-9314</u>
Client ID	<u>386224</u>	Site ID	<u>837637</u>
SIC Code	<u>8800</u>	Municipality	<u>Spring Creek Township</u>
SIC Description	<u>Private Households</u>	County	<u>Warren</u>
Date Application Received	<u>July 28, 2025</u>	WQM Required	<u>Previously issued - 6219414 T-1</u>
Date Application Accepted		WQM App. No.	
Project Description	<u>Renewal application for a Single Resident Sewage Treatment (SRSTP)</u>		

Summary of Review

On July 28, 2025, the Department received a renewal application for Individual Permit No. PA0287946 which expired on April 30, 2025. This is an existing discharge serving a 4-bedroom home and discharging to Winton Run (CWF). The permit was transferred in 2024. There are no proposed changes to the effluent limitations.

The existing facilities consist of (WQM Permit No. 6219414 T-1): A 1,000-gallon Premier Tech EC7-600 Pack Coco Filter Unit containing a septic tank and coco filter, a Norweco LF 1000 chlorinator, and a 300-gallon chlorine contact tank.

Act 14 notifications were submitted and received.

No AMRs have been submitted since the transfer.

There are no open violations in WMS for the subject Client ID (386224) as of July 31, 2025.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Carlee Wilson Carlee Wilson / Environmental Engineering Trainee	July 31, 2025
X		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	August 1, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	41° 52' 55.28"	Longitude	-79° 36' 20.12"
Quad Name	-	Quad Code	-
Wastewater Description:	Sewage Effluent		
Receiving Waters	Winton Run (CWF)	Stream Code	56203
NHD Com ID	112375659	RMI	0.0300
Drainage Area	0.0418	Yield (cfs/mi ²)	0.05
Q ₇₋₁₀ Flow (cfs)	0.002	Q ₇₋₁₀ Basis	USGS - StreamStats
Elevation (ft)	-	Slope (ft/ft)	-
Watershed No.	16-B	Chapter 93 Class.	CWF
Existing Use	-	Existing Use Qualifier	-
Exceptions to Use	-	Exceptions to Criteria	-
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment	-		
Source(s) of Impairment	-		
TMDL Status	-	Name	-
Background/Ambient Data		Data Source	
pH (SU)	-	-	
Temperature (°F)	-	-	
Hardness (mg/L)	-	-	
Other:	-	-	
Nearest Downstream Public Water Supply Intake		-	
PWS Waters	-	Flow at Intake (cfs)	-
PWS RMI	-	Distance from Outfall (mi)	-

Changes Since Last Permit Issuance: Drainage Area and Q₇₋₁₀ Flow were updated using USGS's StreamStats.

Other Comments:

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

This SFTF was designed where applicable in accordance with the SFTF Manual, but it does not qualify for coverage under the PAG-04 General Permit due to the use of a Premier Tech EC7-600 Pack Model.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
TRC	XXX	XXX	XXX	Report Daily Max	XXX	XXX	1/month	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001 – after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids, and Fecal Coliforms are technology-based on Chapter 92a.47. The limit for pH is technology-based on Chapter 93.7. These effluent limitations and monitoring requirements are established in the requirements of DEP's Standard Operating Procedure (SOP) for *New and Reissuance Small Flow Treatment Facility Individual NPDES Permit Application*.

Attachment 1
eMapPA – Winton Run Designated Use

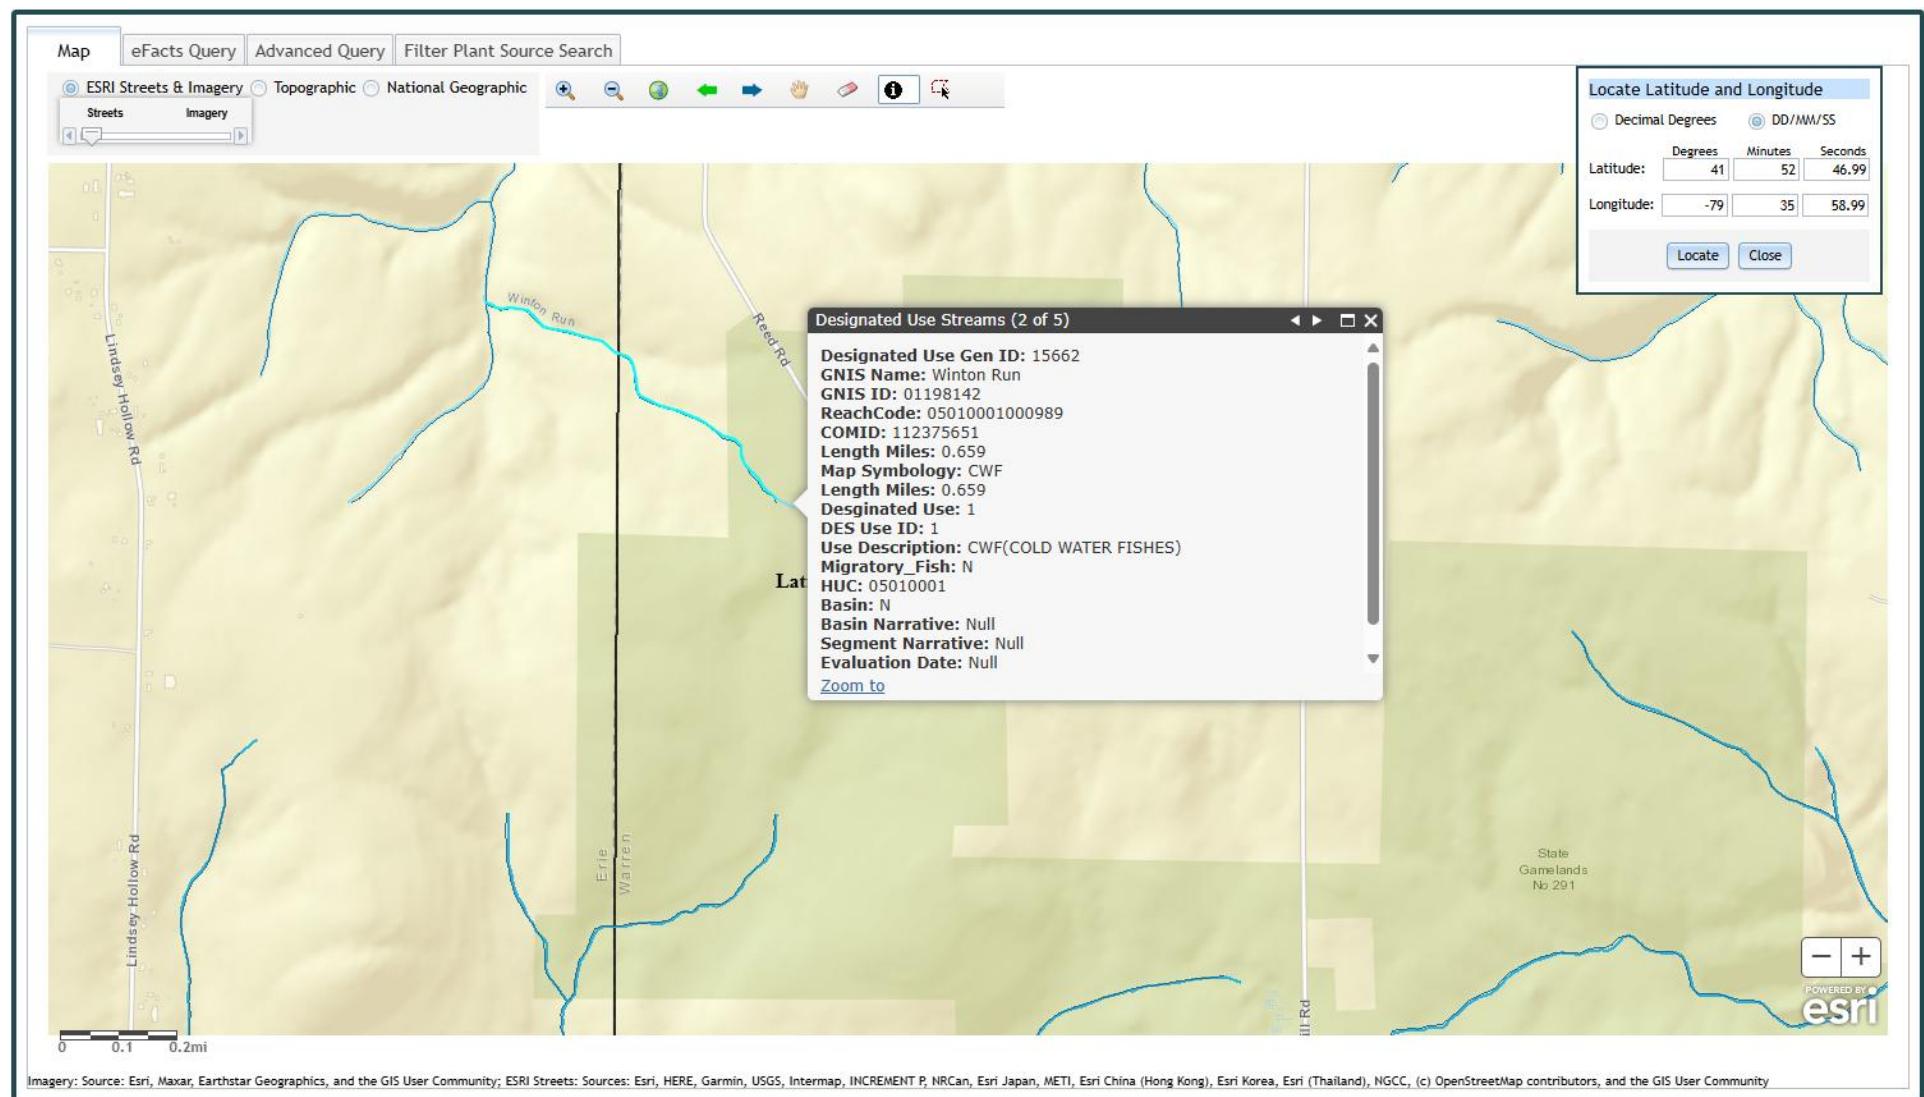

Attachment 2
Google Earth – Aerial Site View

