



Application Type Renewal
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0288101**
APS ID **1133534**
Authorization ID **1520369**

Applicant, Facility and Project Information

Applicant Name	<u>Craig Toocheck</u>	Facility Name	<u>Craig Toocheck SRSTP</u>
Applicant Address	520 Edgewood Avenue	Facility Address	2975 Dawson Run Road
Applicant Contact	Craig Toocheck	Facility Contact	Craig Toocheck
Applicant Phone	(412) 973-9040	Facility Phone	(412) 973-9040
Client ID	355182	Site ID	840301
SIC Code	4952,8800	Municipality	Harmony Township
SIC Description	Private Households,Trans. & Utilities - Sewerage Systems	County	Forest
Date Application Received	<u>March 19, 2025</u>	WQM Required	Previously issued - 2720401
Date Application Accepted		WQM App. No.	
Project Description	Renewal for a Single Resident Sewage Treatment Plant (SRSTP)		

Summary of Review

The permittee is applying for reissuance of Individual Permit No. PA0288101 that would expire on May 31, 2025. The existing discharge serves a single home and discharges into Tributary 55597 to Allegheny River (CWF).

The existing facility consists of (WQM Permit No. 2720401): A 1,000-gallon dual compartment septic tank with an effluent filter discharging to a Premier Tech EC7-500-C-P Coco filter with effluent pumping and UV disinfection

Act 14 notifications were submitted and received.

There are no open violations in WMS for the subject Client ID (355182) as of April 2, 2025.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Carlee Wilson Carlee Wilson / Environmental Engineering Trainee	April 2, 2025
X		Adam Olesnanik Adam Olesnanik, P.E. / Environmental Engineer Manager	April 4, 2025

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	41° 33' 24.25"	Longitude	-79° 26' 0.06"
Quad Name	-	Quad Code	-
Wastewater Description:	Sewage Effluent		
Receiving Waters	Unnamed Tributary to Allegheny River (CWF)	Stream Code	55597
NHD Com ID	100473925	RMI	0.7000
Drainage Area	0.2	Yield (cfs/mi ²)	-
Q ₇₋₁₀ Flow (cfs)	0.00666	Q ₇₋₁₀ Basis	USGS - StreamStats
Elevation (ft)	-	Slope (ft/ft)	-
Watershed No.	16-F	Chapter 93 Class.	CWF
Existing Use	-	Existing Use Qualifier	-
Exceptions to Use	-	Exceptions to Criteria	-
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment	-		
Source(s) of Impairment	-		
TMDL Status	-	Name	-
Background/Ambient Data	Data Source		
pH (SU)	-	-	
Temperature (°F)	-	-	
Hardness (mg/L)	-	-	
Other:	-	-	
Nearest Downstream Public Water Supply Intake	-		
PWS Waters	-	Flow at Intake (cfs)	-
PWS RMI	-	Distance from Outfall (mi)	-

Changes Since Last Permit Issuance: N/A

Other Comments:

This SFTF was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7-500-C-P Coco Filter.

In accordance with the SOP, water quality modeling was not performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (MGD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001 – after disinfection

Attachment 1
eMapPA – Receiving Stream Location and Data

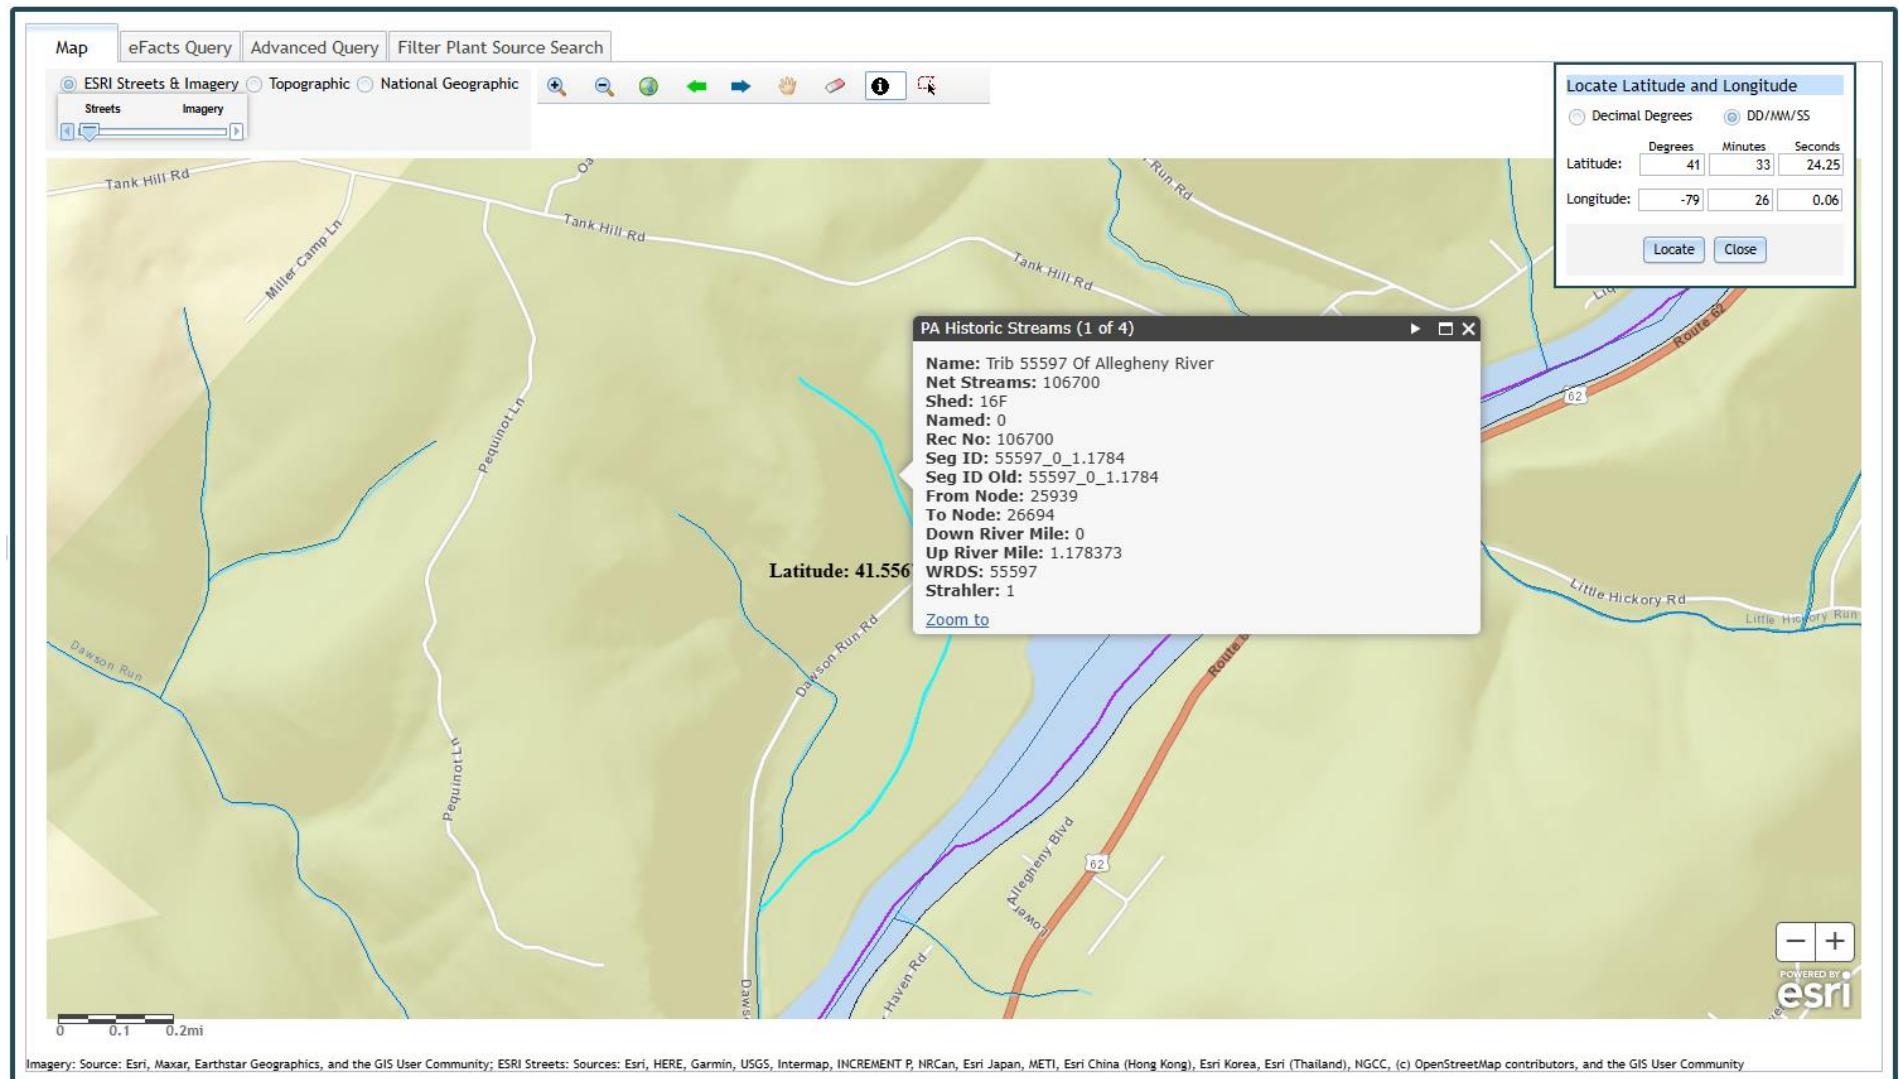

Attachment 2
Google Earth – Aerial Site View

