

Application Type New
Wastewater Type Sewage
Facility Type SFTF

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. PA0288349
APS ID 1015438
Authorization ID 1312435

Applicant, Facility and Project Information

Applicant Name	<u>David Schlabach</u>	Facility Name	<u>David J Schlabach SFTF</u>
Applicant Address	<u>254 Route 410</u> <u>Punxsutawney, PA 15767-8707</u>	Facility Address	<u>254 Route 410</u> <u>Punxsutawney, PA 15767-8707</u>
Applicant Contact	<u>David Schlabach</u>	Facility Contact	<u>David Schlabach</u>
Applicant Phone	<u>(814) 427-2839</u>	Facility Phone	<u>(814) 427-2839</u>
Client ID	<u>302110</u>	Site ID	<u>839346</u>
SIC Code	<u>8800</u>	Municipality	<u>Henderson Township</u>
SIC Description	<u>Private Households</u>	County	<u>Jefferson</u>
Date Application Received	<u>April 17, 2020</u>	WQM Required	<u>Yes</u>
Date Application Accepted	<u>May 6, 2020</u>	WQM App. No.	<u>3320401</u>
Project Description	<u>Small Flow Treatment Facility.</u>		

Summary of Review

This is a new discharge for an existing 3-bedroom home and a proposed 1-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 – Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 3320401): A 1,000-gallon dual compartment concrete septic tank behind each dwelling with a Zabel A300 effluent filter at the outlet end of each tank, Premier Tech EC7 Coco Filter unit with a Norweco LF 1000 chlorinator and then a 300-gallon chlorine contact tank.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (302110) as of 7/6/2020.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	July 6, 2020
X		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	July 7, 2020

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.0008</u>
Latitude	<u>40° 59' 7.65"</u>	Longitude	<u>-78° 50' 29.91"</u>
Quad Name	<u>McGees Mills</u>	Quad Code	<u>33915</u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Unnamed Tributary to Stump Creek (CWF)</u>	Stream Code	<u>47929</u>
NHD Com ID	<u>123861739</u>	RMI	<u>0.1200</u>
Drainage Area	<u>0.26</u>	Yield (cfs/mi ²)	<u>0.1</u>
Q ₇₋₁₀ Flow (cfs)	<u>0.026</u>	Q ₇₋₁₀ Basis	<u>Default</u>
Elevation (ft)	<u>1311</u>	Slope (ft/ft)	<u>---</u>
Watershed No.	<u>17D</u>	Chapter 93 Class.	<u>Cold Water Fishes</u>
Existing Use	<u>---</u>	Existing Use Qualifier	<u>---</u>
Exceptions to Use	<u>---</u>	Exceptions to Criteria	<u>---</u>
Assessment Status	<u>Attaining Use(s)</u>		
Cause(s) of Impairment	<u>---</u>		
Source(s) of Impairment	<u>---</u>		
TMDL Status	<u>Final</u>	Name	<u>Stump Creek Watershed</u>
Background/Ambient Data		Data Source	
pH (SU)	<u>7.0</u>	Default	
Temperature (°F)	<u>20</u>	Default	
Hardness (mg/L)	<u>100</u>	Default	
Other:	<u>---</u>	---	
Nearest Downstream Public Water Supply Intake	<u>PA American Water Punxsutawney</u>		
PWS Waters	<u>Mahoning Creek</u>	Flow at Intake (cfs)	<u>Unknown</u>
PWS RMI	<u>Unknown</u>	Distance from Outfall (mi)	<u>>10</u>

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning notification was sent on August 7, 2019).

Other Comments:

This discharge was not included in the Stump Creek watershed TMDL. However, the discharge would not be expected to discharge pollutants associated with AMD and the discharge is for the abatement of an existing malfunctioning on-lot system in the Stump Creek watershed. Therefore, no monitoring and no waste load allocations are proposed for this discharge as it should not impact the TMDL.

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7 Coco Filter unit. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Premier Tech EC7 is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Average Monthly	Maximum	Instant. Maximum		
Flow (GPD)	Report	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD₅, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1
eMap – Location Map / Receiving Stream Designation

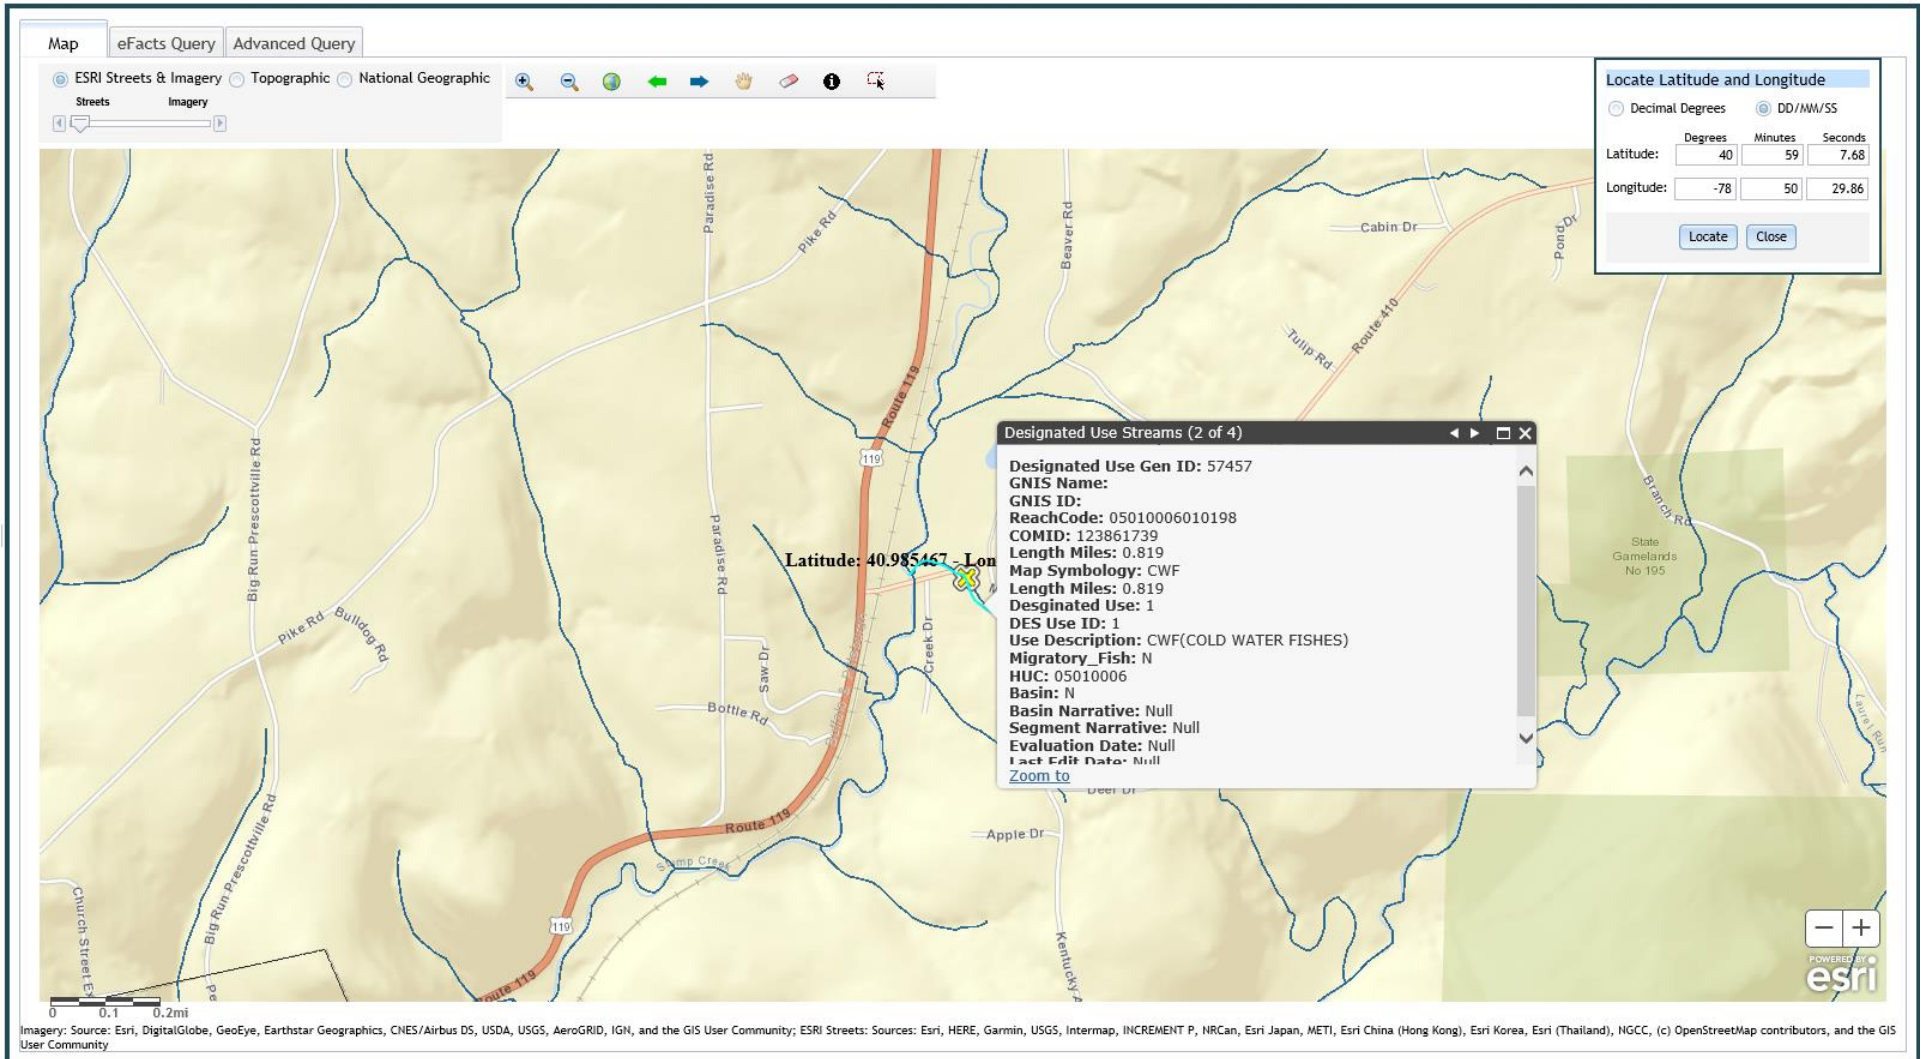

Attachment 2
Google Earth Imagery

