

Application Type New  
Wastewater Type Sewage  
Facility Type SRSTP

**NPDES PERMIT FACT SHEET  
INDIVIDUAL SFTF/SRSTP**

Application No. PA0288551  
APS ID 1019359  
Authorization ID 1319745

**Applicant, Facility and Project Information**

Applicant Name	<u>Diane &amp; Richard McMillen</u>	Facility Name	<u>Diane &amp; Richard McMillen SRSTP</u>
Applicant Address	<u>2858 E 28th Street</u> <u>Erie, PA 16510-2822</u>	Facility Address	<u>2305 Emersen Hill Road</u> <u>Grand Valley, PA 16420</u>
Applicant Contact	<u>Richard Mcmillen</u>	Facility Contact	<u>Diane &amp; Richard McMillen</u>
Applicant Phone	<u>(814) 392-2681</u>	Facility Phone	<u>(814) 392-2681</u>
Client ID	<u>357339</u>	Site ID	<u>839305</u>
SIC Code	<u>8800</u>	Municipality	<u>Eldred Township</u>
SIC Description	<u>Private Households</u>	County	<u>Warren</u>
Date Application Received	<u>June 23, 2020</u>	WQM Required	<u>Yes</u>
Date Application Accepted	<u>July 17, 2020</u>	WQM App. No.	<u>6220405</u>
Project Description	<u>Single Residence Sewage Treatment Plant.</u>		

**Summary of Review**

This is a new discharge for two existing 3-bedroom homes to a repair of an existing malfunctioning on-lot system.

Act 14 – Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 6220405): An existing 1,000-gallon dual compartment polyethylene septic tank, a new 500-gallon single compartment septic tank followed by a Premier Tech EC7-500-C-GDV Coco Filter unit followed by a Salcor 3G ultraviolet (UV) disinfection unit.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (357339) as of 7/27/2020.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Civil Engineer Trainee	July 28, 2020
X		Justin C. Dickey Justin C. Dickey, P.E. / Environmental Engineer Manager	August 3, 2020

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.0005</u>
Latitude	<u>41° 42' 34.72"</u>	Longitude	<u>-79° 30' 57.38"</u>
Quad Name	<u>Grand Valley</u>	Quad Code	<u>41079F5</u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Pine Creek (HQ-CWF)</u>	Stream Code	<u>54331</u>
NHD Com ID	<u>100470089</u>	RMI	<u>0.1400</u>
Drainage Area	<u>0.17</u>	Yield (cfs/mi <sup>2</sup> )	<u>0.1</u>
Q <sub>7-10</sub> Flow (cfs)	<u>0.1</u>	Q <sub>7-10</sub> Basis	<u>Default</u>
Elevation (ft)	<u>1653</u>	Slope (ft/ft)	<u>---</u>
Watershed No.	<u>16E</u>	Chapter 93 Class.	<u>High Quality Waters - Cold Water Fishes</u>
Existing Use	<u>---</u>	Existing Use Qualifier	<u>---</u>
Exceptions to Use	<u>---</u>	Exceptions to Criteria	<u>---</u>
Assessment Status	<u>Attaining Use(s)</u>		
Cause(s) of Impairment	<u>---</u>		
Source(s) of Impairment	<u>---</u>		
TMDL Status	<u>---</u>	Name	<u>---</u>
Background/Ambient Data		Data Source	
pH (SU)	<u>7.0</u>	Default	<u>---</u>
Temperature (°F)	<u>20</u>	Default	<u>---</u>
Hardness (mg/L)	<u>100</u>	Default	<u>---</u>
Other:	<u>---</u>	---	<u>---</u>
Nearest Downstream Public Water Supply Intake	<u>Aqua Pennsylvania - Emlenton</u>		
PWS Waters	<u>Allegheny River</u>	Flow at Intake (cfs)	<u>1376.0</u>
PWS RMI	<u>90.0</u>	Distance from Outfall (mi)	<u>&gt;50</u>

Changes Since Last Permit Issuance: N/A – This is a proposed discharge (Planning was approved on January 29, 2020).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7-C-P Coco Filter unit and the discharge is located in a High Quality (HQ) watershed. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Premier Tech EC7 is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

The proposed permit is for the discharge of treated domestic sewage to repair an existing malfunctioning on-lot septic system. The discharge should not contribute to the stream impairment and should result in an improvement to the watershed by abating an existing on-going issue.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

**Proposed Effluent Limitations and Monitoring Requirements**

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


**Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.**

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) <sup>(1)</sup>		Concentrations (mg/L)				Minimum <sup>(2)</sup> Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Daily Min	XXX	9.0 Daily Max	XXX	1/month	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub>, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7. In accordance with Regional Policy, pH monitoring is established as monthly due to High Quality (HQ) Stream Classification.

Attachment 1  
eMap – Location Map

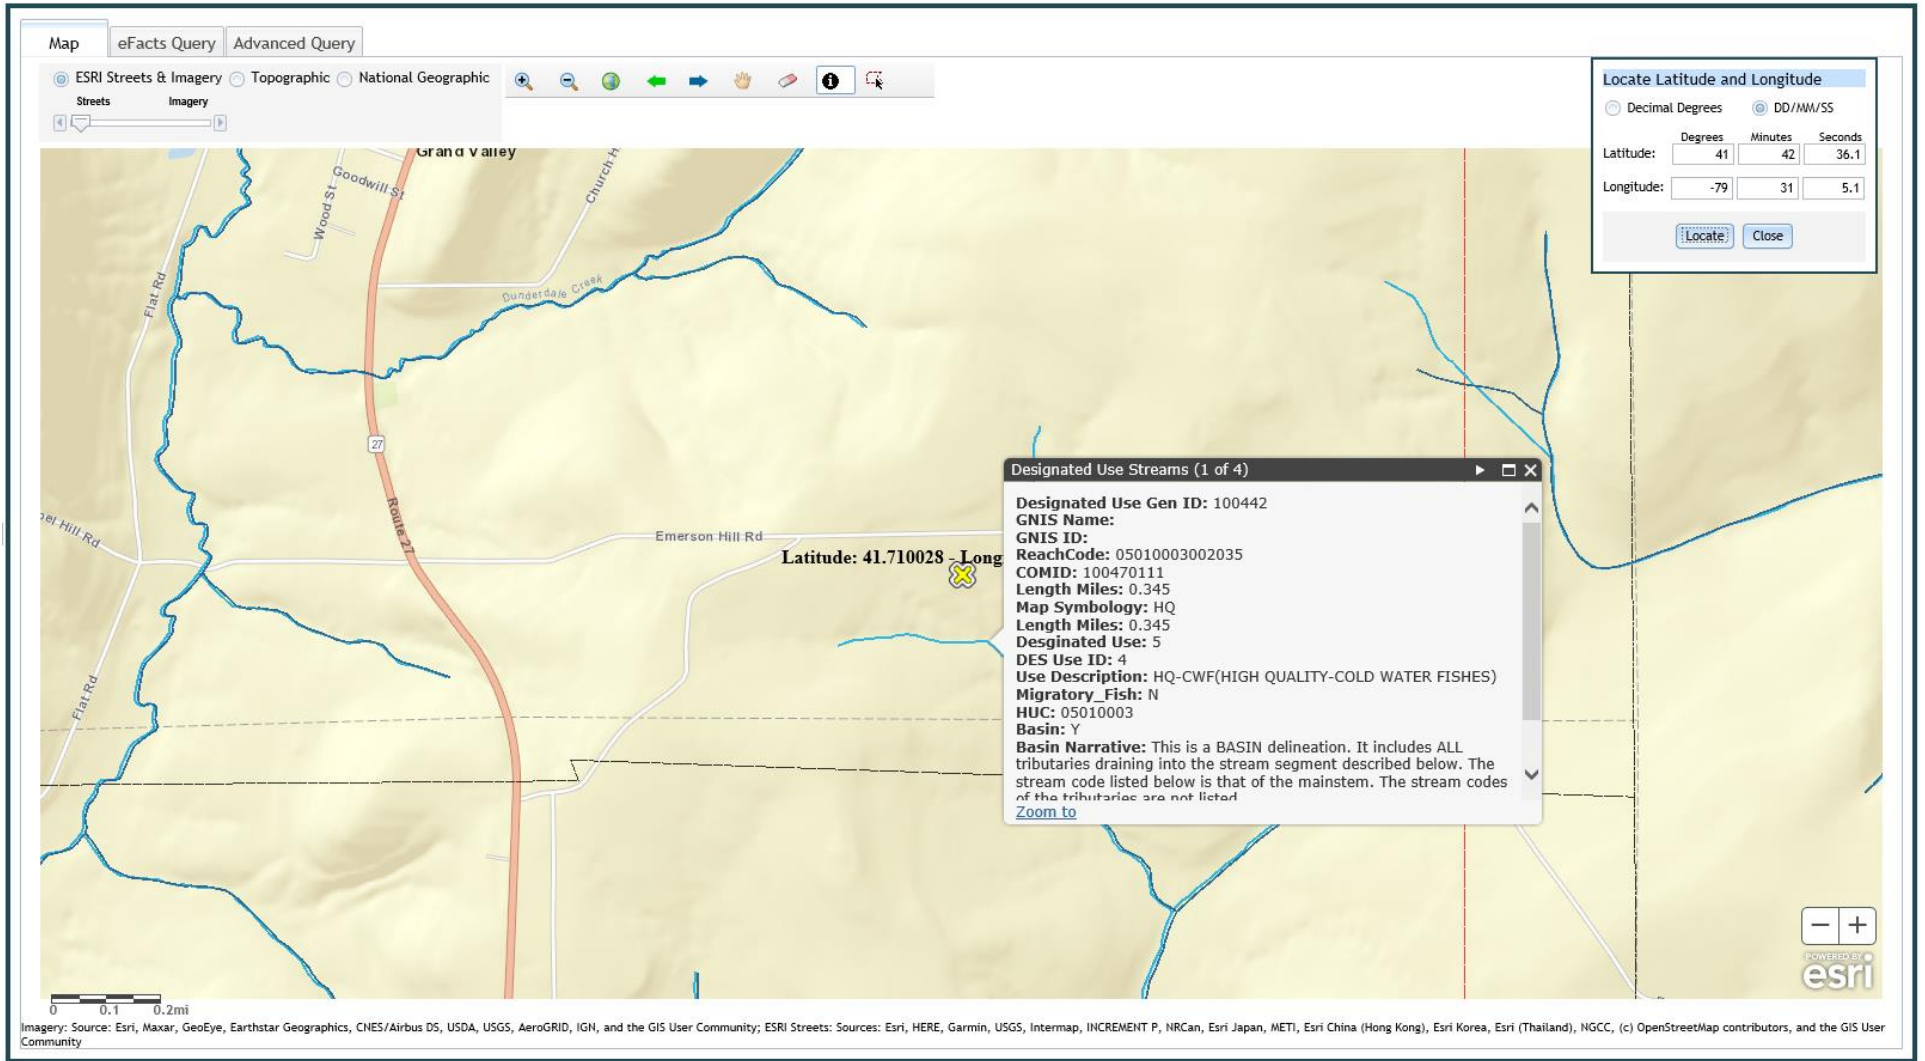

**Attachment 2**  
**Google Earth Imagery**

