

Application Type New
 Facility Type Non-Municipal
 Major / Minor Minor

**NPDES PERMIT FACT SHEET
INDIVIDUAL SEWAGE**

Application No. PA0294250
 APS ID 1094943
 Authorization ID 1456753

Applicant and Facility Information

Applicant Name	<u>MRPI Amity Hall LLC</u>	Facility Name	<u>Susquehanna Crossings</u>
Applicant Address	<u>509 S Exeter Street Suite 216</u> <u>Baltimore, MD 21202-4365</u>	Facility Address	<u>3300 Block Susquehanna Trail</u> <u>Duncannon, PA 17020</u>
Applicant Contact	<u>Matthew Clymer</u>	Facility Contact	<u>Matthew Clymer</u>
Applicant Phone	<u>(610) 888-6373</u>	Facility Phone	<u>(610) 888-6373</u>
Client ID	<u>377385</u>	Site ID	<u>866562</u>
Ch 94 Load Status	<u>Not Overloaded</u>	Municipality	<u>Watts Township</u>
Connection Status	<u>No Limitations</u>	County	<u>Perry</u>
Date Application Received	<u>September 26, 2023</u>	EPA Waived?	<u>Yes</u>
Date Application Accepted	<u>October 10, 2023</u>	If No, Reason	<u></u>
Purpose of Application	<u>This is an application for a new NPDES/WQM permit</u>		

Approve	Deny	Signatures	Date
X		Nicholas Hong, P.E. / Environmental Engineer Nick Hong (via electronic signature)	May 13, 2024
x		Daniel W. Martin, P.E. / Environmental Engineer Manager Maria D. Bebenek for	May 21, 2024
x		Maria D. Bebenek, P.E. / Environmental Program Manager Maria D. Bebenek	May 21, 2024

Summary of Review

The application submitted by the applicant requests a new NPDES & WQM permit(s) for the MRPI Amity Hall, LLC / Susquehanna Crossing located at 3300 Block Susquehanna Trail, Duncannon, PA 17020 in Perry County, municipality of Watts Township. The application was received by DEP Southcentral Regional Office (SCRO) on September 26, 2023. The processing of the application was delayed due to awaiting the WQM Part II application.

The purpose of this Fact Sheet is to present the basis of information used for establishing the proposed NPDES permit effluent limitations. The Fact Sheet includes a description of the facility, a description of the facility's receiving waters, and a description of the facility's receiving waters attainment/non-attainment assessment status. Section 5 provides the justification for the proposed NPDES effluent limits derived from technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), total maximum daily loading (TMDL), antidegradation, anti-backsliding, and/or whole effluent toxicity (WET). A brief summary of the outlined descriptions has been included in the Summary of Review section.

The subject facility is a 0.05 MGD annual average and hydraulic design flow treatment facility. The NPDES application has been processed as a Minor Sewage (Level 2) due to the type of sewage and the design flow rate for the facility. The applicant disclosed the Act 14 requirement to Perry County Planning Commission and Watts Township Board of Supervisors and the notice was received by the parties on September 5, 2023 and September 13, 2023. A planning approval letter was issued by DEP on August 23, 2023 (DEP Code No. A3-50929-100-3). The planning approval allows for the treatment plant to be sized for 50,000 gpd to accommodate potential future sewage flows.

Utilizing the DEP's web-based Emap-PA information system, the receiving waters has been determined to be the Susquehanna River. The Susquehanna River discharges into the Chesapeake Bay. The subject site is subject to the Chesapeake Bay waste implementation plan requirements. The receiving water has protected water usage for warm water fishes (WWF) and migratory fishes (MF). No Class A Wild Trout fisheries are impacted by this discharge. The absence of high quality and/or exceptional value surface waters removes the need for an additional evaluation of anti-degradation requirements.

The Susquehanna River is a Category 2 and 5 stream listed in the 2024 Integrated List of All Waters (formerly 303d Listed Streams). This stream is an attaining stream that supports recreational uses. The receiving stream is also impaired for fish consumption due to PCBs from an unknown source. The receiving waters is not subject to a local total maximum daily load (TMDL) plan to improve water quality in the subject facility's watershed.

Sludge use and disposal description and location(s): This is a new discharger. Future renewals will detail sludge use and disposal.

The proposed permit will expire five (5) years from the effective date.

Based on the review in this report, it is recommended that the permit be drafted. DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Any additional information or public review of documents associated with the discharge or facility may be available at PA DEP Southcentral Regional Office (SCRO), 909 Elmerton Avenue, Harrisburg, PA 17110. To make an appointment for file review, contact the SCRO File Review Coordinator at 717.705.4700.

1.0 Applicant

1.1 General Information

This fact sheet summarizes PA Department of Environmental Protection's review for the NPDES renewal for the following subject facility.

Facility Name: MRPI Amity Hall, LLC / Susquehanna Crossing

NPDES Permit # PA0294250

Physical Address: 3300 Block Susquehanna Trail
Duncannon, PA 17020

Mailing Address: 509 South Exeter Street
Baltimore, MD 21202

Contact: Matthew Clymer
Owner
mclymer@mrpindustrial.com

Consultant: Max Stoner, PE
Glace Associates, Inc.
max@glaceeng.com
(717) 731-1579

1.2 Permit History

MRPI Amity Hall, LLC is proposing to construct two (2) warehouse/distribution center facilities totaling approximately 1.9 M sq. ft. on their property in Watts Township, Perry County. The industrial development referred to as Susquehanna Crossings, is to be located northeast of the Routes 22/322 West on-ramp off US-15 S in the Township. The development is projected to initially generate 30,000 gpd of domestic wastewater flow. The number of EDUs projected for the development is 75 and is based on 400 gpd per EDU. A package sewage treatment facility with a design capacity of 50,000 gpd is proposed to be constructed to serve the warehouse facilities.

Treated effluent from the package plant will be discharged to the Susquehanna River. The LPSS main will be directionally drilled under Rte. 15 to Tract 20-C, owned by MRPI Amity Hall, LLC. The treated effluent line will be pumped until reaching the discharge point. The proposed development encompasses 297± acres.

Due to topography, the warehouses to be located west of Taylor Road will convey flow via LPSS to the proposed package plant to be located southeast of Routes 11 & 15 (Susquehanna Trail) and northwest of Old Trail Road. The plant site is located outside the floodplain of the Susquehanna River.

Tracts 19-B and 20-A east of Taylor Road are also owned by MRPI Amity Hall, LLC. Combined, these tracts occupy 157.4 acres of land zoned as agricultural/rural within Watts Township. The developer also owns Tracts 20-B and 20-C southeast of Rte. 15. Both parcels are zoned commercial though Tract 20-C lies within the floodplain. Tract 20-B is approximately 2 acres while 20-C is 26 acres. Any of these 4 parcels could be developed in the future. With a treatment plant capacity of 50,000 gpd and proposed flow of 30,000 gpd from Susquehanna Crossings, there will be ample capacity remaining for future development or should there be a greater usage within either of the two warehouses or possible failures of onlot septic systems or small flow treatment facilities on adjacent properties.

Permit submittal included the following information.

- NPDES Application

2.0 Treatment Facility Summary

2.1.1 Site location

The physical address for the facility is 3300 Block Susquehanna Trail, Duncannon, PA 17020. A topographical and an aerial photograph of the facility are depicted as Figure 1 and Figure 2.

Figure 1: Topographical map of the subject facility

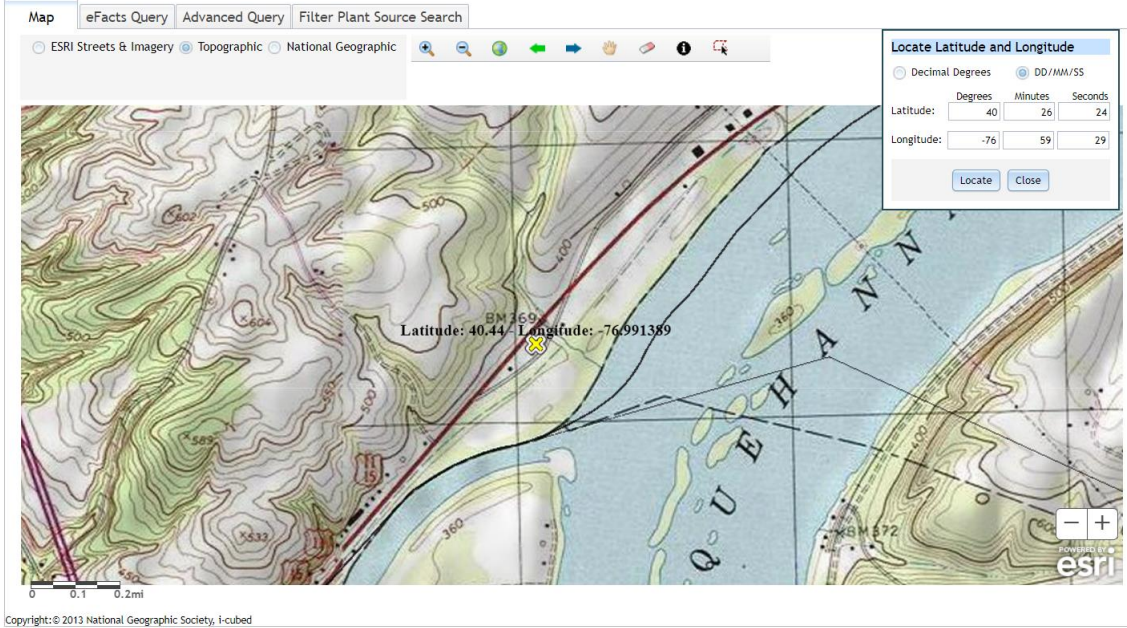


Figure 2: Aerial Photograph of the subject facility


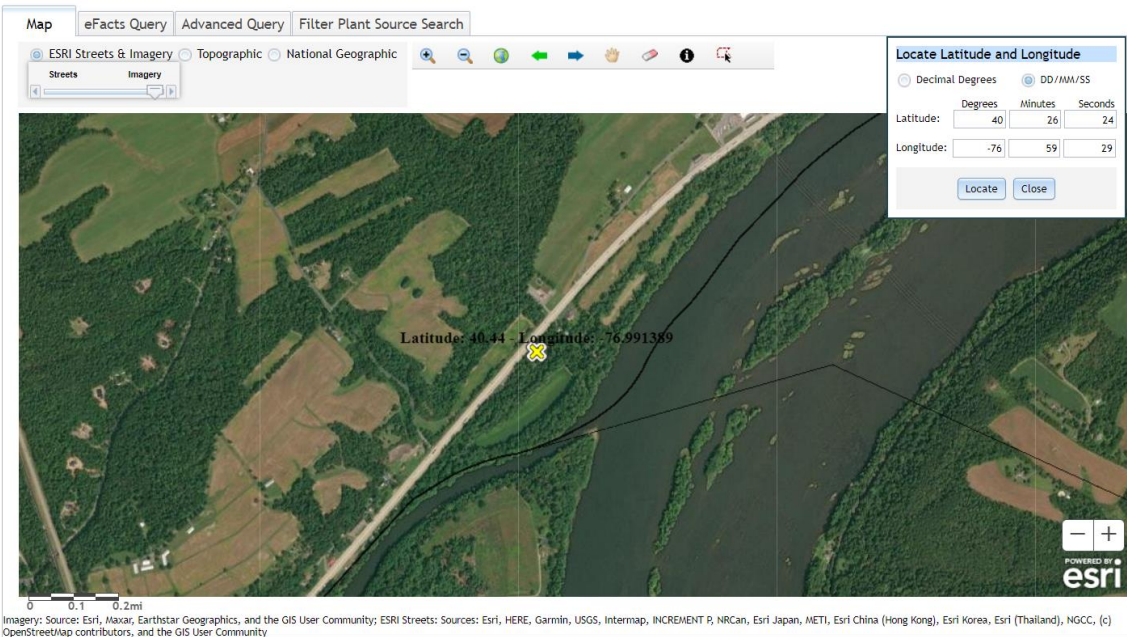


Figure 3- Site Map

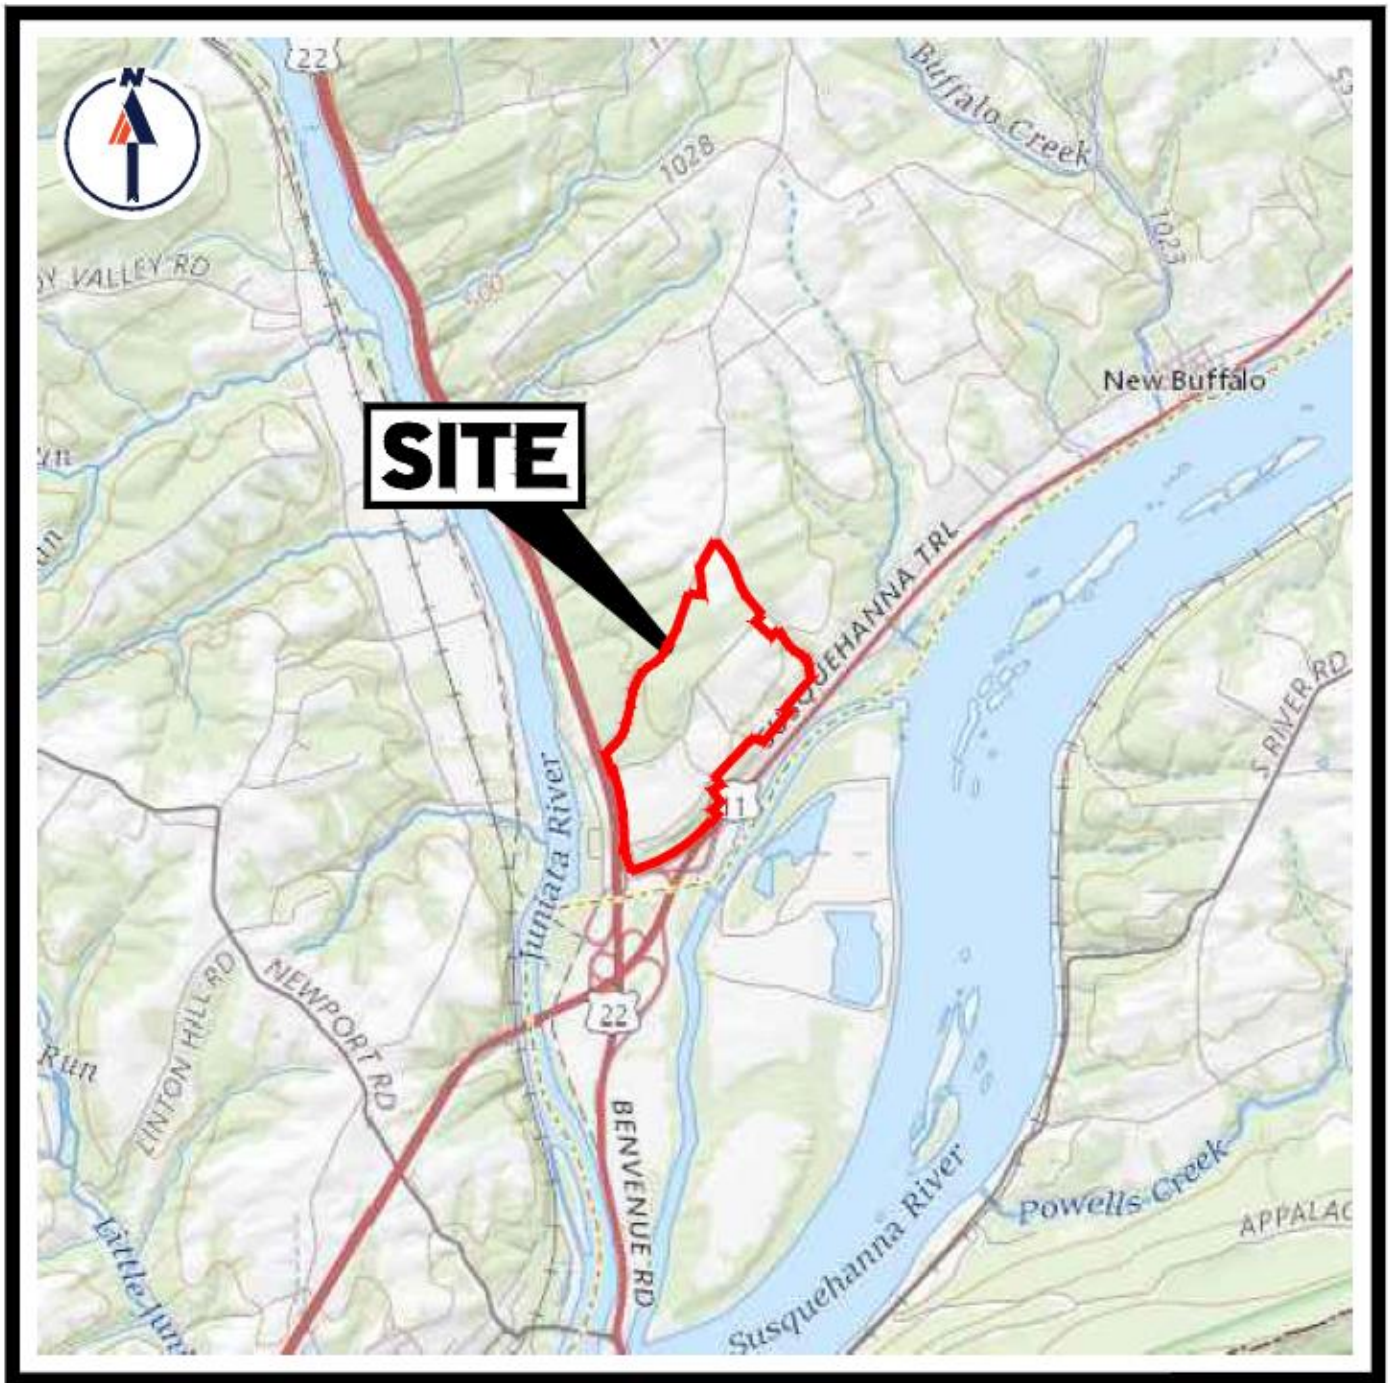

U.S.G.S. MAP

SCALE: 1" = 5,280' (1 MILE)
SOURCE: NEW BLOOM FIELD, PA AND HARRISBURG PA QUADS
(US GEOLOGICAL SURVEY)

2.2 Description of Wastewater Treatment Process

The subject facility is a 0.05 MGD annual average design flow facility. The subject facility treats wastewater using an equalization basin, a Dutchland biological reactor / future anoxic tank, a clarifier, a UV disinfection unit, and a post aeration unit prior to discharge through the outfall to the Susquehanna River. The facility will also have a sludge holding tank.

The treatment process is summarized in the table.

Treatment Facility Summary				
Treatment Facility Name: Mrpi Amity Hall LLC / Susquehanna Crossing				
WQM Permit No.	Issuance Date			
5024401	TBD			
Waste Type	Degree of Treatment	Process Type	Disinfection	Avg Annual Flow (MGD)
Sewage	Secondary	Extended Aeration	Ultraviolet	0.05
Hydraulic Capacity (MGD)	Organic Capacity (lbs/day)	Load Status	Biosolids Treatment	Biosolids Use/Disposal
0.05		Not Overloaded		

2.3 Facility Outfall Information

The facility has the following outfall information for wastewater.

Outfall No.	001	Design Flow (MGD)	.05
Latitude	40° 26' 24.00"	Longitude	-76° 59' 29.00"
Wastewater Description: Sewage Effluent			

The subject facility outfall is within the vicinity of another sewage/wastewater outfall. The downstream outfalls are Stardust Motel (PA0086941), LTD Ranch House (PA0083984), Sheetz (PA0261378), Pilot Travel (PA0084115) and Plaza Mgmt (PA0246867) which are all within 2 miles from the subject facility.

2.3.1 Operational Considerations- Chemical Additives

Chemical additives are chemical products introduced into a waste stream that is used for cleaning, disinfecting, or maintenance and which may be detected in effluent discharged to waters of the Commonwealth. Chemicals excluded are those used for neutralization of waste streams, the production of goods, and treatment of wastewater.

The subject facility utilizes the following chemicals as part of their treatment process.

- The facility does not anticipate any wastewater chemicals.
- The WQM did indicate chlorine tablets will be used as a backup disinfection to the UV unit.

3.0 Receiving Waters and Water Supply Information Detail Summary

3.1 Receiving Waters

The receiving waters has been determined to be Susquehanna River. The Susquehanna River discharges into the Chesapeake Bay.

3.2 Public Water Supply (PWS) Intake

The closest PWS to the subject facility is Suez Water (PWS ID #7220015) located approximately 12 miles downstream of the subject facility on the Susquehanna River. Based upon the distance and the flow rate of the facility, the PWS should not be impacted.

3.3 Class A Wild Trout Streams

Class A Wild Trout Streams are waters that support a population of naturally produced trout of sufficient size and abundance to support long-term and rewarding sport fishery. DEP classifies these waters as high-quality coldwater fisheries.

The information obtained from EMAP suggests that no Class A Wild Trout Fishery will be impacted by this discharge.

3.4 2024 Integrated List of All Waters (303d Listed Streams)

Section 303(d) of the Clean Water Act requires States to list all impaired surface waters not supporting uses even after appropriate and required water pollution control technologies have been applied. The 303(d) list includes the reason for impairment which may be one or more point sources (i.e. industrial or sewage discharges) or non-point sources (i.e. abandoned mine lands or agricultural runoff and the pollutant causing the impairment such as metals, pH, mercury or siltation).

States or the U.S. Environmental Protection Agency (EPA) must determine the conditions that would return the water to a condition that meets water quality standards. As a follow-up to listing, the state or EPA must develop a Total Maximum Daily Load (TMDL) for each waterbody on the list. A TMDL identifies allowable pollutant loads to a waterbody from both point and non-point sources that will prevent a violation of water quality standards. A TMDL also includes a margin of safety to ensure protection of the water.

The water quality status of Pennsylvania's waters uses a five-part categorization (lists) of waters per their attainment use status. The categories represent varying levels of attainment, ranging from Category 1, where all designated water uses are met to Category 5 where impairment by pollutants requires a TMDL for water quality protection.

The receiving waters is listed in the 2024 Pennsylvania Integrated Water Quality Monitoring and Assessment Report as a Category 2 and 5 waterbody. The surface waters is an attaining stream for recreational uses. The receiving stream is also impaired for fish consumption due to PCBs from an unknown source. The designated use has been classified as protected waters for warm water fishes (WWF) and migratory fishes (MF).

3.5 Low Flow Stream Conditions

Water quality modeling estimates are based upon conservative data inputs. The data are typically estimated using either a stream gauge or through USGS web based StreamStats program. The NPDES effluent limits are based upon the combined flows from both the stream and the facility discharge.

A conservative approach to estimate the impact of the facility discharge using values which minimize the total combined volume of the stream and the facility discharge. The volumetric flow rate for the stream is based upon the seven-day, 10-year low flow (Q710) which is the lowest estimated flow rate of the stream during a 7 consecutive day period that occurs once in 10 -year time period. The facility discharge is based upon a known design capacity of the subject facility.

The closest WQN station to the subject facility is the Susquehanna River @ Harrisburg, PA (WQN202). This WQN station is located approximately 18 miles downstream of the subject facility.

The closest gauge station to the subject facility is the Susquehanna River at Harrisburg, PA (USGS station number 1570500). This gauge station is located approximately 18 miles downstream of the subject facility.

For WQM modeling, pH and stream water temperature data from the water quality network station was used. pH was estimated to be 8.25 and the stream water temperature was estimated to be 23.75 C.

The hardness of the stream was estimated from the water quality network to be 109 mg/l CaCO₃.

The Q710 for the facility was estimated by factoring in the stream flow to the west of Haldeman Island. The Susquehanna River flows south with approximately 15% of the flow going around Haldeman Island. The drainage area for the modeling points were multiplied by a factor of 15%. The drainage areas and modeling nodes are found in Section 4.3. Modeling point #A is a point upstream of Haldeman Island. Other modeling points are downstream of the subject facility.

Gauge Station Data		
USGS Station Number	1570500	
Station Name	Susquehanna River at Harrisburg, PA	
Q710	3,200	ft ³ /sec
Drainage Area (DA)	24,100	mi ²
Calculations		
The low flow yield of the gauge station is:		
Low Flow Yield (LFY) = Q710 / DA		
LFY = (3,200 ft ³ /sec / 24,100 mi ²)		
LFY =	0.1328	ft ³ /sec/mi ²
The low flow at the subject site is based upon the DA of		
	19700	mi ²
Note: the drainage area incorporates a 15% factor for flow on the west side of island.		
Q710 = (LFY@gauge station)(DA@Subject Site)(15% factor for west side of island)		
Q710 =	392.365	ft ³ /sec

3.6 Summary of Discharge, Receiving Waters and Water Supply Information

Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.05</u>
Latitude	<u>40° 26' 25.41"</u>	Longitude	<u>-76° 59' 26.56"</u>
Quad Name	<u></u>	Quad Code	<u></u>
Wastewater Description: <u>Sewage Effluent</u>			

Receiving Waters	<u>Susquehanna River (WWF, MF)</u>	Stream Code	<u>6685</u>
NHD Com ID	<u>54975137</u>	RMI	<u>87.69</u>
Drainage Area	<u>2955</u>	Yield (cfs/mi ²)	<u>0.1328</u>
Q ₇₋₁₀ Flow (cfs)	<u>392.365</u>	Q ₇₋₁₀ Basis	<u>StreamGauge</u>
Elevation (ft)	<u>344</u>	Slope (ft/ft)	<u></u>
Watershed No.	<u>6-C</u>	Chapter 93 Class.	<u>WWF, MF</u>
Existing Use	<u></u>	Existing Use Qualifier	<u></u>
Exceptions to Use	<u></u>	Exceptions to Criteria	<u></u>
Assessment Status	<u>Not Assessed</u>		
Cause(s) of Impairment	<u>Not appl.</u>		
Source(s) of Impairment	<u>Not appl.</u>		
TMDL Status	<u>Not appl.</u>	Name	<u></u>

Background/Ambient Data		Data Source	
pH (SU)	<u>8.25</u>	WQN202; median July to Sept	<u></u>
Temperature (°C)	<u>23.75</u>	WQN202; median July to Sept	<u></u>
Hardness (mg/L)	<u>109</u>	WQN202; historical median	<u></u>
Other:	<u></u>		<u></u>

Nearest Downstream Public Water Supply Intake	<u>Susquehanna River at Harrisburg, PA</u>		
PWS Waters	<u>Susquehanna River</u>	Flow at Intake (cfs)	<u></u>
PWS RMI	<u></u>	Distance from Outfall (mi)	<u>18</u>

4.0: Overview of Presiding Water Quality Standards

4.1 General

There are at least six (6) different policies which determines the effluent performance limits for the NPDES permit. The policies are technology based effluent limits (TBEL), water quality based effluent limits (WQBEL), antidegradation, total maximum daily loading (TMDL), anti-backsliding, and whole effluent toxicity (WET) The effluent performance limitations enforced are the selected permit limits that is most protective to the designated use of the receiving waters. An overview of each of the policies that are applicable to the subject facility has been presented in Section 6.

4.2.1 Technology-Based Limitations

TBEL treatment requirements under section 301(b) of the Act represent the minimum level of control that must be imposed in a permit issued under section 402 of the Act (40 CFR 125.3). Available TBEL requirements for the state of Pennsylvania are itemized in PA Code 25, Chapter 92a.47.

The presiding sources for the basis for the effluent limitations are governed by either federal or state regulation. The reference sources for each of the parameters is itemized in the tables. The following technology-based limitations apply, subject to water quality analysis and best professional judgement (BPJ) where applicable:

Parameter	Limit (mg/l)	SBC	Federal Regulation	State Regulation
CBOD ₅	25	Average Monthly	133.102(a)(4)(i)	92a.47(a)(1)
	40	Average Weekly	133.102(a)(4)(ii)	92a.47(a)(2)
Total Suspended Solids	30	Average Monthly	133.102(b)(1)	92a.47(a)(1)
	45	Average Weekly	133.102(b)(2)	92a.47(a)(2)
pH	6.0 – 9.0 S.U.	Min – Max	133.102(c)	95.2(1)
Fecal Coliform (5/1 – 9/30)	200 / 100 ml	Geo Mean	-	92a.47(a)(4)
Fecal Coliform (5/1 – 9/30)	1,000 / 100 ml	IMAX	-	92a.47(a)(4)
Fecal Coliform (10/1 – 4/30)	2,000 / 100 ml	Geo Mean	-	92a.47(a)(5)
Fecal Coliform (10/1 – 4/30)	10,000 / 100 ml	IMAX	-	92a.47(a)(5)
Total Residual Chlorine	0.5	Average Monthly	-	92a.48(b)(2)

4.3 Water Quality-Based Limitations

WQBEL are based on the need to attain or maintain the water quality criteria and to assure protection of designated and existing uses (PA Code 25, Chapter 92a.2). The subject facility that is typically enforced is the more stringent limit of either the TBEL or the WQBEL.

Determination of WQBEL is calculated by spreadsheet analysis or by a computer modeling program developed by DEP. DEP permit engineers utilize the following computing programs for WQBEL permit limitations: (1) MS Excel worksheet for Total Residual Chlorine (TRC); (2) WQM 7.0 for Windows Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen Version 1.1 (WQM Model) and (3) Toxics using DEP Toxics Management Spreadsheet for Toxics pollutants.

The modeling point nodes utilized for this facility are summarized below.

General Data 1	(Modeling Point #1) / MRPI Amity	(Modeling Point #2) / Stardust Motel	(Modeling Point #3) / LTD Ranch House	(Modeling Point #4) / Sheetz	(Modeling Point #5) / Pilot Travel	(Modeling Point #6) / Plaza Managemen	(Modeling Point #A)	Units
Stream Code	6685	6685	6685	6685	6685	6685	6685	
River Mile Index	87.69	87.44	87.14	85.56	85.26	85.1	88.77	miles
Elevation	344	343.67	343.1	337.75	337.29	337.06	345.93	feet
Latitude	40.436111	40.433955	40.430264	40.408602	40.404387	40.402295	40.44499	
Longitude	-76.994444	-76.998371	-77.001504	-77.007855	-77.008799	-77.010001	-76.97305	
Drainage Area	2955	2956	2957	2958	2959	2960	19700	sq miles
Low Flow Yield	0.1328	0.1328	0.1328	0.1328	0.1328	0.1328	0.1328	cfs/sq mile

4.3.1 Water Quality Modeling 7.0

The WQM Model is a computer model that is used to determine NPDES discharge effluent limitations for Carbonaceous BOD (CBOD5), Ammonia Nitrogen (NH3-N), and Dissolved Oxygen (DO) for single and multiple point source discharges scenarios. WQM Model is a complete-mix model which means that the discharge flow and the stream flow are assumed to instantly and completely mixed at the discharge node.

WQM recommends effluent limits for DO, CBOD5, and NH₃-N in mg/l for the discharge(s) in the simulation.

Four types of limits may be recommended. The limits are

- (a) a minimum concentration for DO in the discharge as 30-day average;
- (b) a 30-day average concentration for CBOD5 in the discharge;
- (c) a 30-day average concentration for the NH₃-N in the discharge;
- (d) 24-hour average concentration for NH₃-N in the discharge.

The WQM Model requires several input values for calculating output values. The source of data originates from either EMAP, the National Map, or Stream Stats. Data for stream gauge information, if any, was abstracted from USGS Low-Flow, Base-Flow, and Mean-Flow Regression Equations for Pennsylvania Streams authored by Marla H. Stuckey (Scientific Investigations Report 2006-5130).

The applicable WQM Effluent Limit Type are discussed in Section 6 under the corresponding parameter which is either DO, CBOD, or ammonia-nitrogen.

4.3.2 Toxics Modeling

Since the design flow rate does not exceed 0.10 MGD, the facility is not subject to Toxics Modeling.

4.3.3 Whole Effluent Toxicity (WET)

The facility is not subject to WET.

4.4 Total Maximum Daily Loading (TMDL)

4.4.1 TMDL

The goal of the Clean Water Act (CWA), which governs water pollution, is to ensure that all of the Nation's waters are clean and healthy enough to support aquatic life and recreation. To achieve this goal, the CWA created programs designed to regulate and reduce the amount of pollution entering United States waters. Section 303(d) of the CWA requires states to assess their waterbodies to identify those not meeting water quality standards. If a waterbody is not meeting standards, it is listed as impaired and reported to the U.S. Environmental Protection Agency. The state then develops a plan to clean up the impaired waterbody. This plan includes the development of a Total Maximum Daily Load (TMDL) for the pollutant(s) that

were found to be the cause of the water quality violations. A Total Maximum Daily Load (TMDL) calculates the maximum amount of a specific pollutant that a waterbody can receive and still meet water quality standards.

A TMDL for a given pollutant and waterbody is composed of the sum of individual wasteload allocations (WLAs) for point sources and load allocations (LAs) for nonpoint sources and natural background levels. In addition, the TMDL must include an implicit or explicit margin of safety (MOS) to account for the uncertainty in the relationship between pollutant loads and the quality of the receiving waterbody. The TMDL components are illustrated using the following equation:

$$TMDL = \sum WLAs + \sum LAs + MOS$$

Pennsylvania has committed to restoring all impaired waters by developing TMDLs and TMDL alternatives for all impaired waterbodies. The TMDL serves as the starting point or planning tool for restoring water quality.

4.4.1.1 Local TMDL

The subject facility does not discharge into a local TMDL.

4.4.1.2 Chesapeake Bay TMDL Requirement

The Chesapeake Bay Watershed is a large ecosystem that encompasses approximately 64,000 square miles in Maryland, Delaware, Virginia, West Virginia, Pennsylvania, New York and the District of Columbia. An ecosystem is composed of interrelated parts that interact with each other to form a whole. All of the plants and animals in an ecosystem depend on each other in some way. Every living thing needs a healthy ecosystem to survive. Human activities affect the Chesapeake Bay ecosystem by adding pollution, using resources and changing the character of the land.

Most of the Chesapeake Bay and many of its tidal tributaries have been listed as impaired under Section 303(d) of the federal Water Pollution Control Act ("Clean Water Act"), 33 U.S.C. § 1313(d). While the Chesapeake Bay is outside the boundaries of Pennsylvania, more than half of the State lies within the watershed. Two major rivers in Pennsylvania are part of the Chesapeake Bay Watershed. They are (a) the Susquehanna River and (b) the Potomac River. These two rivers total 40 percent of the entire Chesapeake Bay watershed.

The overall management approach needed for reducing nitrogen, phosphorus and sediment are provided in the Bay TMDL document and the Phase I, II, and III WIPs which is described in the Bay TMDL document and Executive Order 13508.

The Bay TMDL is a comprehensive pollution reduction effort in the Chesapeake Bay watershed identifying the necessary pollution reductions of nitrogen, phosphorus and sediment across the seven Bay watershed jurisdictions of Delaware, Maryland, New York, Pennsylvania, Virginia, West Virginia and the District of Columbia to meet applicable water quality standards in the Bay and its tidal waters.

The Watershed Implementation Plans (WIPs) provides objectives for how the jurisdictions in partnership with federal and local governments will achieve the Bay TMDL's nutrient and sediment allocations.

Phase 3 WIP provides an update on Chesapeake Bay TMDL implementation activities for point sources and DEP's current implementation strategy for wastewater. The latest revision of the supplement was September 13, 2021.

The Chesapeake Bay TMDL (Appendix Q) categorizes point sources into four sectors:

- Sector A- significant sewage dischargers;
- Sector B- significant industrial waste (IW) dischargers;
- Sector C- non-significant dischargers (both sewage and IW facilities); and
- Sector D- combined sewer overflows (CSOs).

All sectors contain a listing of individual facilities with NPDES permits that were believed to be discharging at the time the TMDL was published (2010). All sectors with the exception of the non-significant dischargers have individual wasteload allocations (WLAs) for TN and TP assigned to specific facilities. Non-significant dischargers have a bulk or aggregate allocation for TN and TP based on the facilities in that sector that were believed to be discharging at that time and their estimated nutrient loads.

Cap Loads will be established in permits as Net Annual TN and TP loads (lbs/yr) that apply during the period of October 1 – September 30. For facilities that have received Cap Loads in any other form, the Cap Loads will be modified accordingly when the permits are renewed.

Offsets have been incorporated into Cap Loads in several permits issued to date. From this point forward, permits will be issued with the WLAs as Cap Loads and will identify Offsets separately to facilitate nutrient trading activities and compliance with the TMDL.

Based upon the supplement the subject facility has been categorized as a Sector C discharger. The supplement defines Sector C as a non-significant dischargers include sewage facilities (Phase 4 facilities: ≥ 0.2 MGD and < 0.4 MGD and Phase 5 facilities: > 0.002 MGD and < 0.2 MGD), small flow/single residence sewage treatment facilities (≤ 0.002 MGD), and non-significant IW facilities, all of which may be covered by statewide General Permits or may have individual NPDES permits.

At this time, there are approximately 850 Phase 4 and 5 sewage facilities, approximately 715 small flow sewage treatment facilities covered by a statewide General Permit, and approximately 300 non-significant IW facilities.

For Phase 5 sewage facilities with individual permits (average annual design flow on August 29, 2005 > 0.002 MGD and < 0.2 MGD), DEP will issue individual permits with monitoring and reporting for TN and TP throughout the permit term at a frequency no less than annually, unless 1) the facility has already conducted at least two years of nutrient monitoring and 2) a summary of the monitoring results are included in the next permit's fact sheet. If, however, Phase 5 facilities choose to expand, the renewed or amended permits will contain Cap Loads based on the lesser of a) existing TN/TP concentrations at current design average annual flow or b) 7,306 lbs/yr TN and 974 lbs/yr TP.

If no data are available to determine existing concentrations for expanding Phase 4 or 5 facilities, default concentrations of 25 mg/l TN and 4 mg/l TP may be used (these are the average estimated concentrations of all non-significant sewage facilities).

DEP will not issue permits to existing Phase 4 and 5 facilities containing Cap Loads unless it is done on a broad scale or unless the facilities are expanding.

For new Phase 4 and 5 sewage discharges, in general DEP will issue new permits containing Cap Loads of "0" and new facilities will be expected to purchase credits and/or apply offsets to achieve compliance, with the exception of small flow and single residence facilities.

The facility is a new Phase 5 sewage discharger. The permit shall limit the cap load to "0" for both total nitrogen and phosphorus. This facility is subject to Sector C monitoring requirements. Monitoring for nitrogen and phosphorus shall be at least 2x/month.

Reporting

Cap Loads will be established in permits as Net Annual TN and TP loads (lbs/yr) that apply during the period of October 1 – September 30.

Facilities with NPDES permits must use DEP's eDMR system for reporting, except small flow treatment facilities. An Annual DMR must be submitted by the end of the Truing Period, November 28. As attachments to the Annual DMR a facility must submit a completed Annual Chesapeake Bay Spreadsheet, available through DEP's Supplemental Reports website, which contains an Annual Nutrient Monitoring worksheet and an Annual Nutrient Budget worksheet. This Spreadsheet will be submitted once per Compliance Year only, and reflect all nutrient sample results (for the period October 1 – September 30), Credit transactions (including the Truing Period) and Offsets applied during the Compliance Year.

4.5 Anti-Degradation Requirement

Chapter 93.4a of the PA regulations requires that surface water of the Commonwealth of Pennsylvania may not be degraded below levels that protect the existing uses. The regulations specifically state that *Existing instream water uses and the level of water quality necessary to protect the existing uses shall be maintained and protected*. Antidegradation requirements are implemented through DEP's guidance manual entitled Water Quality Antidegradation Implementation Guidance (Document #391-0300-02).

The policy requires DEP to protect the existing uses of all surface waters and the existing quality of High Quality (HQ) and Exceptional Value (EV) Waters. Existing uses are protected when DEP makes a final decision on any permit or approval for an activity that may affect a protected use. Existing uses are protected based upon DEP's evaluation of the best available information (which satisfies DEP protocols and Quality Assurance/Quality Control (QA/QC) procedures) that indicates the protected use of the waterbody.

For a new, additional, or increased point source discharge to an HQ or EV water, the person proposing the discharge is required to utilize a nondischarge alternative that is cost-effective and environmentally sound when compared with the cost of the proposed discharge. If a nondischarge alternative is not cost-effective and environmentally sound, the person must use the best available combination of treatment, pollution prevention, and wastewater reuse technologies and assure that any discharge is nondegrading. In the case of HQ waters, DEP may find that after satisfaction of intergovernmental coordination and public participation requirements lower water quality is necessary to accommodate important economic or social development in the area in which the waters are located. In addition, DEP will assure that cost-effective and reasonable best management practices for nonpoint source control in HQ and EV waters are achieved.

The subject facility's discharge will be to a non-special protection waters and the permit conditions are imposed to protect existing instream water quality and uses. Neither HQ waters or EV waters is impacted by this discharge.

4.6 Anti-Backsliding

Anti-backsliding is a federal regulation which prohibits a permit from being renewed, reissued, or modified containing effluent limitations which are less stringent than the comparable effluent limitations in the previous permit (40 CFR 122.1.1 and 40 CFR 122.1.2).

This is a new discharger. Future renewals may be subject to anti-backsliding.

5.0 NPDES Parameter Details

The basis for the proposed sampling and their monitoring frequency that will appear in the permit for each individual parameter are itemized in this Section. The final limits are the more stringent of technology based effluent treatment (TBEL) requirements, water quality based (WQBEL) limits, TMDL, antidegradation, anti-degradation, or WET.

The reader will find in this section:

- a) a justification of recommended permit monitoring requirements and limitations for each parameter in the proposed NPDES permit; and
- b) a summary of the proposed NPDES effluent limits.

5.1 Recommended Monitoring Requirements and Effluent Limitations

A summary of the recommended monitoring requirements and effluent limitations are itemized in the tables. The tables are categorized by (a) Conventional Pollutants and Disinfection, (b) Nitrogen Species and Phosphorus, and (c) Chapter 92a.61 targeted parameters.

5.1.1 Conventional Pollutants and Disinfection

The facility uses UV disinfection as primary and chlorine disinfection as backup.

Summary of Proposed NPDES Parameter Details for Conventional Pollutants and Disinfection			
MRPI Amity Hall, PA0294250			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
pH (S.U.)	TBEL	Monitoring:	The monitoring frequency shall be daily as a grab sample (Table 6-3).
		Effluent Limit:	Effluent limits may range from pH = 6.0 to 9.0
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 95.2(1).
Dissolved Oxygen	BPJ	Monitoring:	The monitoring frequency shall be daily as a grab sample (Table 6-3).
		Effluent Limit:	Effluent limits shall be greater than 5.0 mg/l.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by best professional judgement.
CBOD	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as grab sample (Table 6-3).
		Effluent Limit:	Effluent limits shall not exceed 25 mg/l as an average monthly.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(1). WQM modeling indicates that the TBEL is more stringent than the WQBEL. Thus, the permit limit is confined to TBEL.
TSS	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as grab sample (Table 6-3).
		Effluent Limit:	Effluent limits shall not exceed 30 mg/l as an average monthly.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(1). While there is no WQM modeling for this parameter, the permit limit for TSS is generally assigned similar effluent limits as CBOD or BOD.
TRC	TBEL	Monitoring:	The monitoring frequency shall be on a daily basis as a grab sample when discharging
		Effluent Limit:	The average monthly limit should not exceed 0.500 mg/l and/or 1.635 mg/l as an instantaneous maximum.
		Rationale:	Chlorine in both combined (chloramine) and free form is extremely toxic to freshwater fish and other forms of aquatic life (Implementation Guidance Total Residual Chlorine 1). The TRC effluent limitations to be imposed on a discharger shall be the more stringent of either the WQBEL or TBEL requirements and shall be expressed in the NPDES permit as an average monthly and instantaneous maximum effluent concentration (Implementation Guidance Total Residual Chlorine 4). Based on the stream flow rate (lowest 7-day flow rate in 10 years) and the design flow rate of the subject facility calculated by the TRC Evaluation worksheet, the TBEL is more stringent than the WQBEL. The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.48(b)(2). The facility uses UV disinfection as primary and chlorine disinfection as backup.
UV disinfection	SOP	Monitoring:	The monitoring frequency is 1/day. The facility will be required to recording the UV intensity.
		Effluent Limit:	No effluent requirements
		Rationale:	Consistent with the SOP- Establishing Effluent Limitations for Individual Sewage Permits (Revised January 10, 2019), the facility will be required to have routine monitoring for UV transmittance, UV dosage, or UV intensity.
Fecal Coliform	TBEL	Monitoring:	The monitoring frequency shall be 2x/month as a grab sample (Table 6-3).
		Effluent Limit:	Summer effluent limits shall not exceed 200 No./100 mL as a geometric mean. Winter effluent limits shall not exceed 2000 No./100 mL as a geometric mean.
		Rationale:	The monitoring frequency has been assigned in accordance with Table 6-3 and the effluent limits assigned by Chapter 92a.47(a)(4) and 92a.47(a)(5).

Notes:

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other

2 Monitoring frequency based on flow rate of 0.05 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

5.1.2 Nitrogen Species and Phosphorus

Summary of Proposed NPDES Parameter Details for Nitrogen Species and Phosphorus			
MRPI Amity Hall, PA0294250			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
Ammonia-Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/mo as a grab sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/mo.
Nitrate-Nitrite as N	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/mo as a grab sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/mo.
Total Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/mo as a calculation
		Effluent Limit:	Effluent limits shall not exceed 25 mg/l as an average monthly.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/month.
TKN	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/mo as a grab sample
		Effluent Limit:	No effluent requirements.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/mo.
Total Phosphorus	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 2x/mo as a grab sample
		Effluent Limit:	Effluent limits shall not exceed 4 mg/l as an average monthly.
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 2x/mo.
Net Total Nitrogen	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/yr as a calculation
		Effluent Limit:	A cap load of 0 lbs/yr
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr.
Net Total Phosphorus	Chesapeake Bay TMDL	Monitoring:	The monitoring frequency shall be 1x/yr as a calculation
		Effluent Limit:	A cap load of 0 lbs/yr
		Rationale:	Due to the Chesapeake Bay Implementation Plan, the facility is required to be monitored on a frequency at least 1x/yr.
Notes:			

1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other

2 Monitoring frequency based on flow rate of 0.05 MGD.

3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits (Document # 362-0400-001) Revised 10/97

4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)

5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021

5.1.3.1 Implementation of Regulation- Chapter 92a.61

Chapter 92a.61 provides provisions to DEP to monitor for pollutants that may have an impact on the quality of waters of the Commonwealth. Based upon DEP policy directives issued on March 22, 2021 and in conjunction with EPA's 2017 Triennial Review, monitoring for E. Coli shall be required.

Summary of Proposed NPDES Parameter Details for pollutants monitored under Chapter 92a.61			
MRPI Amity Hall, PA0294250			
Parameter	Permit Limitation Required by ¹ :	Recommendation	
E. Coli	SOP; Chapter 92a.61	Monitoring:	The monitoring frequency shall be 1x/quarter as a grab sample (SOP).
		Effluent Limit:	No effluent requirements.
		Rationale:	Consistent with the SOP- Establishing Effluent Limitations for Individual Sewage Permits (Revised March 22, 2019) and under the authority of Chapter 92a.61, the facility will be required to monitor for E.Coli.
Notes:			
1 The NPDES permit was limited by (a) anti-Backsliding, (b) Anti-Degradation, (c) SOP, (d) TBEL, (e) TMDL, (f) WQBEL, (g) WET, or (h) Other			
2 Monitoring frequency based on flow rate of 0.05 MGD.			
3 Table 6-3 (Self Monitoring Requirements for Sewage Discharges) in Technical Guidance for the Development and Specification of Effluent Limitations and Other Permit Conditions in NPDES Permits (Document # 362-0400-001) Revised 10/97			
4 Water Quality Antidegradation Implementaton Guidance (Document # 391-0300-002)			
5 Chesapeake Bay Phase 3 Watershed Implementation Plan Wastewater Supplement, Revised September 13, 2021			

5.2.1 Summary of Proposed NPDES Effluent Limits

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the “NPDES Permit Writer’s Manual” (362-0400-001), SOPs and/or BPJ.

The proposed NPDES effluent limitations are summarized in the table below.

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. A. For Outfall 001, Latitude 40° 26' 24.00", Longitude 76° 59' 29.00", River Mile Index 087.69, Stream Code 6685

Receiving Waters: Susquehanna River (WWF, MF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from Permit Effective Date through Permit Expiration Date.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Daily Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Flow (MGD)	Report	Report Daily Max	XXX	XXX	XXX	XXX	Continuous	Measured
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/day	Grab
Dissolved Oxygen	XXX	XXX	5.0 Inst Min	XXX	XXX	XXX	1/day	Grab
Total Residual Chlorine (TRC)	XXX	XXX	XXX	0.50	XXX	1.6	Daily when Discharging	Grab
Carbonaceous Biochemical Oxygen Demand (CBOD5)	Report	Report	XXX	25.0	40.0	XXX	2/month	Grab
Total Suspended Solids	Report	Report	XXX	30.0	45.0	XXX	2/month	Grab
Fecal Coliform (No./100 ml) Oct 1 - Apr 30	XXX	XXX	XXX	2000 Geo Mean	XXX	10000	2/month	Grab
Fecal Coliform (No./100 ml) May 1 - Sep 30	XXX	XXX	XXX	200 Geo Mean	XXX	1000	2/month	Grab
E. Coli (No./100 ml)	XXX	XXX	XXX	XXX	Report Daily Max	XXX	1/quarter	Grab
Ultraviolet light intensity (mW/cm ²)	XXX	XXX	Report	XXX	XXX	XXX	1/day	Grab
Ammonia-Nitrogen	Report	XXX	XXX	Report	XXX	XXX	2/month	Grab

Outfall001, Continued (from Permit Effective Date through Permit Expiration Date)

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Weekly Average	Daily Minimum	Average Monthly	Weekly Average	Instant. Maximum		
Total Phosphorus	Report	XXX	XXX	Report	XXX	XXX	2/month	Grab

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

PART A - EFFLUENT LIMITATIONS, MONITORING, RECORDKEEPING AND REPORTING REQUIREMENTS

I. B. For Outfall 001, Latitude 40° 26' 24.00", Longitude 76° 59' 29.00", River Mile Index 87.69, Stream Code 6685

Receiving Waters: Susquehanna River (WWF, MF)

Type of Effluent: Sewage Effluent

1. The permittee is authorized to discharge during the period from **Permit Effective Date** through **Permit Expiration Date**.
2. Based on the anticipated wastewater characteristics and flows described in the permit application and its supporting documents and/or amendments, the following effluent limitations and monitoring requirements apply (see also Additional Requirements and Footnotes).

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Monthly	Annual	Monthly	Monthly Average	Maximum	Instant. Maximum		
Ammonia-N	Report	Report	XXX	Report	XXX	XXX	2/month	Grab
Kjeldahl-N	Report	XXX	XXX	Report	XXX	XXX	1/month	Grab
Nitrate-Nitrite as N	Report	XXX	XXX	Report	XXX	XXX	1/month	Grab
Total Nitrogen	Report	Report	XXX	Report	XXX	XXX	1/month	Calculation
Total Phosphorus	Report	Report	XXX	Report	XXX	XXX	2/month	Grab
Net Total Nitrogen	XXX	0	XXX	XXX	XXX	XXX	1/year	Calculation
Net Total Phosphorus	XXX	0	XXX	XXX	XXX	XXX	1/year	Calculation

Samples taken in compliance with the monitoring requirements specified above shall be taken at the following location(s):

at Outfall 001

Footnotes:

(1) See Part C for Chesapeake Bay Requirements.

(2) This is the minimum number of sampling events required. Permittees are encouraged, and it may be advantageous in demonstrating compliance, to perform more than the minimum number of sampling events required.

5.2.2 Summary of Proposed Permit Part C Conditions

The subject facility has the following Part C conditions.

- Hauled-in Waste Restrictions
- Chesapeake Bay Nutrient Definitions
- Solids Management for Non-Lagoon Treatment Systems
- UV cleaning

Tools and References Used to Develop Permit	
<input checked="" type="checkbox"/>	WQM for Windows Model (see Attachment [redacted])
<input type="checkbox"/>	Toxics Management Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	TRC Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Temperature Model Spreadsheet (see Attachment [redacted])
<input type="checkbox"/>	Water Quality Toxics Management Strategy, 361-0100-003, 4/06.
<input type="checkbox"/>	Technical Guidance for the Development and Specification of Effluent Limitations, 386-0400-001, 10/97.
<input type="checkbox"/>	Policy for Permitting Surface Water Diversions, 386-2000-019, 3/98.
<input type="checkbox"/>	Policy for Conducting Technical Reviews of Minor NPDES Renewal Applications, 386-2000-018, 11/96.
<input type="checkbox"/>	Technology-Based Control Requirements for Water Treatment Plant Wastes, 386-2183-001, 10/97.
<input type="checkbox"/>	Technical Guidance for Development of NPDES Permit Requirements Steam Electric Industry, 386-2183-002, 12/97.
<input type="checkbox"/>	Pennsylvania CSO Policy, 386-2000-002, 9/08.
<input type="checkbox"/>	Water Quality Antidegradation Implementation Guidance, 391-0300-002, 11/03.
<input type="checkbox"/>	Implementation Guidance Evaluation & Process Thermal Discharge (316(a)) Federal Water Pollution Act, 386-2000-008, 4/97.
<input type="checkbox"/>	Determining Water Quality-Based Effluent Limits, 386-2000-004, 12/97.
<input type="checkbox"/>	Implementation Guidance Design Conditions, 386-2000-007, 9/97.
<input type="checkbox"/>	Technical Reference Guide (TRG) WQM 7.0 for Windows, Wasteload Allocation Program for Dissolved Oxygen and Ammonia Nitrogen, Version 1.0, 386-2000-016, 6/2004.
<input type="checkbox"/>	Interim Method for the Sampling and Analysis of Osmotic Pressure on Streams, Brines, and Industrial Discharges, 386-2000-012, 10/1997.
<input type="checkbox"/>	Implementation Guidance for Section 95.6 Management of Point Source Phosphorus Discharges to Lakes, Ponds, and Impoundments, 386-2000-009, 3/99.
<input type="checkbox"/>	Technical Reference Guide (TRG) PENTOXSD for Windows, PA Single Discharge Wasteload Allocation Program for Toxics, Version 2.0, 386-2000-015, 5/2004.
<input type="checkbox"/>	Implementation Guidance for Section 93.7 Ammonia Criteria, 386-2000-022, 11/97.
<input type="checkbox"/>	Policy and Procedure for Evaluating Wastewater Discharges to Intermittent and Ephemeral Streams, Drainage Channels and Swales, and Storm Sewers, 386-2000-013, 4/2008.
<input type="checkbox"/>	Implementation Guidance Total Residual Chlorine (TRC) Regulation, 386-2000-011, 11/1994.
<input type="checkbox"/>	Implementation Guidance for Temperature Criteria, 386-2000-001, 4/09.
<input type="checkbox"/>	Implementation Guidance for Section 95.9 Phosphorus Discharges to Free Flowing Streams, 386-2000-021, 10/97.
<input type="checkbox"/>	Implementation Guidance for Application of Section 93.5(e) for Potable Water Supply Protection Total Dissolved Solids, Nitrite-Nitrate, Non-Priority Pollutant Phenolics and Fluorides, 386-2000-020, 10/97.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Determining Stream and Point Source Discharge Design Hardness, 386-2000-005, 3/99.
<input type="checkbox"/>	Implementation Guidance for the Determination and Use of Background/Ambient Water Quality in the Determination of Wasteload Allocations and NPDES Effluent Limitations for Toxic Substances, 386-2000-010, 3/1999.
<input type="checkbox"/>	Design Stream Flows, 386-2000-003, 9/98.
<input type="checkbox"/>	Field Data Collection and Evaluation Protocol for Deriving Daily and Hourly Discharge Coefficients of Variation (CV) and Other Discharge Characteristics, 386-2000-006, 10/98.
<input type="checkbox"/>	Evaluations of Phosphorus Discharges to Lakes, Ponds and Impoundments, 386-3200-001, 6/97.
<input type="checkbox"/>	Pennsylvania's Chesapeake Bay Tributary Strategy Implementation Plan for NPDES Permitting, 4/07.
<input checked="" type="checkbox"/>	SOP: New and Reissuance Sewage Individual NPDES Permit Applications, rev 2/3/2022
<input type="checkbox"/>	Other: [redacted]

Attachment A

Stream Stats/Gauge Data

14 Selected Streamflow Statistics for Streamgage Locations in and near Pennsylvania

Table 1. List of U.S. Geological Survey streamgage locations in and near Pennsylvania with updated streamflow statistics.—Continued

[Latitude and Longitude in decimal degrees; mi², square miles]

Streamgage number	Streamgage name	Latitude	Longitude	Drainage area (mi ²)	Regulated ¹
01561000	Brush Creek at Gapsville, Pa.	39.956	-78.254	36.8	N
01562000	Raystown Branch Juniata River at Saxton, Pa.	40.216	-78.265	756	N
01562500	Great Trough Creek near Marklesburg, Pa.	40.350	-78.130	84.6	N
01563200	Raystown Branch Juniata River below Rays Dam nr Huntingdon, Pa.	40.429	-77.991	960	Y
01563500	Juniata River at Mapleton Depot, Pa.	40.392	-77.935	2,030	Y
01564500	Aughwick Creek near Three Springs, Pa.	40.213	-77.925	205	N
01565000	Kishacoquillas Creek at Reedsville, Pa.	40.655	-77.583	164	N
01565700	Little Lost Creek at Oakland Mills, Pa.	40.605	-77.311	6.52	N
01566000	Tuscarora Creek near Port Royal, Pa.	40.515	-77.419	214	N
01566500	Cocolamus Creek near Millerstown, Pa.	40.566	-77.118	57.2	N
01567000	Juniata River at Newport, Pa.	40.478	-77.129	3,354	Y
01567500	Bixler Run near Loysville, Pa.	40.371	-77.402	15.0	N
01568000	Sherman Creek at Shermans Dale, Pa.	40.323	-77.169	207	N
01568500	Clark Creek near Carsonville, Pa.	40.460	-76.751	22.5	LF
01569000	Stony Creek nr Dauphin, Pa.	40.380	-76.907	33.2	N
01569800	Letort Spring Run near Carlisle, Pa.	40.235	-77.139	21.6	N
01570000	Conodoguinet Creek near Hogestown, Pa.	40.252	-77.021	470	LF
01570500	Susquehanna River at Harrisburg, Pa.	40.255	-76.886	24,100	Y
01571000	Paxton Creek near Penbrook, Pa.	40.308	-76.850	11.2	N
01571500	Yellow Breeches Creek near Camp Hill, Pa.	40.225	-76.898	213	N
01572000	Lower Little Swatara Creek at Pine Grove, Pa.	40.538	-76.377	34.3	N
01572025	Swatara Creek near Pine Grove, Pa.	40.533	-76.402	116	N
01572190	Swatara Creek near Inwood, Pa.	40.479	-76.531	167	N
01573000	Swatara Creek at Harper Tavern, Pa.	40.403	-76.577	337	N
01573086	Beck Creek near Cleona, Pa.	40.323	-76.483	7.87	N
01573160	Quittapahilla Creek near Bellegrove, Pa.	40.343	-76.562	74.2	N
01573500	Manada Creek at Manada Gap, Pa.	40.397	-76.709	13.5	N
01573560	Swatara Creek near Hershey, Pa.	40.298	-76.668	483	N
01574000	West Conewago Creek near Manchester, Pa.	40.082	-76.720	510	N
01574500	Codorus Creek at Spring Grove, Pa.	39.879	-76.853	75.5	Y
01575000	South Branch Codorus Creek near York, Pa.	39.921	-76.749	117	Y
01575500	Codorus Creek near York, Pa.	39.946	-76.755	222	Y
01576000	Susquehanna River at Marietta, Pa.	40.055	-76.531	25,990	Y
01576085	Little Conestoga Creek near Churchtown, Pa.	40.145	-75.989	5.82	N
01576500	Conestoga River at Lancaster, Pa.	40.050	-76.277	324	N
01576754	Conestoga River at Conestoga, Pa.	39.946	-76.368	470	N
01578310	Susquehanna River at Conowingo, Md.	39.658	-76.174	27,100	Y
01578400	Bowery Run near Quarryville, Pa.	39.895	-76.114	5.98	N
01580000	Deer Creek at Rocks, Md.	39.630	-76.403	94.4	N
01581500	Bynum Run at Bel Air, Md.	39.541	-76.330	8.52	N
01581700	Winters Run near Benson, Md.	39.520	-76.373	34.8	N
01582000	Little Falls at Blue Mount, Md.	39.604	-76.620	52.9	N
01582500	Gunpowder Falls at Glencoe, Md.	39.550	-76.636	160	Y
01583000	Slade Run near Glyndon, Md.	39.495	-76.795	2.09	N
01583100	Piney Run at Dover, Md.	39.521	-76.767	12.3	N

Table 2. Selected low-flow statistics for streamgage locations in and near Pennsylvania.—Continued

[ft³/s; cubic feet per second; —, statistic not computed; <, less than]

Streamgage number	Period of record used in analysis ¹	Number of years used in analysis	1-day, 10-year (ft ³ /s)	7-day, 10-year (ft ³ /s)	7-day, 2-year (ft ³ /s)	30-day, 10-year (ft ³ /s)	30-day, 2-year (ft ³ /s)	90-day, 10-year (ft ³ /s)
01565000	1941–2008	37	17.6	18.6	28.6	20.3	32.4	24.4
01565700	1965–1981	17	.4	.4	.9	.5	1.1	.8
01566000	1913–2008	52	4.3	7.9	18.8	12.4	25.6	19.2
01566500	1932–1958	27	1.7	2.4	4.0	3.2	5.7	4.9
01567000	² 1974–2008	35	504	534	725	589	857	727
01567000	³ 1901–1972	72	311	367	571	439	704	547
01567500	1955–2008	54	2.0	2.2	3.3	2.6	3.8	3.1
01568000	1931–2008	78	12.7	15.5	25.5	19.2	32.0	26.0
01568500	² 1943–1997	55	1.8	2.3	4.3	2.7	5.0	3.1
01569000	1939–1974	14	2.6	4.0	7.4	5.1	9.4	7.8
01569800	1978–2008	31	15.9	17.0	24.4	18.4	26.1	20.3
01570000	³ 1913–1969	35	—	63.1	110	76.1	124	95.3
01570000	² 1971–2008	38	63.1	69.3	109	78.3	125	97.8
01570500	³ 1901–1972	72	2,310	2,440	4,000	2,830	4,950	3,850
01570500	² 1974–2008	35	3,020	3,200	5,180	3,690	6,490	4,960
01571000	1941–1995	16	.1	.2	.6	.3	1.2	.8
01571500	1911–2008	62	81.6	86.8	115	94.0	124	105
01572000	1921–1984	14	2.1	2.3	4.8	3.0	6.5	4.5
01572025	1990–2008	17	15.2	16.4	26.7	18.5	34.6	27.7
01572190	1990–2008	17	19.1	20.5	36.2	23.9	45.8	35.3
01573000	1920–2008	89	18.0	22.0	52.0	30.8	69.2	50.9
01573086	1965–1981	17	.5	.6	2.6	.8	3.3	1.1
01573160	1977–1994	18	26.9	29.6	46.4	33.6	51.9	39.5
01573500	1939–1958	20	1.3	1.4	2.5	1.8	3.2	2.6
01573560	1977–2008	30	50.3	62.0	104	76.9	131	108
01574000	1930–2008	79	8.0	11.1	32.0	17.7	47.0	33.9
01574500	² 1968–2008	41	14.2	24.0	35.9	29.4	42.0	33.3
01574500	³ 1930–1966	34	2.3	7.1	11.5	9.3	14.8	12.7
01575000	² 1973–1995	23	.7	1.4	6.7	3.2	12.0	9.3
01575000	³ 1929–1971	43	.1	.6	10.3	2.3	15.0	6.1
01575500	² 1948–1996	49	12.1	18.7	41.3	23.9	50.0	33.8
01576000	³ 1933–1972	40	2,100	2,420	4,160	2,960	5,130	4,100
01576000	² 1974–2008	35	2,990	3,270	5,680	3,980	7,180	5,540
01576085	1984–1995	12	.4	.5	.8	.7	1.2	1.2
01576500	1931–2008	78	27.2	38.6	79.4	49.1	97.3	66.1
01576754	1986–2008	23	74.2	84.9	151	106	189	147
⁴ 01578310	1969–2008	40	549	2,820	5,650	4,190	7,380	6,140
01578400	1964–1981	18	1.4	1.5	2.7	1.9	3.2	2.5
⁴ 01580000	1928–2008	81	19.7	22.8	48.1	28.1	51.8	35.4
⁴ 01581500	1946–2008	28	.2	.3	1.2	.8	1.7	1.5
⁴ 01581700	1969–2008	40	4.7	5.5	17.5	8.1	18.3	12.0
⁴ 01582000	1946–2008	63	11.3	12.5	25.0	15.5	28.0	20.3
⁴ 01582500	1979–2008	27	41.2	43.9	78.8	53.8	90.6	74.1
⁴ 01583000	1949–1981	33	.3	.3	.7	.3	1.0	.6
⁴ 01583100	1984–2008	15	2.1	2.4	5.5	3.2	6.0	4.2

Attachment B

WQM 7.0 Modeling Output Values

WQM 7.0 Effluent Limits

<u>SWP Basin</u>		<u>Stream Code</u>		<u>Stream Name</u>			
07K		6685		SUSQUEHANNA RIVER			
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
87.690	MRPI Amity	PA0294250-24	0.050	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
87.440	Stardust Hotel	PA0086941-24	0.004	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
87.140	LTD Ranch House	PA0083984-24	0.004	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
85.560	Sheetz	PA0261378-24	0.007	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5

WQM 7.0 Effluent Limits

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>					
07K	6685	SUSQUEHANNA RIVER					
RMI	Name	Permit Number	Disc Flow (mgd)	Parameter	Effl. Limit 30-day Ave. (mg/L)	Effl. Limit Maximum (mg/L)	Effl. Limit Minimum (mg/L)
85.260	Pilot Travel	PA0084115-24	0.008	CBOD5	25		
				NH3-N	25	50	
				Dissolved Oxygen			5

WQM 7.0 Wasteload Allocations

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>
07K	6685	SUSQUEHANNA RIVER

NH3-N Acute Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
87.690	MRPI Amity	1.77	50	1.77	50	0	0
87.440	Stardust Hotel	1.77	50	1.77	50	0	0
87.140	LTD Ranch Hous	1.77	50	1.77	50	0	0
85.560	Sheetz	1.77	50	1.78	50	0	0
85.260	Pilot Travel	1.77	50	1.78	50	0	0

NH3-N Chronic Allocations

RMI	Discharge Name	Baseline Criterion (mg/L)	Baseline WLA (mg/L)	Multiple Criterion (mg/L)	Multiple WLA (mg/L)	Critical Reach	Percent Reduction
87.690	MRPI Amity	.42	25	.42	25	0	0
87.440	Stardust Hotel	.41	25	.42	25	0	0
87.140	LTD Ranch Hous	.41	25	.42	25	0	0
85.560	Sheetz	.41	25	.42	25	0	0
85.260	Pilot Travel	.41	25	.42	25	0	0

Dissolved Oxygen Allocations

RMI	Discharge Name	<u>CBOD5</u>		<u>NH3-N</u>		<u>Dissolved Oxygen</u>		Critical Reach	Percent Reduction
		Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)	Baseline (mg/L)	Multiple (mg/L)		
87.69	MRPI Amity	25	25	25	25	5	5	0	0
87.44	Stardust Hotel	25	25	25	25	5	5	0	0
87.14	LTD Ranch House	25	25	25	25	5	5	0	0
85.56	Sheetz	25	25	25	25	5	5	0	0
85.26	Pilot Travel	25	25	25	25	5	5	0	0

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	87.690	344.00	2955.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
MRPI Amity	PA0294250-24	0.0500	0.0500	0.0500	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	87.440	343.67	2956.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Stardust Hotel	PA0086941-24	0.0036	0.0036	0.0036	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	87.140	343.10	2957.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
LTD Ranch House	PA0083984-24	0.0045	0.0045	0.0045	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	85.560	337.75	2958.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Sheetz	PA0261378-24	0.0075	0.0075	0.0075	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	85.260	337.29	2959.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Pilot Travel	PA0084115-24	0.0080	0.0080	0.0080	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

Input Data WQM 7.0

SWP Basin	Stream Code	Stream Name	RMI	Elevation (ft)	Drainage Area (sq mi)	Slope (ft/ft)	PWS Withdrawal (mgd)	Apply FC
07K	6685	SUSQUEHANNA RIVER	85.100	337.06	2960.00	0.00000	0.00	<input checked="" type="checkbox"/>

Stream Data

Design Cond.	LFY	Trib Flow	Stream Flow	Rch Trav Time	Rch Velocity	WD Ratio	Rch Width	Rch Depth	Tributary		Stream	
	(cfsm)	(cfs)	(cfs)	(days)	(fps)		(ft)	(ft)	Temp (°C)	pH	Temp (°C)	pH
Q7-10	0.133	0.00	0.00	0.000	0.000	0.0	0.00	0.00	23.75	8.25	0.00	0.00
Q1-10		0.00	0.00	0.000	0.000							
Q30-10		0.00	0.00	0.000	0.000							

Discharge Data

Name	Permit Number	Existing Disc Flow (mgd)	Permitted Disc Flow (mgd)	Design Disc Flow (mgd)	Reserve Factor	Disc Temp (°C)	Disc pH
Plaza Mgmt	PA0246867-24	0.0150	0.0150	0.0150	0.000	25.00	7.00

Parameter Data

Parameter Name	Disc Conc (mg/L)	Trib Conc (mg/L)	Stream Conc (mg/L)	Fate Coef (1/days)
CBOD5	25.00	2.00	0.00	1.50
Dissolved Oxygen	5.00	8.24	0.00	0.00
NH3-N	25.00	0.00	0.00	0.70

WQM 7.0 D.O.Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07K	6685	SUSQUEHANNA RIVER		
<hr/>				
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
87.690	0.050	23.750	8.249	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
376.716	1.197	314.594	0.870	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
2.00	0.004	0.00	0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
8.242	1.109	Tsivoglou	5	
<u>Reach Travel Time (days)</u>	Subreach Results			
0.018	<u>TravTime (days)</u>	<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.002	2.00	0.00	7.70
	0.004	2.00	0.00	7.70
	0.005	2.00	0.00	7.70
	0.007	2.00	0.00	7.70
	0.009	2.00	0.00	7.70
	0.011	2.00	0.00	7.70
	0.012	2.00	0.00	7.70
	0.014	2.00	0.00	7.70
	0.016	2.00	0.00	7.70
	0.018	2.00	0.00	7.70
<hr/>				
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
87.440	0.054	23.750	8.248	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
372.079	1.189	313.043	0.888	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
2.00	0.004	0.01	0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
7.703	1.629	Tsivoglou	5	
<u>Reach Travel Time (days)</u>	Subreach Results			
0.021	<u>TravTime (days)</u>	<u>CBOD5 (mg/L)</u>	<u>NH3-N (mg/L)</u>	<u>D.O. (mg/L)</u>
	0.002	2.00	0.01	7.70
	0.004	2.00	0.01	7.70
	0.006	2.00	0.01	7.70
	0.008	2.00	0.01	7.70
	0.010	2.00	0.01	7.70
	0.012	2.00	0.01	7.70
	0.014	2.00	0.01	7.70
	0.017	2.00	0.01	7.70
	0.019	2.00	0.01	7.70
	0.021	2.00	0.01	7.70

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>			
07K	6685	SUSQUEHANNA RIVER			
<hr/>					
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>	
87.140	0.058	23.750		8.248	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>	
363.805	1.178	308.875		0.917	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>	
2.00	0.004	0.01		0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>	
7.703	2.997	Tsivoglou		5	
<u>Reach Travel Time (days)</u>					
0.105					
Subreach Results					
	<u>TravTime</u>	<u>CBOD5</u>	<u>NH3-N</u>	<u>D.O.</u>	
	(days)	(mg/L)	(mg/L)	(mg/L)	
	0.011	2.00	0.01	7.70	
	0.021	2.00	0.01	7.70	
	0.032	2.00	0.01	7.70	
	0.042	2.00	0.01	7.70	
	0.053	2.00	0.01	7.70	
	0.063	2.00	0.01	7.70	
	0.074	2.00	0.01	7.70	
	0.084	2.00	0.01	7.70	
	0.095	2.00	0.01	7.70	
	0.105	2.00	0.01	7.70	
<hr/>					
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>		<u>Analysis pH</u>	
85.560	0.066	23.750		8.248	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>		<u>Reach Velocity (fps)</u>	
375.054	1.194	314.207		0.878	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>		<u>Reach Kn (1/days)</u>	
2.00	0.004	0.01		0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>		<u>Reach DO Goal (mg/L)</u>	
7.703	1.300	Tsivoglou		5	
<u>Reach Travel Time (days)</u>					
0.021					
Subreach Results					
	<u>TravTime</u>	<u>CBOD5</u>	<u>NH3-N</u>	<u>D.O.</u>	
	(days)	(mg/L)	(mg/L)	(mg/L)	
	0.002	2.00	0.01	7.70	
	0.004	2.00	0.01	7.70	
	0.006	2.00	0.01	7.70	
	0.008	2.00	0.01	7.70	
	0.010	2.00	0.01	7.70	
	0.013	2.00	0.01	7.70	
	0.015	2.00	0.01	7.70	
	0.017	2.00	0.01	7.70	
	0.019	2.00	0.01	7.70	
	0.021	2.00	0.01	7.70	
<hr/>					

WQM 7.0 D.O. Simulation

<u>SWP Basin</u>	<u>Stream Code</u>	<u>Stream Name</u>		
07K	6685	SUSQUEHANNA RIVER		
<hr/>				
<u>RMI</u>	<u>Total Discharge Flow (mgd)</u>	<u>Analysis Temperature (°C)</u>	<u>Analysis pH</u>	
85.260	0.074	23.750	8.248	
<u>Reach Width (ft)</u>	<u>Reach Depth (ft)</u>	<u>Reach WDRatio</u>	<u>Reach Velocity (fps)</u>	
375.961	1.195	314.544	0.875	
<u>Reach CBOD5 (mg/L)</u>	<u>Reach Kc (1/days)</u>	<u>Reach NH3-N (mg/L)</u>	<u>Reach Kn (1/days)</u>	
2.01	0.004	0.01	0.934	
<u>Reach DO (mg/L)</u>	<u>Reach Kr (1/days)</u>	<u>Kr Equation</u>	<u>Reach DO Goal (mg/L)</u>	
7.703	1.214	Tsivoglou	5	
<u>Reach Travel Time (days)</u>				
0.011				
Subreach Results				
	<u>TravTime</u>	<u>CBOD5</u>	<u>NH3-N</u>	<u>D.O.</u>
	(days)	(mg/L)	(mg/L)	(mg/L)
	0.001	2.01	0.01	7.70
	0.002	2.01	0.01	7.70
	0.003	2.01	0.01	7.70
	0.004	2.01	0.01	7.70
	0.006	2.01	0.01	7.70
	0.007	2.01	0.01	7.70
	0.008	2.01	0.01	7.70
	0.009	2.01	0.01	7.70
	0.010	2.01	0.01	7.70
	0.011	2.01	0.01	7.70

WQM 7.0 Hydrodynamic Outputs

<u>SWP Basin</u>		<u>Stream Code</u>				<u>Stream Name</u>						
07K		6685				SUSQUEHANNA RIVER						
RMI	Stream Flow	PWS With	Net Stream Flow	Disc Analysis Flow	Reach Slope	Depth	Width	W/D Ratio	Velocity	Reach Trav Time	Analysis Temp	Analysis pH
	(cfs)	(cfs)	(cfs)	(cfs)	(ft/ft)	(ft)	(ft)		(fps)	(days)	(°C)	
Q7-10 Flow												
87.690	392.42	0.00	392.42	.0773	0.00025	1.197	376.72	314.59	0.87	0.018	23.75	8.25
87.440	392.56	0.00	392.56	.0829	0.00036	1.189	372.08	313.04	0.89	0.021	23.75	8.25
87.140	392.69	0.00	392.69	.0898	0.00064	1.178	363.81	308.88	0.92	0.105	23.75	8.25
85.560	392.82	0.00	392.82	.1014	0.00029	1.194	375.05	314.21	0.88	0.021	23.75	8.25
85.260	392.96	0.00	392.96	.1138	0.00027	1.195	375.96	314.54	0.87	0.011	23.75	8.25
Q1-10 Flow												
87.690	368.88	0.00	368.88	.0773	0.00025	NA	NA	NA	0.84	0.018	23.75	8.25
87.440	369.00	0.00	369.00	.0829	0.00036	NA	NA	NA	0.86	0.021	23.75	8.25
87.140	369.13	0.00	369.13	.0898	0.00064	NA	NA	NA	0.89	0.109	23.75	8.25
85.560	369.25	0.00	369.25	.1014	0.00029	NA	NA	NA	0.85	0.022	23.75	8.25
85.260	369.38	0.00	369.38	.1138	0.00027	NA	NA	NA	0.84	0.012	23.75	8.25
Q30-10 Flow												
87.690	451.29	0.00	451.29	.0773	0.00025	NA	NA	NA	0.94	0.016	23.75	8.25
87.440	451.44	0.00	451.44	.0829	0.00036	NA	NA	NA	0.96	0.019	23.75	8.25
87.140	451.59	0.00	451.59	.0898	0.00064	NA	NA	NA	0.99	0.097	23.75	8.25
85.560	451.75	0.00	451.75	.1014	0.00029	NA	NA	NA	0.95	0.019	23.75	8.25
85.260	451.90	0.00	451.90	.1138	0.00027	NA	NA	NA	0.95	0.010	23.75	8.25

WQM 7.0 Modeling Specifications

Parameters	Both	Use Inputted Q1-10 and Q30-10 Flows	<input type="checkbox"/>
WLA Method	EMPR	Use Inputted W/D Ratio	<input type="checkbox"/>
Q1-10/Q7-10 Ratio	0.94	Use Inputted Reach Travel Times	<input type="checkbox"/>
Q30-10/Q7-10 Ratio	1.15	Temperature Adjust Kr	<input checked="" type="checkbox"/>
D.O. Saturation	90.00%	Use Balanced Technology	<input checked="" type="checkbox"/>
D.O. Goal	5		

Attachment C

TRC Evaluation

MRPI Amity Hall / Susquehanna Crossings

PA0294250
March 2024



1A	B	C	D	E	F	G
2	TRC EVALUATION					
3	Input appropriate values in B4:B8 and E4:E7					
4	392.3651452	= Q stream (cfs)		0.5	= CV Daily	
5	0.05	= Q discharge (MGD)		0.5	= CV Hourly	
6	30	= no. samples		1	= AFC_Partial Mix Factor	
7	0.3	= Chlorine Demand of Stream		1	= CFC_Partial Mix Factor	
8	0	= Chlorine Demand of Discharge		15	= AFC_Criteria Compliance Time (min)	
9	0.5	= BAT/BPJ Value		720	= CFC_Criteria Compliance Time (min)	
	0	= % Factor of Safety (FOS)		0	=Decay Coefficient (K)	
10	Source	Reference	AFC Calculations		Reference	CFC Calculations
11	TRC	1.3.2.III	WLA_afc = #####		1.3.2.III	WLA_cfc = 1577.588
12	PENTOXSD TRG	5.1a	LTAMULT_afc = 0.373		5.1c	LTAMULT_cfc = 0.581
13	PENTOXSD TRG	5.1b	LTA_afc= 602.971		5.1d	LTA_cfc = 917.135
14						
15	Source	Effluent Limit Calculations				
16	PENTOXSD TRG	5.1f	AML_MULT = 1.231			
17	PENTOXSD TRG	5.1g	AVG MON LIMIT (mg/l) = 0.500		BAT/BPJ	
18			INST MAX LIMIT (mg/l) = 1.635			
	WLA_afc	(.019/e ^{-k*AFC_tc}) + [(AFC_Yc*Qs*.019/Qd*e ^{-k*AFC_tc})]... ...+ Xd + (AFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)				
	LTAMULT_afc	EXP((0.5*LN(cvh ² +1))-2.326*LN(cvh ² +1) ^{0.5})				
	LTA_afc	wla_afc*LTAMULT_afc				
	WLA_cfc	(.011/e ^{-k*CFC_tc}) + [(CFC_Yc*Qs*.011/Qd*e ^{-k*CFC_tc})]... ...+ Xd + (CFC_Yc*Qs*Xs/Qd)]*(1-FOS/100)				
	LTAMULT_cfc	EXP((0.5*LN(cvd ² /no_samples+1))-2.326*LN(cvd ² /no_samples+1) ^{0.5})				
	LTA_cfc	wla_cfc*LTAMULT_cfc				
	AML_MULT	EXP(2.326*LN((cvd ² /no_samples+1) ^{0.5})-0.5*LN(cvd ² /no_samples+1))				
	AVG MON LIMIT	MIN(BAT_BPJ,MIN(LTA_afc,LTA_cfc)*AML_MULT)				
	INST MAX LIMIT	1.5*((av_mon_limit/AML_MULT)/LTAMULT_afc)				