

Northwest Regional Office CLEAN WATER PROGRAM

Application Type
Wastewater Type
Facility Type
SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No. PA0295523

APS ID 1102351

Authorization ID 1464425

Applicant Name	Nancy Gustin	Facility Name	Nancy Gustin SRSTP		
Applicant Address	9499 Oliver Road	Facility Address	9499 Oliver Road		
	Waterford, PA 16441-3317		Waterford, PA 16441-3317		
Applicant Contact	Nancy Gustin	Facility Contact			
Applicant Phone	(814) 397-1522	Facility Phone			
Client ID	381413	Site ID	866181		
SIC Code	8800	Municipality	McKean Township		
SIC Description	Private Households	County	Erie		
Date Application Rec	eived October 30, 2023	WQM Required	Yes – Application Received		
Date Application Acco	epted	WQM App. No.	2523432		

Summary of Review

This is a new discharge which will serve an existing 5-bedroom home and replace an existing malfunctioning on-lot disposal system.

Act 14 – Notification has been submitted and received.

The proposed treatment system will consist of (WQM Permit No. 2523432): A Premier Tech Ecoflo Coco Filter EC7-600-P-P-USA Treatment system, an existing 1,500 gallon septic tank, and an integrated Rewatec Ultraviolet Disinfection unit.

There are NO open violations in WMS for the subject Client ID (381413) as of 4/16/24.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
Х		Dustin Hargenrater Dustin Hargenrater / Civil Engineer Trainee	April 16, 2024
		Vacant / Environmental Engineer Manager	Okay to Draft JCD 4/23/2024

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information						
Outfall No. 001	Design Flow (MGD)0006					
· · · · · · · · · · · · · · · · · · ·	Longitude80° 6' 14.8"					
Quad Name Cambridge Springs	Quad Code 41080H1					
Wastewater Description: Sewage Effluen	nt					
Unnamed Tributary to Receiving Waters (CWF, MF)	Elk Creek Stream Code 62618					
NHD Com ID 123920437	RMI 0.5700					
Drainage Area 0.0651	Yield (cfs/mi²) 0.0332					
Q ₇₋₁₀ Flow (cfs) 0.00216	Q ₇₋₁₀ Basis USGS - StreamStats					
Elevation (ft) 1,315	Slope (ft/ft)					
Watershed No. 15-A	Chapter 93 Class. CWF, MF					
Existing Use	Existing Use Qualifier					
Exceptions to Use	Exceptions to Critoria					
Assessment Status Attaining Use(s	·					
On word (a) of large signs and						
Source(s) of Impairment						
TMDL Status	Name					
						
Background/Ambient Data	Data Source					
pH (SU) 7.0	Default					
Temperature (°F) 68	Default					
Hardness (mg/L) 100	Default					
Other:						
Nearest Downstream Public Water Supply In	ntake Lake Erie					
PWS Waters Lake Erie	Flow at Intake (cfs)					
PWS RMI	Distance from Outfall (mi) 25.3					

Changes Since Last Permit Issuance: None – This is a new discharge (Planning was approved on October 2, 2023)

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of the EC7 treatment system.

The Coco filter treatment system is reportedly capable of BOD5 averages of 10 mg/L and TSS averages of 10 mg/L. This facility is not expected to impact the quality of the receiving stream.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (lbs/day) (1)		Concentrations (mg/L)			Minimum ⁽²⁾	Required	
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
	Report							
Flow (GPD)	Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	xxx	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
BOD5	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. the limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location and Receiving Stream Data

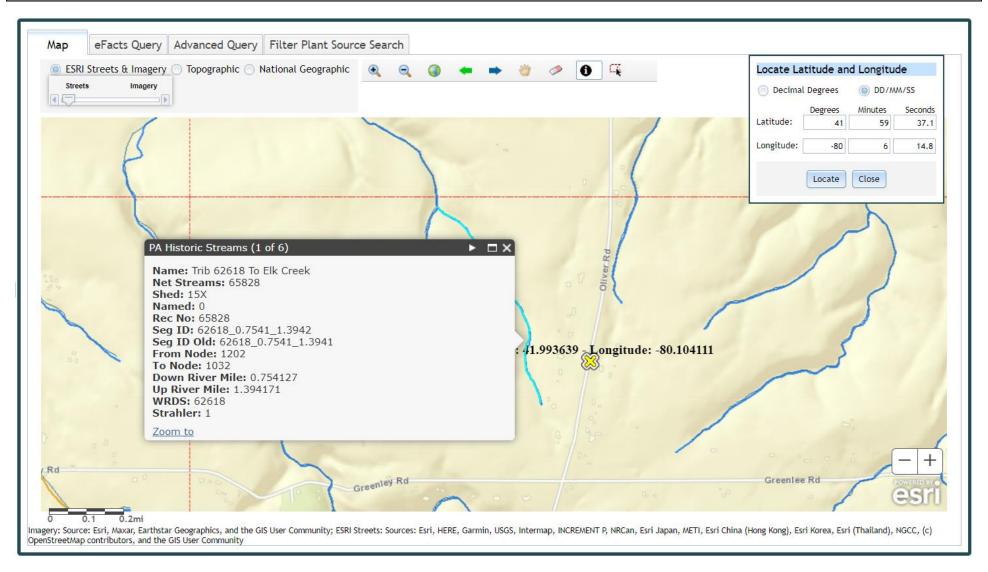

Attachment 2 Google Earth – Site Imagery

