

 Application Type
 New

 Wastewater Type
 Sewage

 Facility Type
 SRSTP

NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

 Application No.
 PA0295531

 APS ID
 1102364

 Authorization ID
 1464452

Applicant, Facility and Project Information

| Applicant Name | Chris F | rontera | Facility Name | Chris Frontera SRSTP | | |
|--|----------------------|--|-----------------------------|---|--|--|
| Applicant Address | 333 Pici | dilli Hill Road | Facility Address | 333 Picidilli Hill Road | | |
| | Corry, PA 16407-4007 | | | Corry, PA 16407-4007 | | |
| Applicant Contact | Chris Fr | ontera | Facility Contact | | | |
| Applicant Phone | (814) 881-9342 | | Facility Phone | | | |
| Client ID | 381414 | | Site ID | 866544 | | |
| SIC Code | 8800 | | Municipality | Columbus Township | | |
| SIC Description | Private Households | | County | Warren | | |
| Date Application Received October 31, 2023 | | October 31, 2023 | WQM Required | Yes – Application Received | | |
| Date Application Accepted | | WQM App. No. | 6223405 | | | |
| | | | | | | |
| Project Description | <u>.</u> | This is a new application for a existing dwelling. | a Single Residence Sewage 1 | Treatment Plant (SRSTP) which will serve an | | |

Summary of Review

This is a new discharge which will serve an existing 3-bedroom home and replace an existing malfunctioning on-lot disposal system.

Act 14 - Notifications were submitted and received.

The proposed treatment system will consist of (WQM Permit No. 6223405): A Premier Tech EC7-500-P-P-PACK-DiUV Coco Filter with integrated septic tank capacity, UV unit and pump preinstalled by the manufacturer.

There are NO open violations in WMS for the subject Client ID (381414) as of 4/16/24.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

| Approve | Deny | Signatures | Date | |
|---------|------|---|--------------------------------|--|
| х | | Dustin Hargenrater Dustin Hargenrater / Civil Engineer Trainee | April 16, 2024 | |
| | | <i>Vacant</i> / Environmental Engineer Manager | Okay to Draft JCD 4/23/2024 | |

Discharge and Stream Data - 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information

| Outfall No. 001 | Design Flow (MGD) | .0004 | | |
|---|--------------------------------|----------------------------|--|--|
| Latitude <u>41° 53' 44.77"</u> | Longitude | -79º 35' 11.03" 41079H5 | | |
| Quad Name Columbus | Quad Code | | | |
| Wastewater Description: Sewage Effluent | | | | |
| Unnamed Tributary of Hare Creek | | | | |
| Receiving Waters (CWF) | Stream Code | 56200 | | |
| NHD Com ID 112374913 | | 0.6700 0.0454 | | |
| Drainage Area 0.0537 | Yield (cfs/mi²) | | | |
| Q ₇₋₁₀ Flow (cfs) 0.00244 | Q ₇₋₁₀ Basis | USGS - StreamStats | | |
| Elevation (ft) 1,578 | Slope (ft/ft) | CWF | | |
| Watershed No. <u>16-B</u> | Chapter 93 Class. | | | |
| Existing Use | Existing Use Qualifier | | | |
| Exceptions to Use | Exceptions to Criteria | | | |
| Assessment Status Attaining Use(s) | | | | |
| Cause(s) of Impairment | | | | |
| Source(s) of Impairment | | | | |
| TMDL Status | Name | | | |
| Background/Ambient Data | Data Source | | | |
| pH (SU) 7.0 | Default | | | |
| Temperature (°F) 68 | Default - CWF | | | |
| Hardness (mg/L) | Default | | | |
| Other: | | | | |
| Nearest Downstream Public Water Supply Intake | Aqua Pennsylvania – Emlento | on | | |
| PWS Waters Allegheny River | Flow at Intake (cfs) 1,376 | | | |
| PWS RMI 90 | Distance from Outfall (mi) 119 | | | |

Changes Since Last Permit Issuance: None - This is a new discharge (Planning was approved on October 20, 2023)

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of the EC7 treatment system.

The Coco filter treatment system is reportedly capable of BOD5 averages of 10 mg/L and TSS averages of 10 mg/L. This facility is not expected to impact the quality of the receiving stream.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

| Parameter | Effluent Limitations | | | | | Monitoring Requirements | | |
|-----------------------------|-------------------------------------|-------------------|-----------------------|-------------------|---------|-------------------------|--------------------------|----------------|
| | Mass Units (Ibs/day) ⁽¹⁾ | | Concentrations (mg/L) | | | Minimum ⁽²⁾ | Required | |
| | Average Monthly | Average Weekly | Minimum | Annual Average | Maximum | Instant. Maximum | Measurement Frequency | Sample Type |
| Flow (GPD) | Report Annl Avg | xxx | xxx | xxx | xxx | xxx | 1/year | Estimate |
| рН (S.U.) | ххх | xxx | 6.0 Inst Min | XXX | xxx | 9.0 | Upon Request | Grab |
| BOD5 | ххх | ххх | XXX | 10.0 | XXX | 20 | 1/year | Grab |
| TSS | ХХХ | ххх | xxx | 10.0 | xxx | 20 | 1/year | Grab |
| Fecal Coliform (No./100 ml) | XXX | XXX | XXX | 200 | XXX | XXX | 1/year | Grab |

Compliance Sampling Location: Outfall 001, after disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. the limits for BOD5, Total Suspended Solids, and Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Attachment 1 eMap – Location and Receiving Stream Data

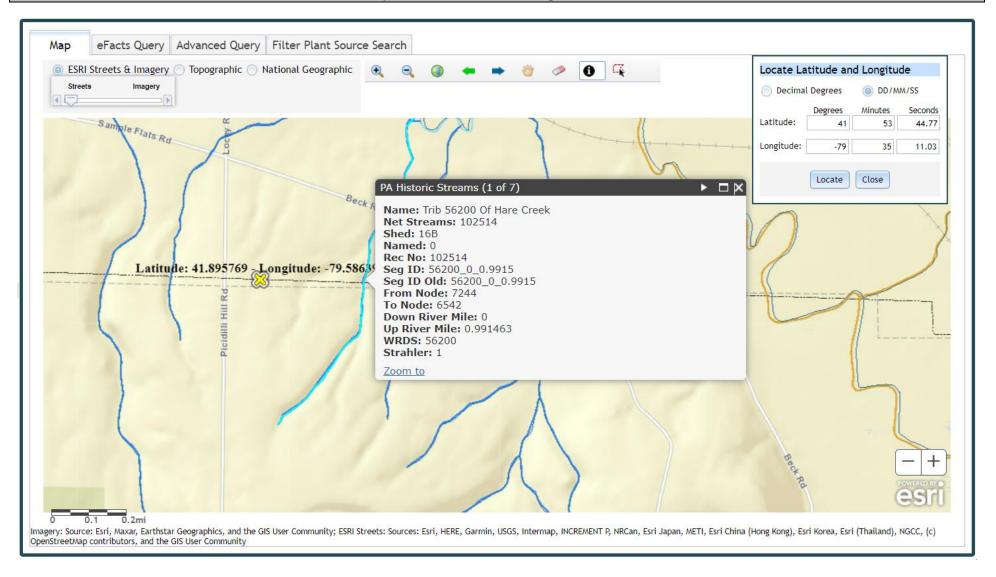

Attachment 2 Google Earth – Site Imagery

