

Application Type New
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. PA0295612
APS ID 1103627
Authorization ID 1467056

Applicant, Facility and Project Information

Applicant Name	<u>Jacob Fye</u>	Facility Name	<u>Jacob Fye SRSTP</u>
Applicant Address	<u>474 S 2nd Avenue</u> <u>Clarion, PA 16214-1428</u>	Facility Address	<u>291 Spring Road</u> <u>Summerville, PA 15864</u>
Applicant Contact	<u>Jacob Fye</u>	Facility Contact	<u></u>
Applicant Phone	<u>(814) 319-4362</u>	Facility Phone	<u></u>
Applicant Email	<u>jfye@championhomes.com</u>		<u></u>
Client ID	<u>381808</u>	Site ID	<u>867207</u>
SIC Code	<u>8800</u>	Municipality	<u>Limestone Township</u>
SIC Description	<u>Private Households</u>	County	<u>Clarion</u>
Date Application Received	<u>December 18, 2023</u>	WQM Required	<u>Yes</u>
Date Application Accepted	<u>January 16, 2024</u>	WQM App. No.	<u>1623405</u>
Project Description	<u>Installation of a new Single Residence Sewage Treatment Plant</u>		

Summary of Review

This is a new discharge for a proposed 3 bedrooms dwelling with proposed construction of a single residence sewage treatment plant. The average daily flow is projected to be 400 GPD.

Proposed treatment will consist of (WQM Permit No. 1623405): A Premier Tech EC7-500-P-P Pack coco filter unit with an integrated DiUV unit and pump preinstalled by the manufacturer. The point of discharge will be on the Fye property into Little Piney Creek, a CWF Creek that is perennial on the owner's property.

Act 14 – Proof of Notification was submitted and received.

Act 537 Sewage Facilities Planning Module Component 3s was approved by the department on November 22, 2023.

SPECIAL CONDITIONS: NONE

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (381808) as of January 17, 2024.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer	January 17, 2024
		Vacant / Environmental Engineer Manager	Okay to Draft JCD 1/17/2024

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	<u>001</u>	Design Flow (MGD)	<u>.0004</u>
Latitude	<u>41° 8' 56.96"</u>	Longitude	<u>-79° 18' 30.15"</u>
Quad Name	<u>Strattanville</u>	Quad Code	<u>41079B3</u>
Wastewater Description: <u>Sewage Effluent</u>			
Receiving Waters	<u>Little Piney Creek (CWF)</u>	Stream Code	<u>49560</u>
NHD Com ID	<u>102670903</u>	RMI	<u>3.51</u>
Drainage Area	<u>8.45</u>	Yield (cfs/mi ²)	<u>0.1</u>
Q ₇₋₁₀ Flow (cfs)	<u>0.845</u>	Q ₇₋₁₀ Basis	<u>Default</u>
Elevation (ft)	<u>1371</u>	Slope (ft/ft)	<u>---</u>
Watershed No.	<u>17-B</u>	Chapter 93 Class.	<u>CWF</u>
Existing Use	<u>---</u>	Existing Use Qualifier	<u>---</u>
Exceptions to Use	<u>---</u>	Exceptions to Criteria	<u>---</u>
Assessment Status	<u>Impaired</u>		
Cause(s) of Impairment	<u>Metals, pH</u>		
Source(s) of Impairment	<u>Acid Mine Drainage</u>		
TMDL Status	<u>---</u>	Name	<u>---</u>
Background/Ambient Data		Data Source	
pH (SU)	<u>7.0</u>	Default	
Temperature (°F)	<u>68</u>	Default	
Hardness (mg/L)	<u>100</u>	Default	
Other:			
Nearest Downstream Public Water Supply Intake	<u>Parker Area Water Authority</u>		
PWS Waters	<u>Allegheny River</u>	Flow at Intake (cfs)	<u>951</u>
PWS RMI	<u>83.96</u>	Distance from Outfall (mi)	<u>---</u>

Changes Since Last Permit Issuance: N/A -This is a proposed discharge (Planning was approved on November 22, 2023).

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Premier Tech EC7-500-P-P Pack coco filter unit.

The Premier Tech EC7-500-P-P Pack coco filter unit is reportedly capable of meeting BOD5 averages of 10 mg/L and TSS averages of 10 mg/L.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP.

The Little Piney Creek—the receiving water for discharges from Outfall 001—is impaired by Metals, pH and AMD but the subject facility is not expected to contribute to the impairment.

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the “NPDES Permit Writer’s Manual” (362-0400-001), SOPs and/or BPJ.

Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	Upon Request	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD5, Total Suspended Solids are BPJ-based on the Department’s “Small Flow Treatment Facilities Manual.” Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

Outfall Location - eMap with Aerial Imagery

Legend

Regulated Facilities and Related Information

Streams and Water Resources

Water Quality

- Existing Use Streams
 - Cold Water Fish
 - Exceptional Value
 - High Quality
 - Trout Stocking
 - Warm Water Fish
 - Overlap
- Designated Use Streams
 - Cold Water Fish
 - Exceptional Value
 - High Quality
 - Trout Stocking
 - Warm Water Fish
 - Overlap
 - Missing from CH93

Boundaries

- County Boundaries
- Municipalities

Map eFacts Query Advanced Query Filter Plant Source Search

ESRI Streets & Imagery Topographic National Geographic

Streets Imagery

Locate Latitude and Longitude

Decimal Degrees DD/MM/SS

Latitude:	Degrees	Minutes	Seconds
	41	8	56.96
Longitude:	Degrees	Minutes	Seconds
	-79	18	30.15

Locate Close

Designated Use Streams (1 of 3)

Latitude: 41.149156


Designated Use Gen ID: 17396
 GNIS Name: Little Piney Creek
 GNIS ID: 01179640
 ReachCode: 05010005001114
 COMID: 102670903
 Length Miles: 0.57
 Map Symbology: CWF
 Length Miles: 0.57
 Designated Use: 1
 DES Use ID: 1
 Use Description: CWF(COLD WATER FISHES)
 Migratory_Fish: N
 HUC: 05010005
 Basin: N
 Basin Narrative: Null
 Segment Narrative: Null
 Evaluation Date: Null
 Last Fdit Date: Null
[Zoom to](#)

Imagery: Source: Esri, Maxar, Earthstar Geographics, and the GIS User Community; ESRI Streets: Sources: Esri, HERE, Garmin, USGS, Intermap, INCREMENT P, NRCan, Esri Japan, METI, Esri China (Hong Kong), Esri Korea, Esri (Thailand), NGCC, (c) OpenStreetMap contributors, and the GIS User Community

Drainage Area Location – StreamStats with Aerial Imagery

StreamStats Report

Region ID: PA
Workspace ID: PA20240116205524256000
Clicked Point (Latitude, Longitude): 41.14923, -79.30835
Time: 2024-01-16 15:55:49 -0500

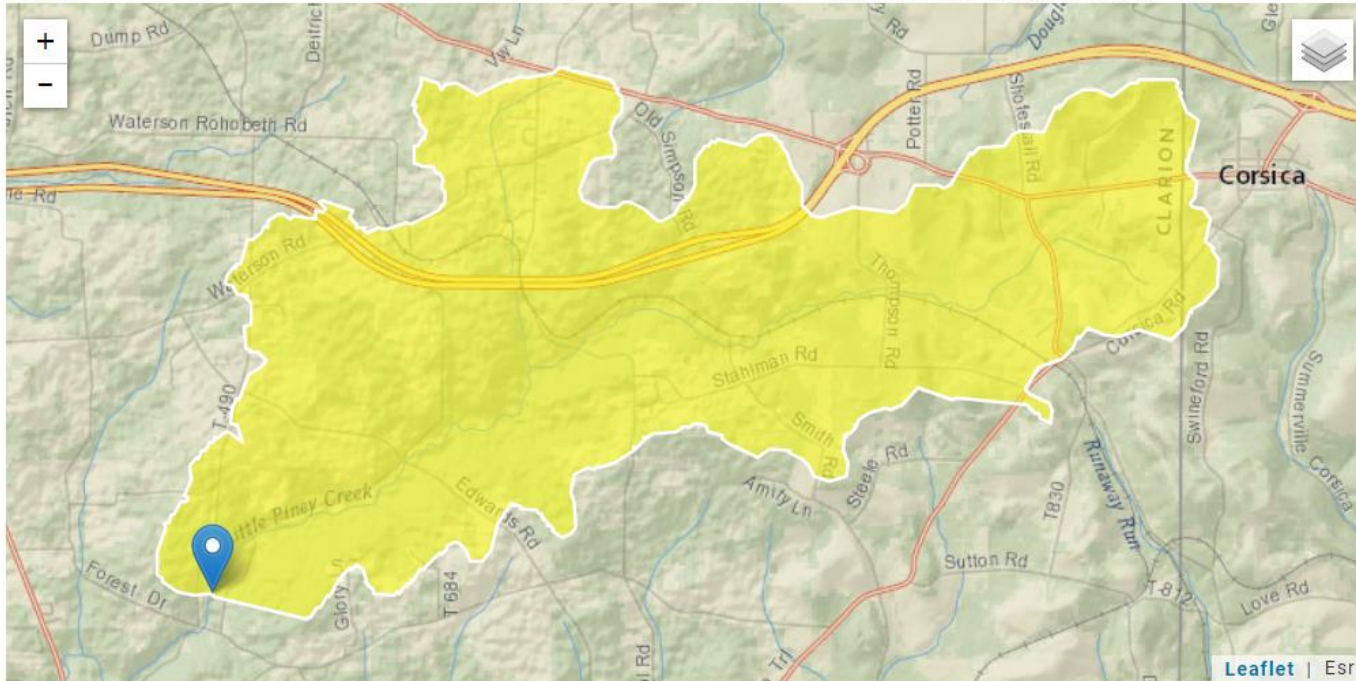

> Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	8.45	square miles