

...

Application Type	New
Wastewater Type	Sewage
Facility Type	SRSTP

# NPDES PERMIT FACT SHEET INDIVIDUAL SFTF/SRSTP

Application No.	PA0295701
APS ID	1107631
Authorization ID	1473522

### Applicant, Facility and Project Information

Applicant Name	Michael Labans	Facility Name	Michael Labans SRSTP
Applicant Address	213 Hope Road	Facility Address	213 Hope Road
	Cranberry Township, PA 16066-3809		Cranberry Township, PA 16066-3809
Applicant Contact	Michael Labans	Facility Contact	
Applicant Phone	(412) 963-4622	Facility Phone	
Client ID	383864	Site ID	868090
SIC Code	8800	Municipality	Cranberry Township
SIC Description	Private Households	County	Butler
Date Application Receiv	vedJanuary 22, 2024	WQM Required	Yes
Date Application Accep	ted	WQM App. No.	1024403
Project Description	Small Residence Sewage Treatmer	nt Plant (SRSTP).	

### Summary of Review

This is a new discharge for an existing 3-bedroom home to a repair of an existing malfunctioning on-lot system.

Act 14 - Proof of Notification was submitted and received.

Proposed treatment will consist of (WQM Permit No. 1024403): A Premier Tech EC7-500-P-P-PACK-DiUV Coco Filter unit with integrated UV unit and pump preinstalled.

The EPA Waiver is in effect.

There are no open violations in WMS for the subject Client ID (383864) as of 4/1/2024.

#### Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date		
х		Jordan A. Frey, E.I.T. Jordan A. Frey, E.I.T. / Project Manager	April 1, 2024		
		(Vacant) / Environmental Engineer Manager	Okay to Draft JCD 4/8/2024		

## Discharge and Stream Data - 2 - Receiving Waters and PWS

### Discharge, Receiving Waters and Water Supply Information

Outfall No. 001	Design Flow (MGD)	.0005	
Latitude 40° 43' 6.29"	Longitude	-80° 4' 9.48"	
Quad Name Mars	Quad Code	40080F1	
Wastewater Description: <u>Sewage Effluent</u>			
Unnamed Tributary to Wolfe Run			
Receiving Waters (WWF)	Stream Code	35038	
NHD Com ID 126220316	RMI	0.6500	
Drainage Area 0.29	Yield (cfs/mi <sup>2</sup> )	0.1	
Q <sub>7-10</sub> Flow (cfs) 0.029	Q <sub>7-10</sub> Basis	Default	
Elevation (ft) 1069	Slope (ft/ft)	Default	
Watershed No. 20-C	Chapter 93 Class.	WWF	
Existing Use	Existing Use Qualifier		
Exceptions to Use	Exceptions to Criteria		
Assessment Status Attaining Use(s)			
Cause(s) of Impairment			
Source(s) of Impairment			
TMDL Status	Name		
Background/Ambient Data	Data Source		
pH (SU) 7.0	Default		
Temperature (°F) 20	Default		
Hardness (mg/L) 100	Default		
Other:			
Nearest Downstream Public Water Supply Intake	Harmony Borough Water Auth	nority	
PWS Waters Connoquenessing Creek	Flow at Intake (cfs)	2.0	
PWS RMI 1.1	Distance from Outfall (mi)	9.5	

Changes Since Last Permit Issuance: N/A - This is a proposed discharge (Planning was approved on January 12, 2024).

Other Comments:

This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the use of a Coco Filter. The proposed discharge is to resolve a repair of a malfunctioning on-lot system.

The Coco Filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/l and TSS averages of 10 mg/l.

In accordance with the SOP, no water quality modeling was performed since this is a SRSTP.

### Proposed Effluent Limitations and Monitoring Requirements


The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.

### Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

	Effluent Limitations				Monitoring Requirements			
Parameter	Mass Units (Ibs/day) <sup>(1)</sup>			Concentrations (mg/L)			Minimum <sup>(2)</sup>	Required
Faialletei	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum	Measurement Frequency	Sample Type
Flow (GPD)	Report Annl Avg	xxx	xxx	XXX	xxx	XXX	1/year	Estimate
рН (S.U.)	ххх	xxx	6.0 Inst Min	XXX	xxx	9.0	Upon Request	Grab
BOD5	ххх	xxx	XXX	10.0	xxx	20	1/year	Grab
TSS	ХХХ	XXX	xxx	10.0	xxx	20	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after disinfection

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for BOD<sub>5</sub> and Total Suspended Solids are BPJ limits based on the Small Flow Treatment Facilities Manual. Fecal Coliform is technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7.

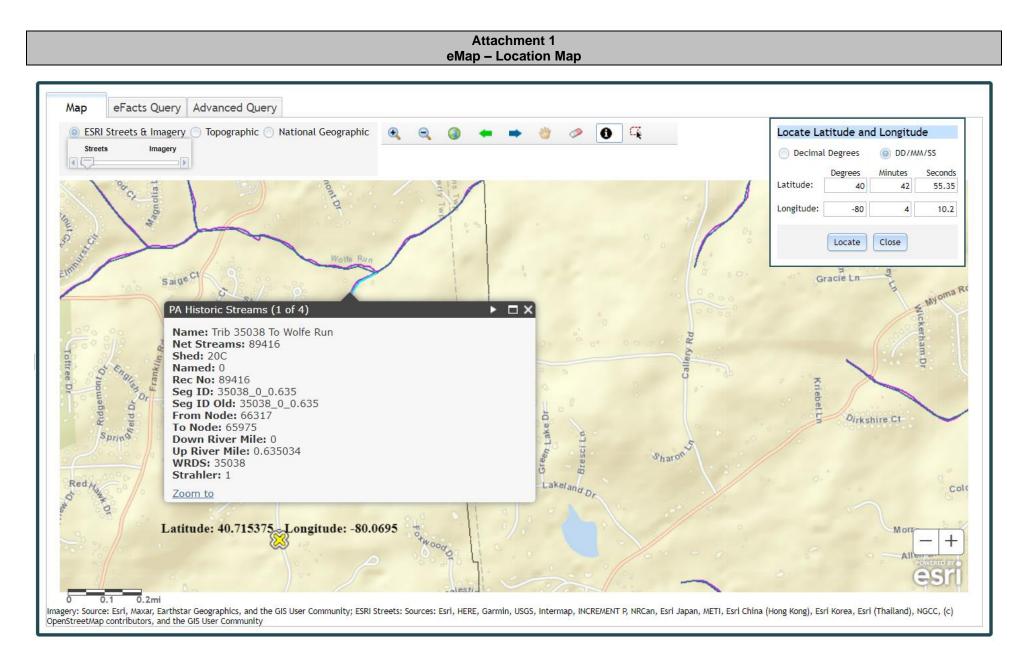

### Attachment 2 Google Earth Imagery

