

Application Type New
Wastewater Type Sewage
Facility Type SRSTP

**NPDES PERMIT FACT SHEET
INDIVIDUAL SFTF/SRSTP**

Application No. **PA0295833**
APS ID **1115234**
Authorization ID **1487775**

Applicant, Facility and Project Information

Applicant Name	<u>Tiffany Kline</u>	Facility Name	<u>Tiffany Kline SRSTP</u>
Applicant Address	<u>2983 W Washington Street</u>	Facility Address	<u>2069 W Washington Street</u>
Applicant Contact	<u>Bradford, PA 16701-2427</u>	Facility Contact	<u>Bradford, PA 16701-2565</u>
Applicant Phone	<u>(814) 362-2882</u>	Facility Phone	<u></u>
Applicant Email	<u>centipede16701@gmail.com</u>	Site ID	<u>871355</u>
Client ID	<u>386329</u>	Municipality	<u>Bradford Township</u>
SIC Code	<u>8800</u>	County	<u>McKean</u>
SIC Description	<u>Private Households</u>	WQM Required	<u>Yes</u>
Date Application Received	<u>May 20, 2024</u>	WQM App. No.	<u>4224403</u>
Date Application Accepted	<u>July 24, 2024</u>		
Project Description	<u>Installation of a new Single Residence Sewage Treatment Plant</u>		

Summary of Review

This is a new discharge for an existing 2 bedrooms residential dwelling with proposed construction of a single residence sewage treatment plant to replace a malfunctioning on-lot sewage system. The average daily flow is projected to be 400 GPD.

On July 22, 2024, a technical deficiency letter was emailed to the consultant to replace the proposed system – a Premier Tech EC7-500-P-P Pack coco filter unit – which requires upsized capacity to meet the effluent requirements for the corresponding flows.

On July 23, 2024, the design was revised. Proposed treatment will consist of (WQM Permit No. 4224403): A new NSF approved Premier Tech ECP-450-P-P Pack coco filter unit with an integrated effluent filter, DiUV disinfection unit and pump preinstalled by the manufacturer. The point of discharge will be on the owner's property into a drainage channel to Willow Creek, a HQ-CWF creek.

Act 14 – Proof of Notification was submitted and received.

Act 537 Sewage Facilities Planning Module Component 3s was approved by the department on May 13, 2024.

SPECIAL CONDITIONS: NONE

The EPA waiver is in effect.

There are NO open violations in WMS for the subject Client ID (386329) as of July 24, 2024.

Public Participation

DEP will publish notice of the receipt of the NPDES permit application and a tentative decision to issue the individual NPDES permit in the *Pennsylvania Bulletin* in accordance with 25 Pa. Code § 92a.82. Upon publication in the *Pennsylvania Bulletin*, DEP will accept written comments from interested persons for a 30-day period (which may be extended for one additional 15-day period at DEP's discretion), which will be considered in making a final decision on the application. Any person may request or petition for a public hearing with respect to the application. A public hearing may be held if DEP determines that there is significant public interest in holding a hearing. If a hearing is held, notice of the hearing will be published in the *Pennsylvania Bulletin* at least 30 days prior to the hearing and in at least one newspaper of general circulation within the geographical area of the discharge.

Approve	Deny	Signatures	Date
X		Aeshah Shameseldin Aeshah Shameseldin / Civil Engineer	July 24, 2024
		Vacant / Environmental Engineer Manager	Okay to Draft JCD 8/2/2024

Discharge and Stream Data – 2 - Receiving Waters and PWS

Discharge, Receiving Waters and Water Supply Information			
Outfall No.	001	Design Flow (MGD)	.0004
Latitude	41° 57' 46.78"	Longitude	-78° 46' 6.23"
Quad Name	Stickney	Quad Code	41078H7
Wastewater Description:	Sewage Effluent		
Receiving Waters	Willow Creek (HQ-CWF)	Stream Code	---
NHD Com ID	112366507	RMI	Confluence with Willow Creek 56875 is at 10.66 RMI
Drainage Area	---	Yield (cfs/mi ²)	---
Q ₇₋₁₀ Flow (cfs)	0	Q ₇₋₁₀ Basis	Dry Channel
Elevation (ft)	1970	Slope (ft/ft)	---
Watershed No.	16-B	Chapter 93 Class.	HQ-CWF
Existing Use	---	Existing Use Qualifier	---
Exceptions to Use	---	Exceptions to Criteria	---
Assessment Status	Attaining Use(s)		
Cause(s) of Impairment	---		
Source(s) of Impairment	---		
TMDL Status	---	Name	---
Background/Ambient Data		Data Source	
pH (SU)	7.0	Default	
Temperature (°F)	68	Default	
Hardness (mg/L)	100	Default	
Other:			
Nearest Downstream Public Water Supply Intake		Aqua Pennsylvania, Inc. - Emlenton	
PWS Waters	Allegheny River	Flow at Intake (cfs)	1,376
PWS RMI	90.0	Distance from Outfall (mi)	---

Changes Since Last Permit Issuance: N/A -This is a proposed discharge (Planning was approved on May 13, 2024).

Other Comments: This SRSTP was designed where applicable in accordance with the SFTF Manual, but it does not qualify for the PAG-04 General Permit due to the discharge into a High-Quality Watershed.

The Premier Tech ECP-450-P-P Pack coco filter unit is reportedly capable of meeting CBOD5 averages of 10 mg/L and TSS averages of 10 mg/L.

In accordance with the SOP, no water quality modeling was performed since this is an SRSTP

Proposed Effluent Limitations and Monitoring Requirements

The limitations and monitoring requirements specified below are proposed for the draft permit, and reflect the most stringent limitations amongst technology, water quality and BPJ. Instantaneous Maximum (IMAX) limits are determined using multipliers of 2 (conventional pollutants) or 2.5 (toxic pollutants). Sample frequencies and types are derived from the "NPDES Permit Writer's Manual" (362-0400-001), SOPs and/or BPJ.


Outfall 001, Effective Period: Permit Effective Date through Permit Expiration Date.

Parameter	Effluent Limitations						Monitoring Requirements	
	Mass Units (lbs/day) ⁽¹⁾		Concentrations (mg/L)				Minimum ⁽²⁾ Measurement Frequency	Required Sample Type
	Average Monthly	Average Weekly	Minimum	Annual Average	Maximum	Instant. Maximum		
Flow (GPD)	Report Annl Avg	XXX	XXX	XXX	XXX	XXX	1/year	Estimate
pH (S.U.)	XXX	XXX	6.0 Inst Min	XXX	XXX	9.0	1/month	Grab
CBOD5	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
TSS	XXX	XXX	XXX	10.0	XXX	20.0	1/year	Grab
Fecal Coliform (No./100 ml)	XXX	XXX	XXX	200	XXX	XXX	1/year	Grab

Compliance Sampling Location: Outfall 001, after UV disinfection.

Other Comments: Flow is monitor only based on Chapter 92a.61. The limits for CBOD5, Total Suspended Solids are BPJ-based on the Department's "Small Flow Treatment Facilities Manual." Fecal Coliform are technology-based on Chapter 92a.47. The limits for pH are technology-based on Chapter 93.7 and the monitoring frequency has been established as "1/month" due to special protection watershed designation (High Quality – HQ).

Outfall Location - eMap with Aerial Imagery

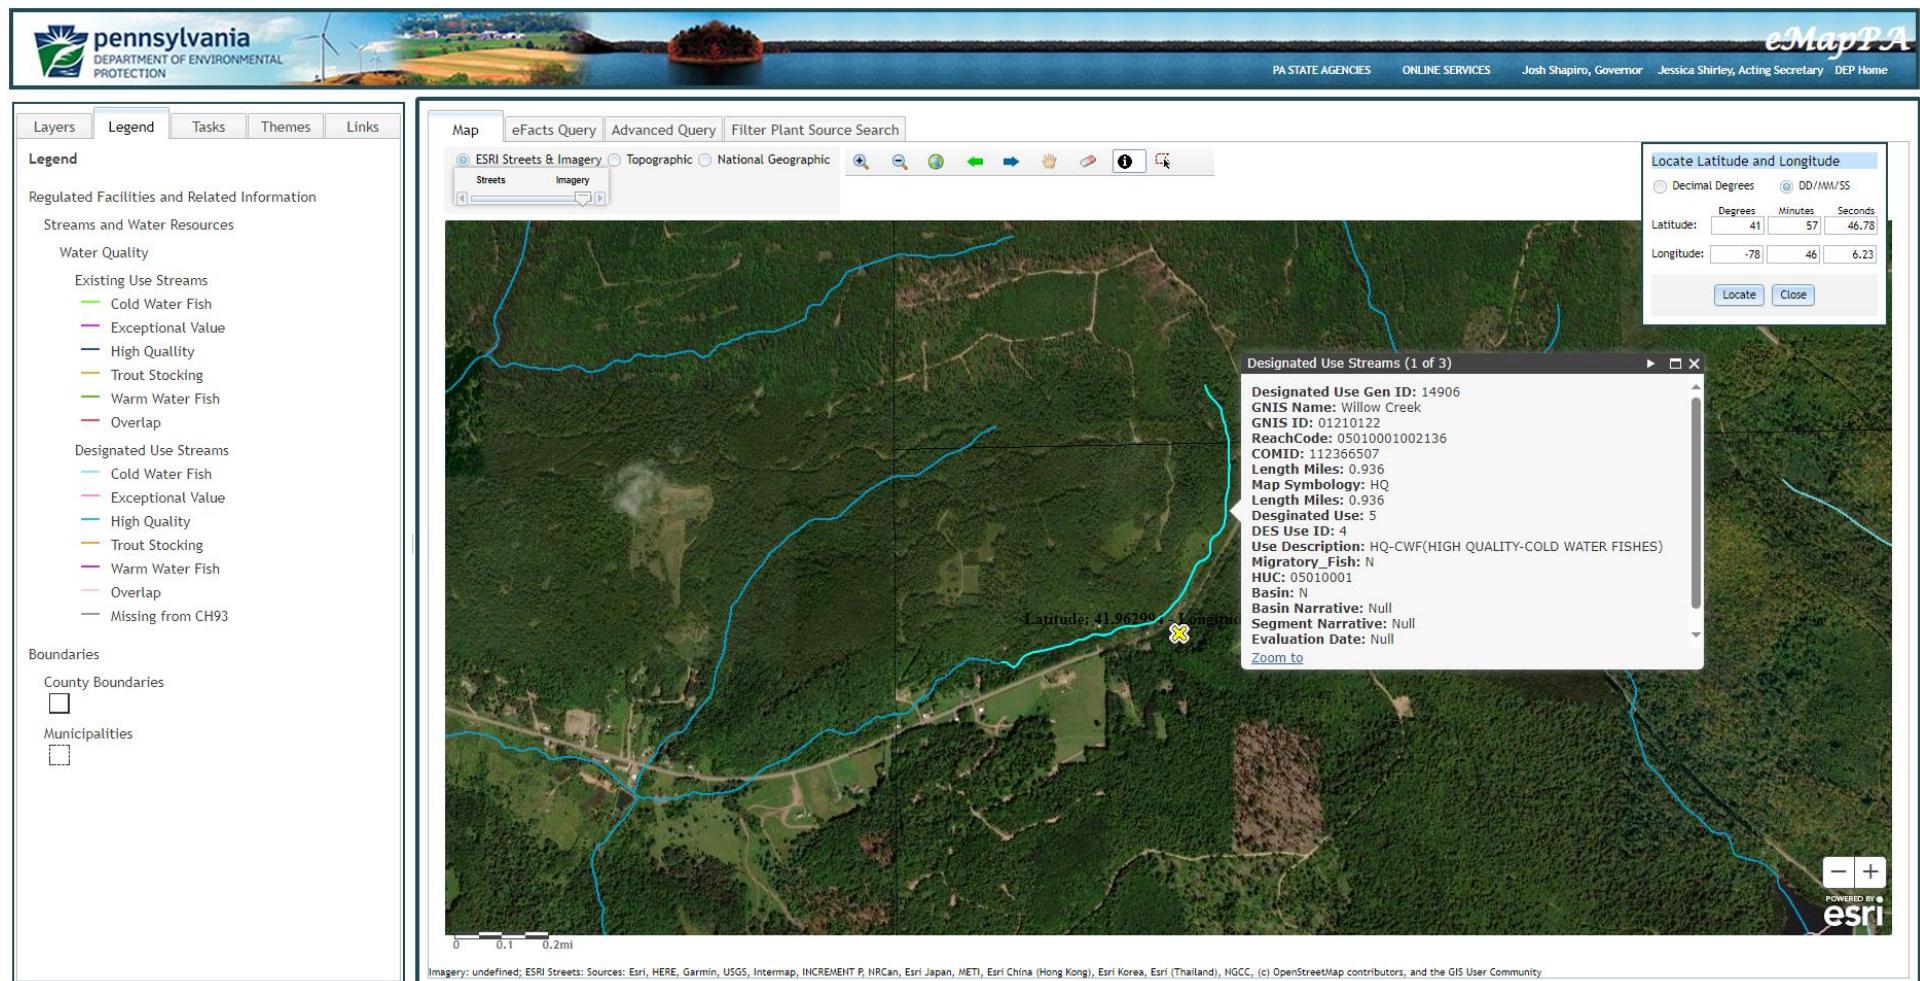

Drainage Area Location – StreamStats with Aerial Imagery

StreamStats Report

Region ID:

Workspace ID:

Clicked Point (Latitude, Longitude):


Time:

PA

PA20240724152615244000

41.96300, -78.76839

2024-07-24 11:26:38 -0400

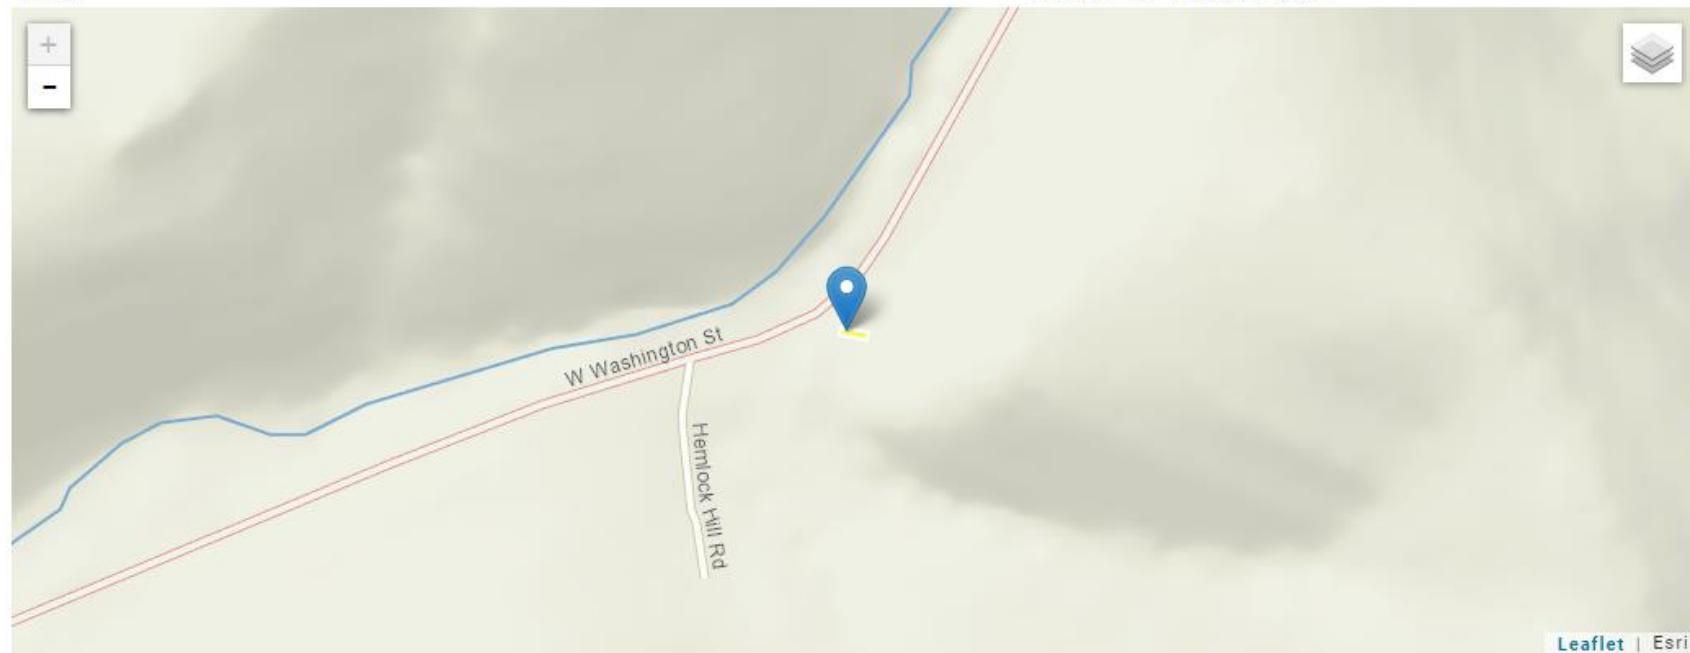

[Leaflet](#) | [Esri](#)

[Collapse All](#)

» Basin Characteristics

Parameter Code	Parameter Description	Value	Unit
DRNAREA	Area that drains to a point on a stream	0.000116	square miles